



भारत सरकार

Government of India

विद्युत मंत्रालय

Ministry of Power

उत्तर क्षेत्रीय विद्युत समिति

Northern Regional Power Committee

**विषय:** उत्तर क्षेत्रीय विद्युत समिति की एल.जी.बी.आर. उप-समिति की 31<sup>वीं</sup> बैठक का कार्यवृत्त ।

**Subject:** Minutes of 31<sup>st</sup> LGBR Sub-Committee meeting of NRPC.

उत्तर क्षेत्रीय विद्युत समिति की एल.जी.बी.आर. उप-समिति की 31<sup>वीं</sup> बैठक दिनांक 17.09.2025 को आयोजित की गई। उक्त बैठक का कार्यवृत्त उत्तर क्षेत्रीय विद्युत समिति की वेबसाइट <http://164.100.60.165> पर उपलब्ध है। यदि कार्यवृत्त पर कोई टिप्पणी हो तो कार्यवृत्त के जारी करने के एक सप्ताह के अंदर उ.क्षे.वि.स. सचिवालय को सूचित करें।

31<sup>st</sup> LGBR Sub-Committee meeting of NRPC was held on 17.09.2025. The Minutes of this meeting has been uploaded on the NRPC website <http://164.100.60.165>. Any comments on the minutes may kindly be submitted to NRPC Sectt within a week of issuance of the minutes.

**संलग्नक:** यथोपरि

DHARMENDER  
KUMAR MEENA

Digitally signed by  
DHARMENDER KUMAR  
MEENA  
Date: 2025.10.01 12:46:23  
+05'30'

(डी. के. मीना)

अधीक्षण अभियंता (प्रचालन)

सेवा में,

उ.क्षे.वि.स. की एल.जी.बी.आर. उप-समिति के सदस्य

| LGBR sub-committee Members for FY 2025-26 |                                     |                                        |                       |                                                                                  |
|-------------------------------------------|-------------------------------------|----------------------------------------|-----------------------|----------------------------------------------------------------------------------|
| S. N o.                                   | NRPC Member                         | Category                               | Nominated Member      | E-mail                                                                           |
| 1                                         | NRLDC                               | Northern Regional Load Despatch Centre | General Manager       | <a href="mailto:somara.lakra@grid-india.in">somara.lakra@grid-india.in</a>       |
| 2                                         | NTPC                                | Central Generating Company             | General Manager       | <a href="mailto:hrastogi@ntpc.co.in">hrastogi@ntpc.co.in</a>                     |
| 3                                         | BBMB                                |                                        | Chief Engineer        | <a href="mailto:powerc@bbmb.nic.in">powerc@bbmb.nic.in</a>                       |
| 3                                         | THDC                                |                                        | General Manager       | <a href="mailto:ravindrasrana@thdc.co.in">ravindrasrana@thdc.co.in</a>           |
| 4                                         | SJVN                                |                                        | General Manager       | <a href="mailto:sjvn.cso@sjvn.nic.in">sjvn.cso@sjvn.nic.in</a>                   |
| 5                                         | NHPC                                |                                        | General Manager       | <a href="mailto:surendramishra@nhpc.nic.in">surendramishra@nhpc.nic.in</a>       |
| 5                                         | NPCIL                               |                                        | General Manager       | <a href="mailto:df@npcil.co.in">df@npcil.co.in</a>                               |
| 6                                         | Delhi SLDC                          | State Load Despatch Centre             | General Manager       | <a href="mailto:gmsldc@delhisldc.org">gmsldc@delhisldc.org</a>                   |
| 7                                         | Haryana SLDC                        |                                        | Chief Engineer (SO&C) | <a href="mailto:cesocomml@hvpn.org.in">cesocomml@hvpn.org.in</a>                 |
| 7                                         | Rajasthan SLDC                      |                                        | Chief Engineer (LD)   | <a href="mailto:ce.ld@rvpn.co.in">ce.ld@rvpn.co.in</a>                           |
| 8                                         | Uttar Pradesh SLDC                  |                                        | Chief Engineer        | <a href="mailto:cepso@upsldc.org">cepso@upsldc.org</a>                           |
| 9                                         | Uttarakhand SLDC                    |                                        | Chief Engineer        | <a href="mailto:se_sldc@ptcul.org">se_sldc@ptcul.org</a>                         |
| 9                                         | Punjab SLDC                         |                                        | Chief Engineer        | <a href="mailto:ce-sldc@pstcl.org">ce-sldc@pstcl.org</a>                         |
| 10                                        | Himachal Pradesh SLDC               |                                        | Chief Engineer        | <a href="mailto:cehpsldc@gmail.com">cehpsldc@gmail.com</a>                       |
| 15                                        | IPGCL                               | State Generating Company               | Chief Engineer        | <a href="mailto:ncsharma@ipgcl-ppcl.nic.in">ncsharma@ipgcl-ppcl.nic.in</a>       |
| 16                                        | HPGCL                               |                                        | Chief Engineer        | <a href="mailto:seom2.rgtp@hpgcl.org.in">seom2.rgtp@hpgcl.org.in</a>             |
| 17                                        | RRVUNL                              |                                        | Chief Engineer        | <a href="mailto:ce.ppmcit@rrvun.com">ce.ppmcit@rrvun.com</a>                     |
| 17                                        | UPRVUNL                             |                                        | Chief Engineer        | <a href="mailto:cgm.to@uprvunl.org">cgm.to@uprvunl.org</a>                       |
| 18                                        | UJVNL                               |                                        | General Manager       | <a href="mailto:gm_engg_ujvn@yahoo.co.in">gm_engg_ujvn@yahoo.co.in</a>           |
| 19                                        | HPPCL                               |                                        | General Manager       | <a href="mailto:gm_generation@hppcl.in">gm_generation@hppcl.in</a>               |
| 19                                        | PSPCL                               |                                        | Chief Engineer        | <a href="mailto:ce-ppr@pspcl.in">ce-ppr@pspcl.in</a>                             |
| 23                                        | Prayagraj Power Generation Co. Ltd. | IPP having more than 1000 MW installed | General Manager       | <a href="mailto:sanjay.bhargava@tatapower.com">sanjay.bhargava@tatapower.com</a> |

|    |                                       |                                                                                                           |                           |                                                                                      |
|----|---------------------------------------|-----------------------------------------------------------------------------------------------------------|---------------------------|--------------------------------------------------------------------------------------|
| 24 | Aravali Power Company Pvt. Ltd        | capacity                                                                                                  | General Manager           | <a href="mailto:amit.hooda01@gmail.com">amit.hooda01@gmail.com</a>                   |
| 25 | Apraave Energy Ltd.,                  |                                                                                                           | General Manager           | <a href="mailto:rajneesh.setia@apraava.com">rajneesh.setia@apraava.com</a>           |
| 25 | Talwandi Sabo Power Ltd.              |                                                                                                           | General Manager           | <a href="mailto:ravinder.thakur@vedanta.co.in">ravinder.thakur@vedanta.co.in</a>     |
| 26 | Nabha Power Limited                   |                                                                                                           | General Manager           | <a href="mailto:Durvesh.Yadav@larsentoubr o.com">Durvesh.Yadav@larsentoubr o.com</a> |
| 27 | MEIL Anpara Energy Limited            |                                                                                                           | General Manager           | <a href="mailto:arun.tholia@meilanparapower.com">arun.tholia@meilanparapower.com</a> |
| 27 | Rosa Power Supply Company Ltd         |                                                                                                           | General Manager           | <a href="mailto:Suvendu.Dey@relianceada.com">Suvendu.Dey@relianceada.com</a>         |
| 28 | Lalitpur Power Generation Company Ltd |                                                                                                           | General Manager           | <a href="mailto:ansar.ltp@lpgcl.com">ansar.ltp@lpgcl.com</a>                         |
| 29 | MEJA Urja Nigam Ltd.                  |                                                                                                           | General Manager           | <a href="mailto:rsjuneja@ntpc.co.in">rsjuneja@ntpc.co.in</a>                         |
| 29 | Adani Power Rajasthan Limited         |                                                                                                           | General Manager           | <a href="mailto:manoj.taunk@adani.com">manoj.taunk@adani.com</a>                     |
| 30 | JSW Energy Ltd. (KWHEP)               |                                                                                                           | General Manager           | <a href="mailto:roshan.zipta@jsw.in">roshan.zipta@jsw.in</a>                         |
| 31 | UT of J&K                             | From each of the Union Territories in the region, a representative nominated by the administration of the | Chief Engineer, JKPTCL    | <a href="mailto:sojpdd@gmail.com">sojpdd@gmail.com</a>                               |
| 32 | UT of Ladakh                          |                                                                                                           | Chief Engineer, LPDD      | <a href="mailto:cepdladakh@gmail.com">cepdladakh@gmail.com</a>                       |
| 33 | UT of Chandigarh                      |                                                                                                           | Executive Engineer, EWEDC | <a href="mailto:elop2-chd@nic.in">elop2-chd@nic.in</a>                               |

|  |  |                                                                                                       |  |  |
|--|--|-------------------------------------------------------------------------------------------------------|--|--|
|  |  | Union<br>Territory<br>concerned<br>out of the<br>entities<br>engaged in<br>generation/<br>transmissio |  |  |
|--|--|-------------------------------------------------------------------------------------------------------|--|--|

### Minutes of the 31<sup>st</sup> LGBR Sub-Committee meeting

1. 31<sup>st</sup> LGBR Sub-Committee meeting was held on 17.09.2025 through Video Conference.
2. Member Secretary, NRPC extended a warm welcome to all the members and participants. He informed that this meeting is being conducted for finalization of annual outage schedule of generating units and month-wise, state-wise demand of Northern Region for FY 2026-27.
3. EE(O), NRPC informed that in 233<sup>rd</sup> OCC meeting, all generating stations in the Northern Region were requested to submit their unit-wise planned maintenance schedule for the year 2026-27 in the prescribed format and SLDC's of Northern Region were asked to submit the month-wise, state-wise demand for FY 2026-27.
4. The copy of presentation delivered in the 31<sup>st</sup> LGBR sub-committee meeting is attached as **Annexure-I**. Discussions held on the proposed planned annual maintenance program of NR generators for FY 2026-27 and projected figures of demand for FY 2026-27 are as under:

#### A. Proposed Planned Outages for the period of Apr-26 to Mar-27

1. SE(O), NRPC emphasized the need to review the existing methodology for annual outage planning, which was originally formulated during the 1<sup>st</sup>, 12<sup>th</sup>, and 18<sup>th</sup> LGBR Sub-Committee meetings. It was noted that the initial framework, established during the 1<sup>st</sup> LGBR Sub-Committee meeting, may no longer be fully adequate given the current scenario, particularly considering the significant increase in the number of generating units with capacities of 500 MW and above in the Northern Region.
2. EE(O), NRPC presented the salient points of the annual outage Planning methodology decided in 1<sup>st</sup>, 12<sup>th</sup> & 18<sup>th</sup> LGBR Sub-committee.
3. LGBR Sub-Committee has reviewed old methodology and approved the following revisions to the aforementioned outage planning methodology:
  - Planned shutdown of generating unit, particularly that of **500 MW & above** should be avoided during summer particularly during the period from 1<sup>st</sup> April to June. However, in case of **Rajasthan** since their peak demand occurs during winter & also since considerable wind generation is available during summer, planned outage of intra-State generating units may be allowed in summer after careful consideration.
  - Planned shutdown of thermal units especially those with a capacity of 500 MW & above, should be avoided during the winter period-particularly from **15<sup>th</sup> December to 31<sup>st</sup> January where major beneficiaries are hydro-rich states.**
  - Concurrent **shutdown** of more than **two generating units** of capacity **500 MW or above** during the period **from 1<sup>st</sup> October to 31<sup>st</sup> March** may be allowed.

4. The Proposed Planned outages of generators, received from states and Generating utilities for the period of Apr-26 to Mar-27 was discussed.
5. SE(O), NRPC informed that in the various review meetings taken by Chairperson, CEA regarding revival of units under outage, it has been deliberated that planned outages in the month of April, May and June 2026 shall be avoided considering high all India demand in that duration.
6. Based on the deliberation held in the meeting, some of the outage of thermal units proposed by Utilities were revised.

| Station                  | Unit | Capacity (MW) | Revised Outage from | Revised Outage To | Duration (days) | Remarks                                                                 |
|--------------------------|------|---------------|---------------------|-------------------|-----------------|-------------------------------------------------------------------------|
| MAHATMA GANDHI TPS (JPL) | 1    | 660           | 01-Mar-26           | 07-Apr-26         | 38              | Planned Unit Biennial Outage                                            |
| SINGRAULI STPS           | 1    | 200           | 01-Jul-26           | 15-Aug-26         | 45              | Boiler + Turbine + Gen (Stator trunnion stud replacement) + Turbine RLA |
| SINGRAULI STPS           | 2    | 200           | 01-Sep-26           | 15-Oct-26         | 45              | Boiler+Gen + Turbine + Turbine RLA                                      |
| SINGRAULI STPS           | 7    | 500           | 16-Oct-26           | 14-Nov-26         | 30              | Boiler+TG Brg Inspection+LP T (PAUT)+ TG Valves                         |
| RIHAND-I STPS            | 1    | 500           | 01-Oct-26           | 24-Nov-26         | 55              | Boiler +Turbine (all 4 modules) +Gen                                    |
| RIHAND-II STPS           | 1    | 500           | 10-Mar-26           | 10-Apr-26         | 32              | Boiler +LPT (LSB replacement with de-tunned) + TG Bearing & Valves      |
| UNCHAHAAR-II TPS         | 2    | 210           | 01-Aug-26           | 30-Aug-26         | 30              | Boiler+LPT + Gen+TG Brg & valves Inspection                             |
| UNCHAHAAR-III TPS        | 1    | 210           | 01-Mar-26           | 10-Apr-27         | 44              | Boiler+Turbine +Turbine RLA                                             |
| AURAIYA CCPP             | GT-I | 660           | 02-Jul-26           | 16-Jul-26         | 15              | Turbine Inspection + Filter Replacement                                 |
| AURAIYA                  | GT-  | 216           | 25-Jul-26           | 08-Aug-           | 15              | Combustor                                                               |

|                  |        |     |           |           |    |                                                                  |
|------------------|--------|-----|-----------|-----------|----|------------------------------------------------------------------|
| CCPP             | 3      |     |           | 26        |    | Inspection + Filter Replacement + Fourth stage Blade Replacement |
| PPS-III BAWANA   | STG -2 | 254 | 21-Mar-27 | 30-Mar-27 | 10 | Condenser Cleaning & Transformer testing                         |
| SSTPS SURATGARH  | 4      | 250 | 07-Jul-26 | 31-Jul-26 | 25 | Annual Boiler Overhaul                                           |
| SSTPS SURATGARH  | 6      | 250 | 01-Aug-26 | 25-Aug-26 | 25 | Annual Boiler Overhaul                                           |
| KOTA TPS (KSTPS) | 5      | 210 | 07-Aug-26 | 31-Aug-26 | 25 | Annual Boiler Overhaul                                           |
| KOTA TPS (KSTPS) | 6      | 195 | 01-Sep-26 | 20-Oct-26 | 50 | Strengthen of Boiler tubes                                       |
| CSCTPP CHHABRA   | 5      | 660 | 26-Sep-26 | 25-Oct-26 | 30 | Annual Boiler Overhaul                                           |
| CSCTPP CHHABRA   | 6      | 660 | 01-Aug-26 | 30-Aug-26 | 30 | Annual Boiler Overhaul                                           |

7. In the meeting, MS, NRPC asked HPGCL to submit the consent of HPPC and Haryana SLDC in written to NRPC Sectt. for planned outage of DCR TPS YAMUNA NAGAR (Unit-2) and RAJIV GANDHI TPS HISAR (Unit-2) in the month of April 2026.
8. Talwandi Sabo and Nabha Power Ltd were requested to review their proposed outage plan of their respective units for FY 2026–27 in consultation with PSPCL, as the proposed overhaul periods currently overlap, potentially impacting power availability of Punjab.
9. With regard to the State Thermal Generating Units of Rajasthan, MS NRPC mentioned that since the maximum power demand of state of Rajasthan is experienced during winter (Rabi crop) season therefore simultaneous/overlap outage of RRVUNL units not more than 500 MW may be allowed from April 2026 to June 2026 so that major/annual maintenance of RRVUNL generating units is completed by October 2026 so as to avoid major breakdown of RRVUNL thermal units and ensure maximum uninterrupted power availability during Rabi season.
10. RRVUNL submitted that during Summer Season (from April to June) Rajasthan experiences adequate availability of wind and solar power generation.
11. RRVUNL was advised to review the proposed annual maintenance schedule of the following units to ensure that simultaneous or overlapping outages of its units do not exceed a combined capacity of 500 MW during the period from April to June 2026

| Station               | Unit | Capacity (MW) | Original Outage from | Original Outage To | Duration (days) | Remarks                                      |
|-----------------------|------|---------------|----------------------|--------------------|-----------------|----------------------------------------------|
| SSTPS SURATGARH       | 4    | 250           | 01-Jun-26            | 25-Jun-26          | 25              | Annual Boiler Overhaul                       |
| KALISINDH TPS (KATPP) | 1    | 600           | 01-May-26            | 19-Jun-26          | 50              | Replacement of Economiser Boiler Tube Panels |
| CSCTPP CHHABRA        | 5    | 660           | 15-Jun-26            | 14-Jul-26          | 30              | Annual Boiler Overhaul                       |

12. The planned outage schedule for generators in NR, agreed in the meeting is enclosed at **Annexure-A.II**.

#### **B. Anticipated Demand Data for the period Apr-26 to Mar-27**

1. It was intimated that all states / UTs of NR region, have submitted their anticipated demand data for the period Apr-26 to Mar-27.
2. EE(O), NRPC presented the demand figures computed by NRPC Secretariat using the Weightage Average (WA) method and CAGR method and the figures submitted by States / UTs of NR.
3. MS, NRPC suggested that since the demand figures computed by NRPC Secretariat using the Weightage Average (WA) method and CAGR methods were not shared with the States /UTs of NR prior to the meeting, the SLDC's of respective States/UTs of NR may review the demand projections calculated by them and if any variation/changes are there same can be communicated to NRPC Sectt. via mail subsequently, if required a follow-up meeting will be convened with the States/UTs of NR for finalization of month-wise, state-wise demand forecasts for FY 2026-27.

The meeting ended with vote of thanks.

\*\*\*





# 31<sup>st</sup> LGBR Meeting (NRPC)

# Planned Outage Schedule

---

Annual Outage Planning methodology decided in 1<sup>st</sup>, 12<sup>th</sup> & 18<sup>th</sup> LGBR Sub-Committee meeting:

- Planned shutdown of generating unit, particularly that of **500 MW & above** should be avoided during summer particularly during the period from **1<sup>st</sup> June to 30<sup>th</sup> August**. However, in case of **Rajasthan** since their peak demand occurs during winter & also since considerable wind generation is available during summer, planned outage of intra-State generating units may be allowed in summer after careful consideration.
- Planned shutdown of **thermal units** particularly that of **500 MW & above** should be avoided during winter particularly from **15<sup>th</sup> December to 15<sup>th</sup> January**
- **Concurrent shutdown** of more than **two generating units** of capacity **500 MW or more** during the period from **15<sup>th</sup> Feb to 30<sup>th</sup> April** and from **1<sup>st</sup> October to 30<sup>th</sup> November** may be allowed.

# Planned Outage Schedule

---

- **During peak months**, shut downs in combined cycle gas based stations should be planned in such a manner that operation in **open cycle is avoided**. For this purpose, whenever shutdown of ST unit is planned, endeavor should be made to carry out maintenance in GT units of the module as well.
- There is not much flexibility as far as planned shutdown of GTs is concerned as the same is to be decided based on Equivalent Operating Hours (EOH). However, possibility of advancing these shutdowns should be considered to the extent possible so as to follow other guidelines
- In case of Gas based station, the generating company shall inform beneficiaries, NRLDC and NRPC Secretariat at least 100 hours before EOH is about to expire.

# Planned Outage Schedule

---

- Concurrent planned shutdown of two generating unit at a generating station should be avoided.
- For Central Generating Stations dedicated to a particular State, prior consultation with SLDC concerned would be carried out before finalizing annual generation outage plan.






**Planned Outage Schedule  
proposed for  
F.Y. 2026-27**

## 2026-27 Total Planned Outage Schedule (MW) of NR



## 2026-27 Thermal Planned Outage Schedule (MW) of NR

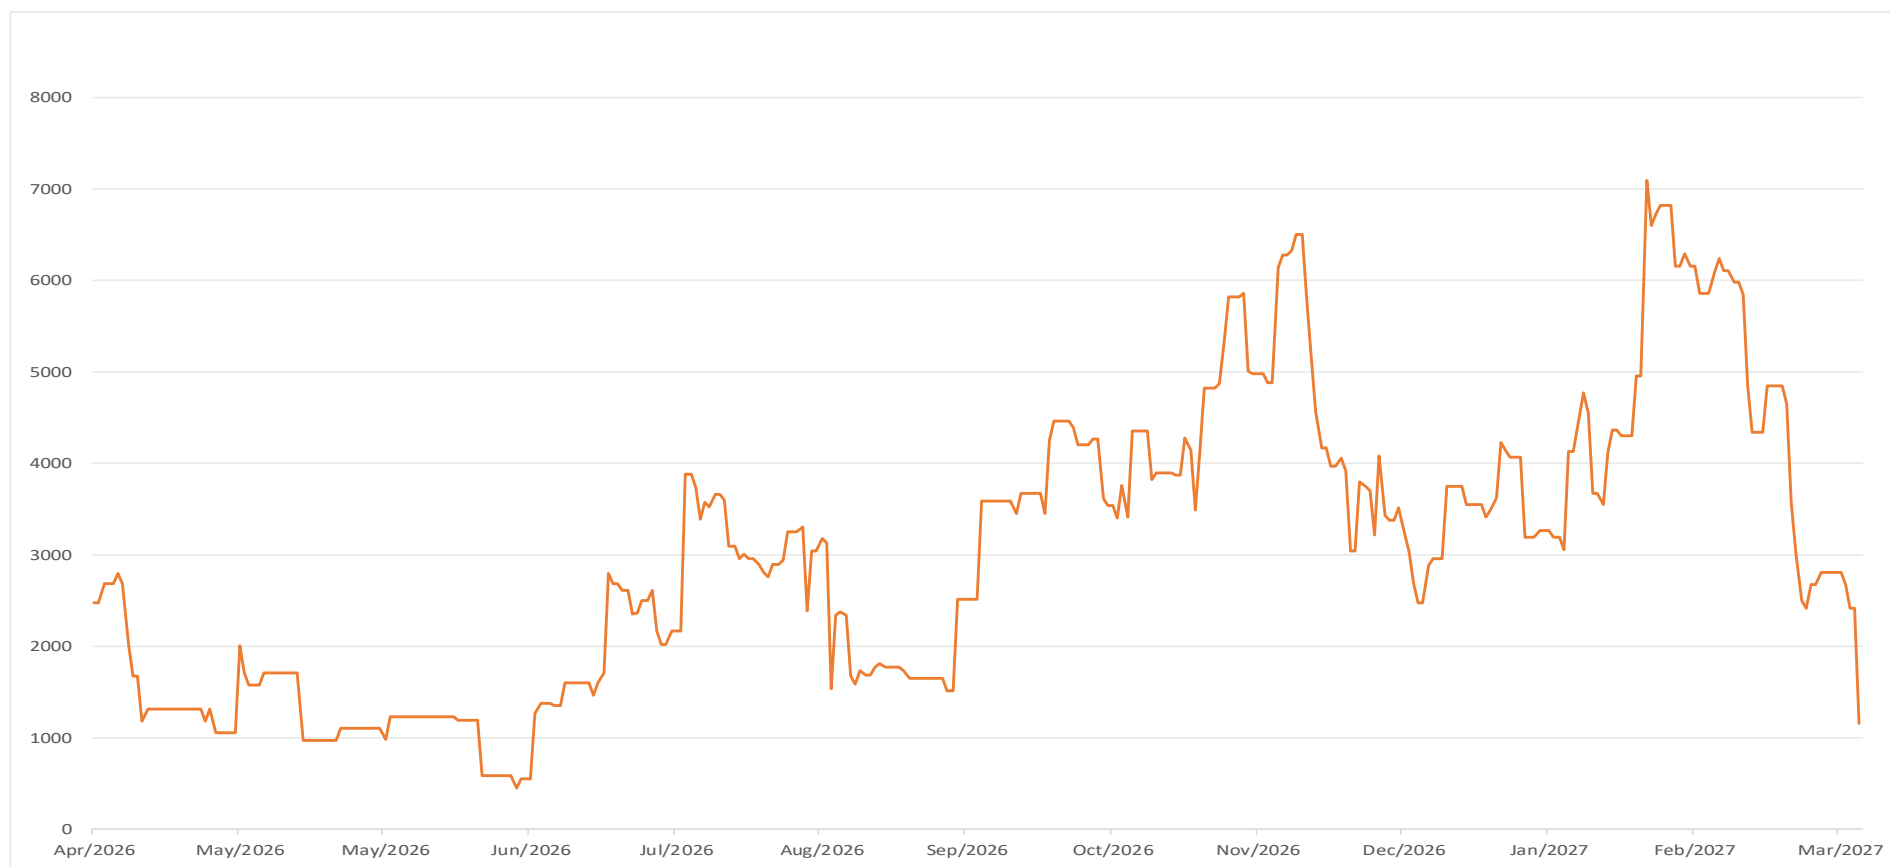


## Planned Thermal Outage Schedule (April 2026)

| Station                          | Unit  | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                            |
|----------------------------------|-------|---------------|-------------|-----------|-----------------|--------------------------------------------------------------------|
| MAHATMA GANDHI TPS (CLP JHAJJAR) | 1     | 660           | 01-Mar-26   | 7-Apr-26  | 38              | Planned Overhaul                                                   |
| RIHAND-II STPS                   | 1     | 500           | 10-Apr-26   | 10-Apr-26 | 30              | Boiler +LPT (LSB replacement with de-tunned) + TG Bearing & Valves |
| AURAIYA CCPP                     | GT-2  | 111.19        | 06-Apr-26   | 06-Apr-26 | 1               | Boiler Licence                                                     |
| DCR TPS YAMUNA NAGAR             | 2     | 300           | 16-Feb-26   | 01-May-26 | 75              | Capital Overhauling                                                |
| RAJIV GANDHI TPS HISAR           | 2     | 600           | 20-Mar-26   | 13-May-26 | 55              | Capital Overhauling                                                |
| JSW ENERGY (BARMER) TPP          | 2     | 135           | 25-Apr-26   | 02-May-26 | 8               | Boiler License renewal                                             |
| JSW ENERGY (BARMER) TPP          | 7     | 135           | 12-Apr-26   | 23-Apr-26 | 12              | Annual Overhaul/ Boiler overhaul                                   |
| JSW ENERGY (BARMER) TPP          | 8     | 135           | 01-Apr-26   | 08-Apr-26 | 8               | Boiler License renewal                                             |
| SSTPS SURATGARH                  | 5     | 250           | 01-Apr-26   | 25-Apr-26 | 25              | Annual Boiler Overhaul                                             |
| GTPS IPGCL                       | GT- 1 | 30            | 01-Apr-26   | 30-Apr-26 | 30              | Major Inspection of GT-1                                           |
| PPS-III BAWANA                   | GT-1  | 216           | 06-Apr-26   | 08-Apr-26 | 3               | Boiler Inspection                                                  |
| PPS-III BAWANA                   | GT-2  | 216           | 03-Apr-26   | 05-Apr-26 | 3               | Boiler Inspection                                                  |




April 2026

2026-27 Thermal Planned Outage Schedule (MW) of NR

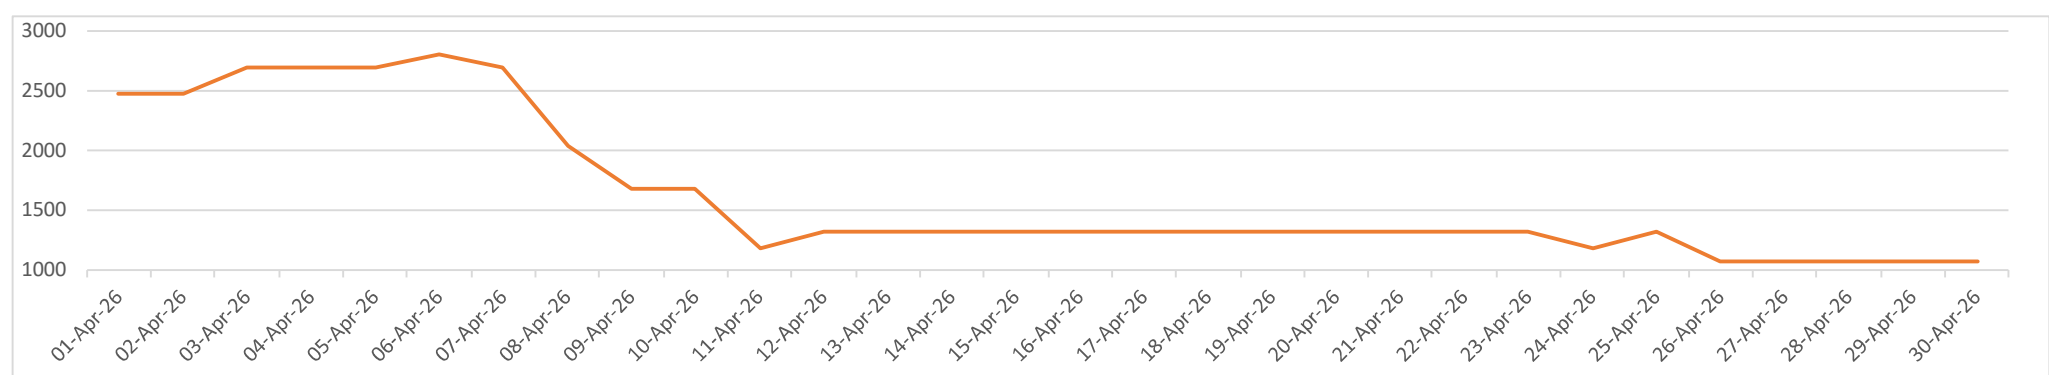

2026-27 Total Planned Outage Schedule (MW) of NR

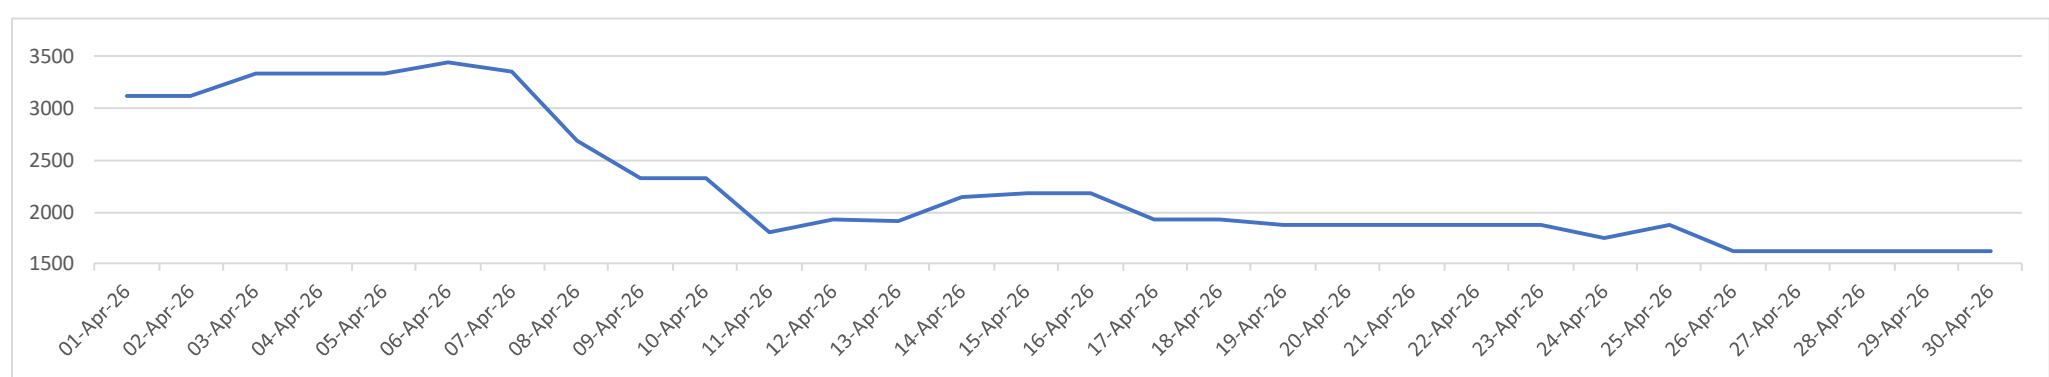


## Planned Thermal Outage Schedule (May 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                         |
|-------------------------|------|---------------|-------------|-----------|-----------------|-------------------------------------------------|
| DCR TPS YAMUNA NAGAR    | 2    | 300           | 16-Feb-26   | 01-May-26 | 75              | Capital Overhauling                             |
| RAJIV GANDHI TPS HISAR  | 2    | 600           | 20-Mar-26   | 13-May-26 | 55              | Capital Overhauling                             |
| JSW ENERGY (BARMER) TPP | 1    | 135           | 06-May-26   | 13-May-26 | 8               | Boiler License renewal                          |
| JSW ENERGY (BARMER) TPP | 2    | 135           | 25-Apr-26   | 02-May-26 | 8               | Boiler License renewal                          |
| JSW ENERGY (BARMER) TPP | 2    | 135           | 22-May-26   | 26-Jun-26 | 36              | Capital Overhaul                                |
| BARSINGSAR LIGNITE      | 2    | 125           | 01-May-26   | 30-May-26 | 30              | Annual Routine Maintenance                      |
| SSTPS SURATGARH         | 1    | 250           | 01-May-26   | 14-Jun-26 | 45              | Annual Boiler Overhaul + C&I system Upgradation |
| KALISINDH TPS (KATPP)   | 1    | 600           | 01-May-26   | 19-Jun-26 | 50              | Replacement of Economiser Boiler Tube Panels    |

May 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

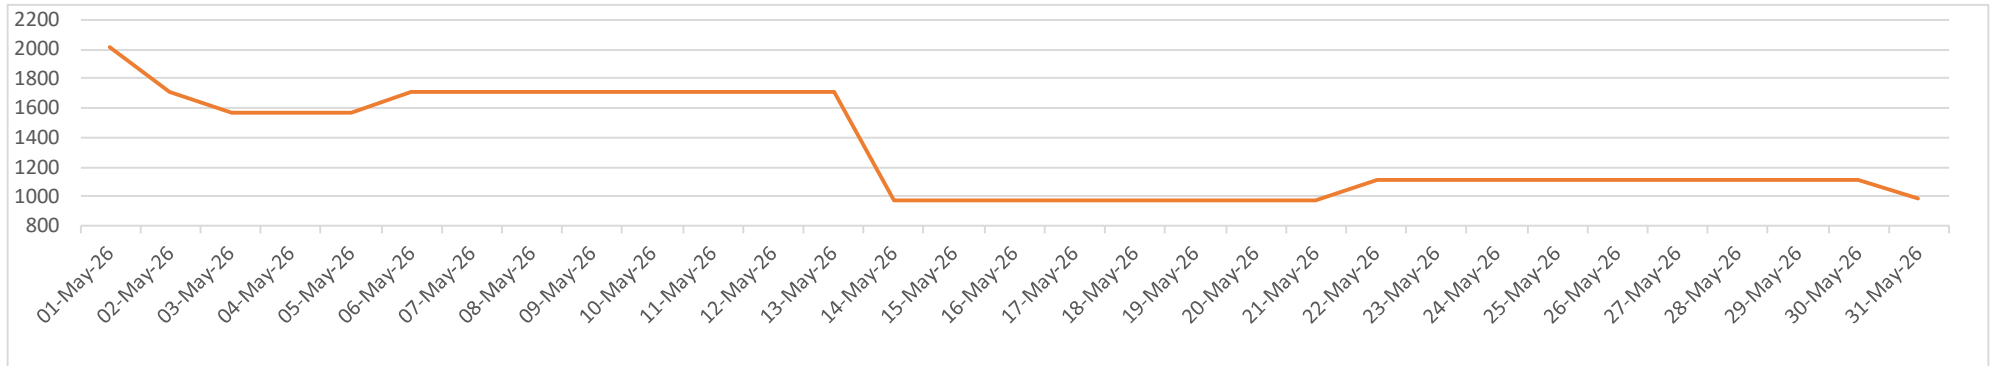

## 2026-27 Planned Outage Schedule (NR)

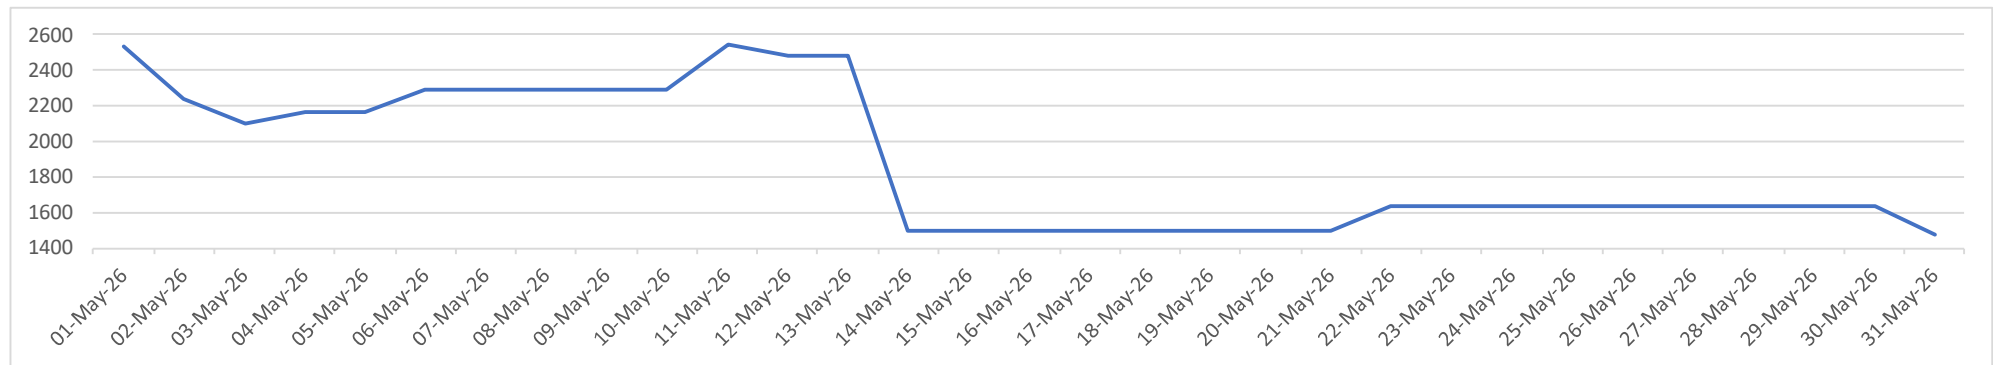


## Planned Thermal Outage Schedule (June 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                          |
|-------------------------|------|---------------|-------------|-----------|-----------------|------------------------------------------------------------------|
| ANTA CCPP               | GT-3 | 88.71         | 28-Jun-26   | 04-Jul-26 | 7               | Turbine minor Inspection (by regular Maintenance - AMC contract) |
| JSW ENERGY (BARMER) TPP | 2    | 135           | 22-May-26   | 26-Jun-26 | 36              | Capital Overhaul                                                 |
| SSTPS SURATGARH         | 1    | 250           | 01-May-26   | 14-Jun-26 | 45              | Annual Boiler Overhaul + C&I system Upgradation                  |
| KOTA TPS (KSTPS)        | 4    | 210           | 15-Jun-26   | 03-Aug-26 | 50              | Capital Overhaul of Turbine (Replacement of LPT Blades)          |
| KALISINDH TPS (KATPP)   | 1    | 600           | 01-May-26   | 19-Jun-26 | 50              | Replacement of Economiser Boiler Tube Panels                     |
| CTPP CHHABRA            | 2    | 250           | 01-Jun-26   | 20-Jul-26 | 50              | Capital Overhaul of Turbine                                      |

June 2026

2026-27 Thermal Planned Outage Schedule (MW) of NR

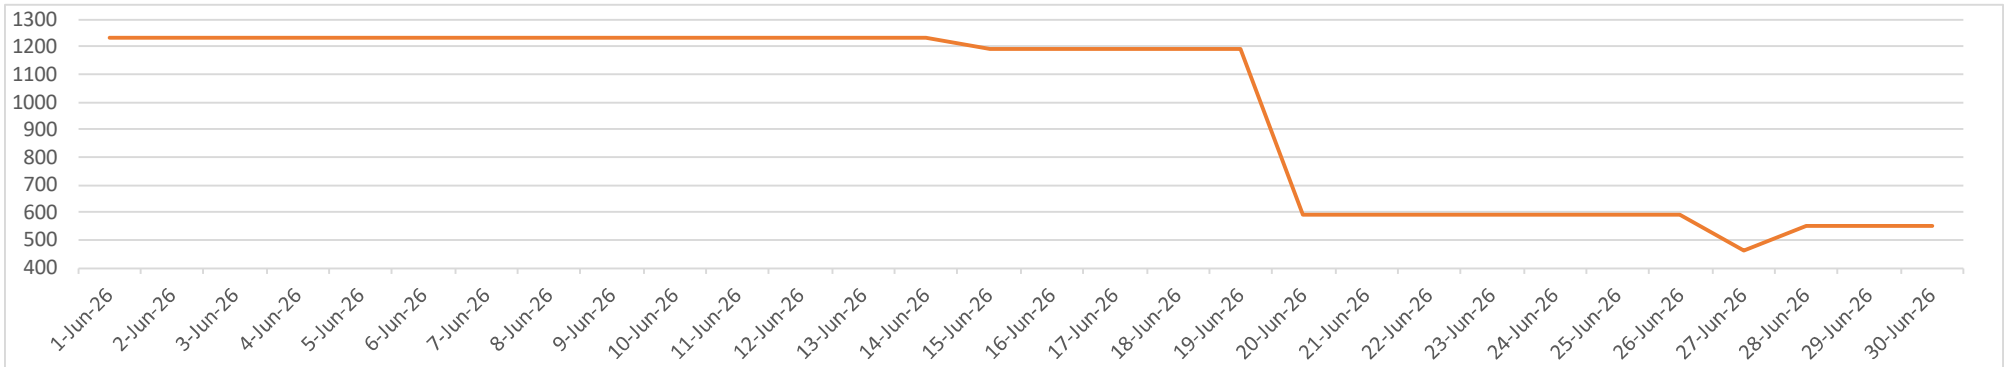

2026-27 Planned Outage Schedule (NR)

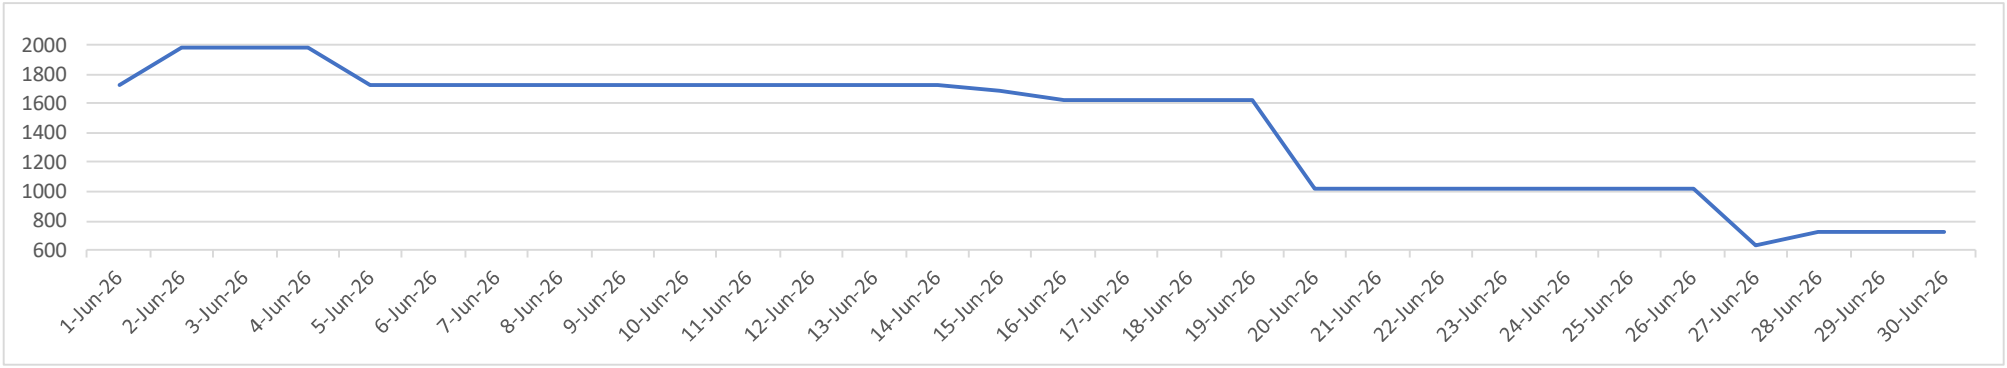

## Planned Thermal Outage Schedule (July 2026)


| Station                          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                    |
|----------------------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------|
| RAPS-B                           | 3    | 220           | 13-Jul-26   | 21-Aug-26 | 40              | Biennial Shutdown                                                          |
| SINGRAULI STPS                   | 1    | 200           | 01-Jul-26   | 15-Aug-26 | 46              | Boiler + Turbine + Gen (Stator trunnion stud replacement) +Turbine RLA     |
| ANTA CCPP                        | GT-3 | 88.71         | 28-Jun-26   | 04-Jul-26 | 7               | Turbine minor Inspection (by regular Maint - AMC contract)                 |
| AURAIYA CCPP                     | GT-1 | 111.19        | 02-Jul-26   | 16-Jul-26 | 15              | Turbine Inspection + Filter Replacement                                    |
| AURAIYA CCPP                     | GT-3 | 111.19        | 25-Jul-26   | 08-Aug-26 | 15              | Combustor Inspection + Filter Replacement + Fourth stage Blade Replacement |
| AURAIYA CCPP                     | GT-3 | 111.19        | 15-Jul-26   | 15-Jul-26 | 1               | Boiler Licence HP                                                          |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-1 | 71.5          | 16-Jul-26   | 18-Jul-26 | 3               | Offline water wash                                                         |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-3 | 71.5          | 01-Jul-26   | 04-Jul-26 | 4               | Offline water wash                                                         |
| FARIDABAD CCGT                   | GT-1 | 137.758       | 22-Jul-26   | 26-Jul-26 | 5               | Minor Inspection + Boiler Lic Renewal                                      |
| FARIDABAD CCGT                   | GT-2 | 137.758       | 29-Jul-26   | 02-Aug-26 | 5               | Minor Inspection + Boiler Lic Renewal                                      |

## Planned Thermal Outage Schedule (July 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                 |
|-------------------------|------|---------------|-------------|-----------|-----------------|---------------------------------------------------------|
| JSW ENERGY (BARMER) TPP | 1    | 135           | 23-Jul-26   | 03-Aug-26 | 12              | Annual Overhaul/ Boiler overhaul                        |
| JSW ENERGY (BARMER) TPP | 5    | 135           | 14-Jul-26   | 21-Jul-26 | 8               | Boiler License renewal                                  |
| JSW ENERGY (BARMER) TPP | 6    | 135           | 05-Jul-26   | 12-Jul-26 | 8               | Boiler License renewal                                  |
| SSTPS SURATGARH         | 2    | 250           | 01-Jul-26   | 25-Jul-26 | 25              | Annual Boiler Overhaul                                  |
| SSCTPP SURATGARH        | 7    | 660           | 16-Jul-26   | 03-Sep-26 | 50              | Capital Overhaul of Turbine                             |
| KOTA TPS (KSTPS)        | 3    | 210           | 16-Jul-26   | 09-Aug-26 | 25              | Annual Overhaul of Turbine (Replacement of LPT Blades)  |
| KOTA TPS (KSTPS)        | 4    | 210           | 15-Jun-26   | 03-Aug-26 | 50              | Capital Overhaul of Turbine (Replacement of LPT Blades) |
| KOTA TPS (KSTPS)        | 7    | 195           | 01-Jul-26   | 25-Jul-26 | 25              | Annual Boiler Overhaul                                  |
| CTPP CHHABRA            | 2    | 250           | 01-Jun-26   | 20-Jul-26 | 50              | Capital Overhaul of Turbine                             |
| CTPP CHHABRA            | 1    | 250           | 16-Jul-26   | 09-Aug-26 | 25              | Annual Boiler Overhaul                                  |
| SSTPS SURATGARH         | 4    | 250           | 07-Jul-26   | 31-Jul-26 | 25              | Annual Boiler Overhaul                                  |

July 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

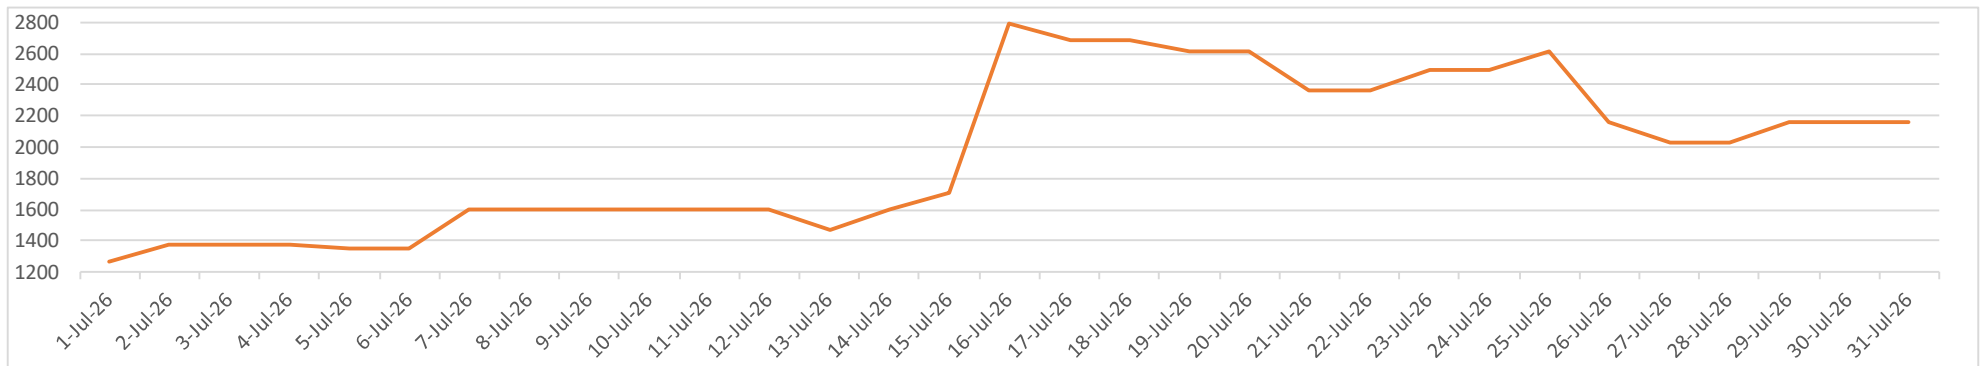

## 2026-27 Planned Outage Schedule (NR)

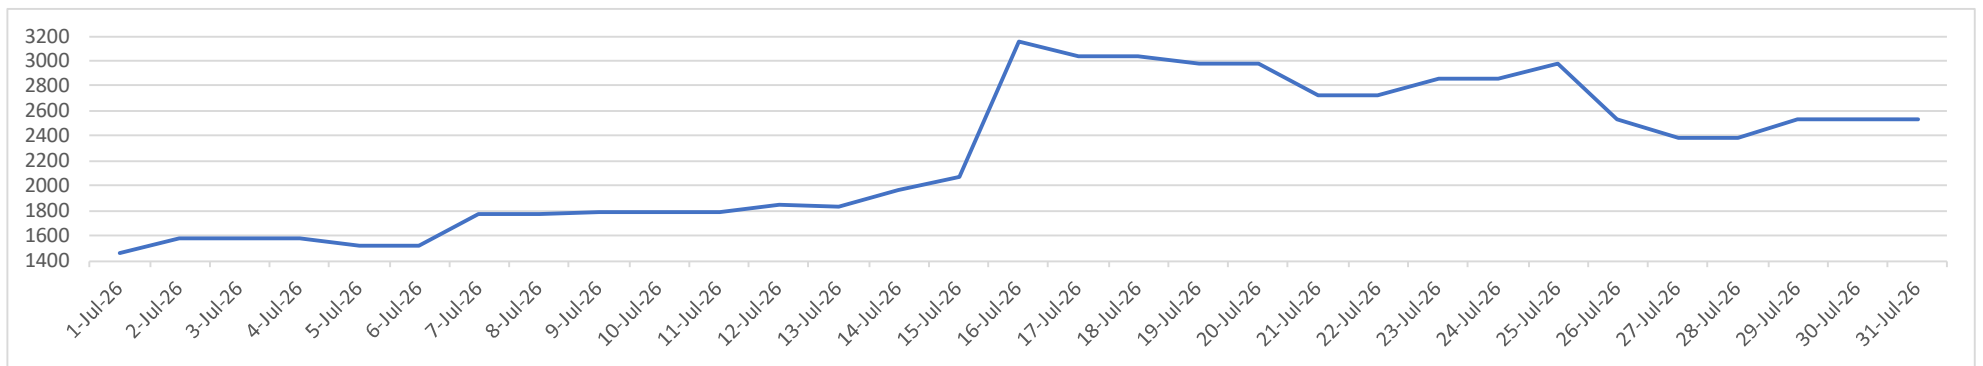



## Planned Thermal Outage Schedule (August 2026)

| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                                                                           |
|-------------------------|------|---------------|-------------|-----------|-----------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| KAWAI TPS (ADANI POWER) | 2    | 660           | 01-Aug-26   | 25-Aug-26 | 25              | AOH HIP, Boiler Licence renewal                                                                                                                                                                                                   |
| RAPS-B                  | 3    | 220           | 13-Jul-26   | 21-Aug-26 | 40              | Biennial Shutdown                                                                                                                                                                                                                 |
| GHATAMPUR TPP           | 1    | 660           | 27-Aug-26   | 30-Aug-26 | 4               | Boiler Licence renewal, furnace inspection and cleaning, RAPH washing, Cen rotor threadout, Gen slip ring inspection, turbine bearing inspection, turbine governor valve stroke checking and other major works to be carried out. |
| KHAMBARKHERA TPS        | 1    | 45            | 01-Aug-26   | 05-Aug-26 | 5               | Refractory Inspection                                                                                                                                                                                                             |
| KHAMBARKHERA TPS        | 2    | 45            | 05-Aug-26   | 09-Aug-26 | 5               | Refractory Inspection                                                                                                                                                                                                             |
| SINGRAULI STPS          | 1    | 200           | 1-Jul-26    | 15-Aug-26 | 46              | Boiler+Gen + Turbine + Turbine RLA                                                                                                                                                                                                |
| ANTA CCPP               | GT-2 | 88.71         | 29-Aug-26   | 04-Sep-26 | 7               | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                                                                        |
| AURAIYA CCPP            | GT-3 | 111.19        | 25-Jul-26   | 08-Aug-26 | 15              | Combustor Inspection + Filter Replacement + Fourth stage Blade Replacement                                                                                                                                                        |
| AURAIYA CCPP            | GT-4 | 111.19        | 22-Aug-26   | 05-Sep-26 | 15              |                                                                                                                                                                                                                                   |
| DADRI CCPP              | GT-3 | 130.19        | 07-Aug-26   | 11-Aug-26 | 5               | M4 Inspection                                                                                                                                                                                                                     |

## Planned Thermal Outage Schedule (August 2026)


| Station                 | Unit         | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                               |
|-------------------------|--------------|---------------|-------------|-----------|-----------------|---------------------------------------|
| BARKHERA TPS            | 1            | 45            | 09-Aug-26   | 13-Aug-26 | 5               | Refractory Inspection                 |
| BARKHERA TPS            | 2            | 45            | 13-Aug-26   | 17-Aug-26 | 5               | Refractory Inspection                 |
| MAQSOODPUR TPS          | 1            | 45            | 17-Aug-26   | 21-Aug-26 | 5               | Refractory Inspection                 |
| MAQSOODPUR TPS          | 2            | 45            | 21-Aug-26   | 25-Aug-26 | 5               | Refractory Inspection                 |
| KUNDARKI TPS            | 1            | 45            | 25-Aug-26   | 29-Aug-26 | 5               | Refractory Inspection                 |
| KUNDARKI TPS            | 2            | 45            | 29-Aug-26   | 02-Sep-26 | 5               | Refractory Inspection                 |
| GAMA CCPP               | Module 1 GT  | 71            | 01-Aug-26   | 30-Aug-26 | 30              | HGPI Inspection                       |
| GAMA CCPP               | Module 1 STG | 72            | 01-Aug-26   | 15-Aug-26 | 15              | Bearing Inspection                    |
| FARIDABAD CCGT          | GT-2         | 137.758       | 29-Jul-26   | 02-Aug-26 | 5               | Minor Inspection + Boiler Lic Renewal |
| JSW ENERGY (BARMER) TPP | 1            | 135           | 23-Jul-26   | 03-Aug-26 | 12              | Annual Overhaul/ Boiler overhaul      |
| JSW ENERGY (BARMER) TPP | 3            | 135           | 19-Aug-26   | 23-Sep-26 | 36              | Capital Overhaul                      |
| JSW ENERGY (BARMER) TPP | 4            | 135           | 05-Aug-26   | 16-Aug-26 | 12              | Annual Overhaul/ Boiler overhaul      |

## Planned Thermal Outage Schedule (August 2026)


| Station          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                 |
|------------------|------|---------------|-------------|-----------|-----------------|---------------------------------------------------------|
| SSTPS SURATGARH  | 6    | 250           | 01-Aug-26   | 25-Aug-26 | 25              | Annual Boiler Overhaul                                  |
| CSCTPP CHHABRA   | 6    | 660           | 01-Aug-26   | 30-Aug-26 | 30              | Annual Boiler Overhaul                                  |
| KOTA TPS (KSTPS) | 1    | 210           | 01-Aug-26   | 25-Aug-26 | 25              | Annual Boiler Overhaul                                  |
| KOTA TPS (KSTPS) | 2    | 210           | 16-Aug-26   | 09-Sep-26 | 25              | Annual Boiler Overhaul                                  |
| KOTA TPS (KSTPS) | 3    | 210           | 16-Jul-26   | 09-Aug-26 | 25              | Annual Overhaul of Turbine (Replacement of LPT Blades)  |
| KOTA TPS (KSTPS) | 4    | 210           | 15-Jun-26   | 03-Aug-26 | 50              | Capital Overhaul of Turbine (Replacement of LPT Blades) |
| CTPP CHHABRA     | 4    | 250           | 22-Aug-26   | 15-Sep-26 | 25              | Annual Boiler Overhaul                                  |
| CTPP CHHABRA     | 1    | 250           | 16-Jul-26   | 09-Aug-26 | 25              | Annual Boiler Overhaul                                  |
| RAMGARH CCPP     | GT-1 | 35.5          | 01-Aug-26   | 14-Sep-26 | 45              | HGPI of Gas Turbine                                     |
| UNCHA HAR-II TPS | 2    | 210           | 01-Aug-26   | 30-Aug-26 | 30              | Boiler+LPT + Gen+TG Brg & valves Inspection             |

Aug 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

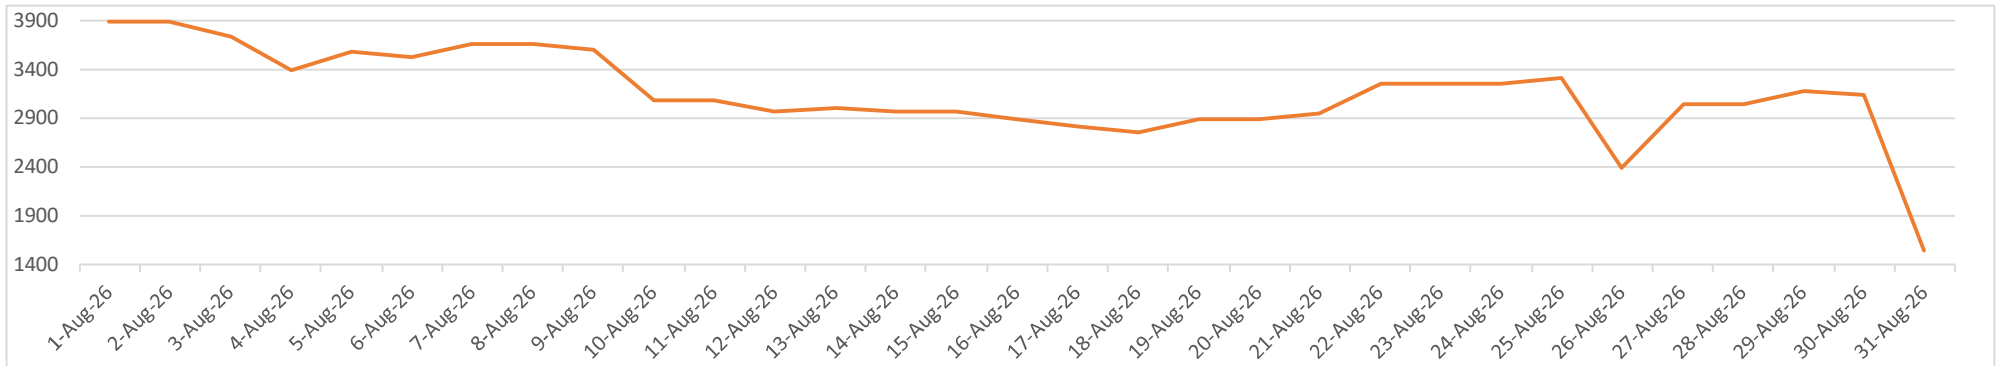

## 2026-27 Planned Outage Schedule (NR)

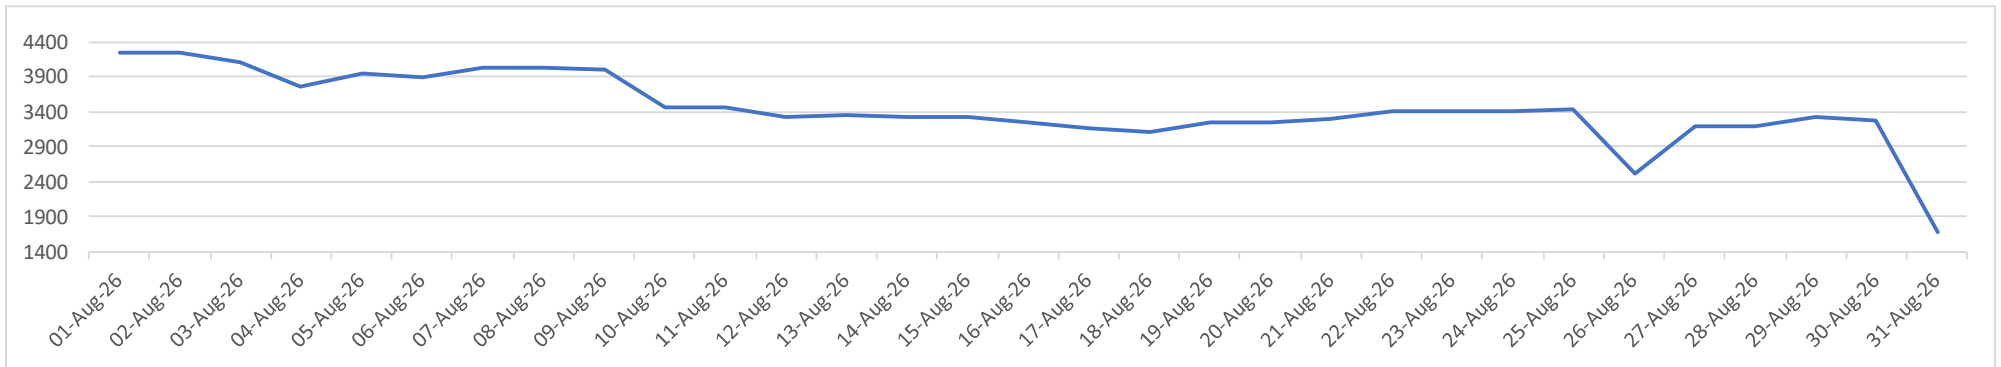

## Planned Thermal Outage Schedule (September 2026)


| Station         | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                    |
|-----------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------|
| SINGRAULI STPS  | 2    | 200           | 1-Sep-26    | 15-Oct-26 | 45              | Boiler+Gen + Turbine + Turbine RLA                                         |
| DADRI-I (NCTPP) | 3    | 210           | 26-Sep-26   | 30-Oct-26 | 35              | Boiler+LPT+Gen + TG valves                                                 |
| ANTA CCPP       | GT-1 | 88.71         | 09-Sep-26   | 15-Sep-26 | 7               | Turbine minor Inspection (by regular Maint - AMC contract)                 |
| ANTA CCPP       | GT-2 | 88.71         | 29-Aug-26   | 04-Sep-26 | 7               | Turbine minor Inspection (by regular Maint - AMC contract)                 |
| AURAIYA CCPP    | GT-4 | 111.19        | 22-Aug-26   | 05-Sep-26 | 15              | Combustor Inspection + Filter Replacement + Fourth stage Blade Replacement |
| RAMGARH CCPP    | GT-1 | 35.5          | 01-Aug-26   | 14-Sep-26 | 45              | HGPI of Gas Turbine                                                        |
| KUNDARKI TPS    | 2    | 45            | 29-Aug-26   | 02-Sep-26 | 5               | Refractory Inspection                                                      |
| UTRAULA TPS     | 1    | 45            | 02-Sep-26   | 06-Sep-26 | 5               | Refractory Inspection                                                      |
| UTRAULA TPS     | 2    | 45            | 06-Sep-26   | 10-Sep-26 | 5               | Refractory Inspection                                                      |
| RAPS-D          | 7    | 700           | 15-Sep-26   | 30-Oct-26 | 46              | Biennial Shutdown                                                          |
| PANIPAT TPS     | 7    | 250           | 16-Sep-26   | 24-Nov-26 | 70              | Capital Overhauling                                                        |

## Planned Thermal Outage Schedule (September 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                          |
|-------------------------|------|---------------|-------------|-----------|-----------------|----------------------------------|
| FARIDABAD CCGT          | ST   | 156.08        | 01-Sep-26   | 15-Oct-26 | 45              | ST DCS R&M                       |
| JSW ENERGY (BARMER) TPP | 3    | 135           | 19-Aug-26   | 23-Sep-26 | 36              | Capital Overhaul                 |
| JSW ENERGY (BARMER) TPP | 5    | 135           | 26-Sep-26   | 07-Oct-26 | 12              | Annual Overhaul/ Boiler overhaul |
| SSTPS SURATGARH         | 6    | 250           | 01-Sep-26   | 25-Sep-26 | 25              | Annual Overhaul                  |
| SSTPS SURATGARH         | 3    | 250           | 10-Sep-26   | 04-Oct-26 | 25              | Annual Boiler Overhaul           |
| SSCTPP SURATGARH        | 7    | 660           | 16-Jul-26   | 03-Sep-26 | 50              | Capital Overhaul of Turbine      |
| KOTA TPS (KSTPS)        | 2    | 210           | 16-Aug-26   | 09-Sep-26 | 25              | Annual Boiler Overhaul           |
| KOTA TPS (KSTPS)        | 5    | 210           | 06-Sep-26   | 30-Sep-26 | 25              | Annual Boiler Overhaul           |
| KOTA TPS (KSTPS)        | 6    | 195           | 01-Sep-26   | 20-Oct-26 | 50              | Strengthen of Boiler tubes       |
| CTPP CHHABRA            | 4    | 250           | 22-Aug-26   | 15-Sep-26 | 25              | Annual Boiler Overhaul           |
| CTPP CHHABRA            | 3    | 250           | 26-Sep-26   | 20-Oct-26 | 26              | Annual Boiler Overhaul           |
| CSCTPP CHHABRA          | 5    | 660           | 26-Sep-26   | 25-Oct-26 | 30              | Annual Boiler Overhaul           |

Sept 2026

2026-27 Thermal Planned Outage Schedule (MW) of NR

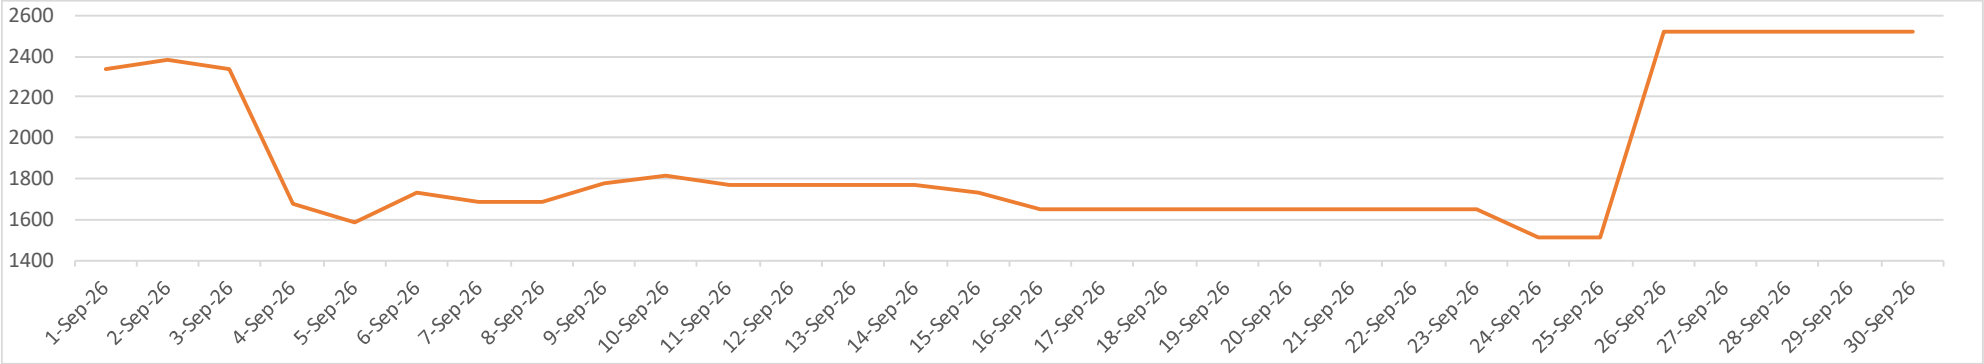

2026-27 Planned Outage Schedule (NR)

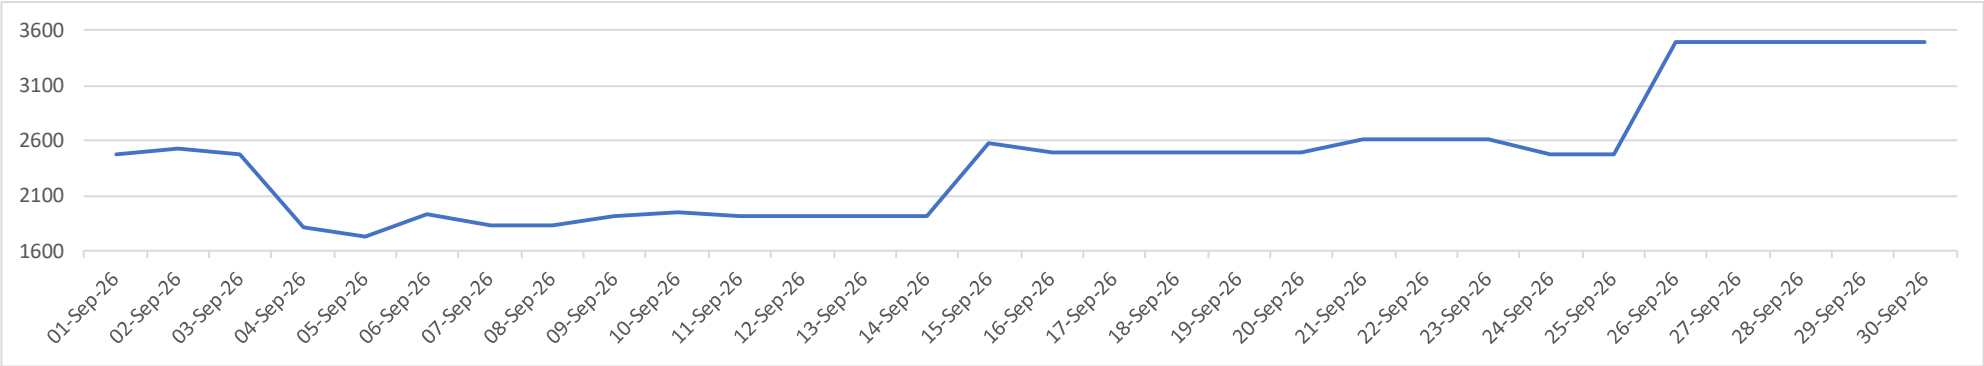

## Planned Thermal Outage Schedule (October 2026)

| Station                          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                |
|----------------------------------|------|---------------|-------------|-----------|-----------------|------------------------------------------------------------------------|
| MEJA STPP                        | 1    | 660           | 01-Oct-26   | 04-Nov-26 | 35              | Overhauling of Boiler, Turbine, Turbine Stop valves and Control Valves |
| SINGRAULI STPS                   | 2    | 200           | 01-Sep-26   | 05-Oct-26 | 45              | Boiler+Gen + Turbine + Turbine RLA                                     |
| SINGRAULI STPS                   | 7    | 500           | 16-Oct-26   | 14-Nov-26 | 30              | Boiler+TG Brg Inspection+LPT (PAUT)+ TG Valves                         |
| RIHAND-I STPS                    | 1    | 500           | 01-Oct-26   | 24-Nov-26 | 55              | Boiler +Turbine (all 4 modules)+Gen                                    |
| UNCHAHAHAR-II TPS                | 2    | 210           | 01-Sep-26   | 05-Oct-26 | 35              | Boiler+LPT + Gen+TG Brg & valves Inspection                            |
| DADRI-I (NCTPP)                  | 3    | 210           | 26-Sep-26   | 30-Oct-26 | 35              | Boiler+LPT+Gen + TG valves                                             |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-1 | 71.5          | 16-Oct-26   | 19-Oct-26 | 4               | Offline water wash, Boiler inspection                                  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | 71.5          | 24-Oct-26   | 26-Oct-26 | 3               | Offline water wash                                                     |
| HARDUAGANJ TPS                   | 8    | 250           | 21-Oct-26   | 19-Nov-26 | 30              | Annual Overhauling                                                     |
| ANPARA C TPS (LANCO)             | 1    | 600           | 30-Oct-26   | 08-Dec-26 | 40              | Annual Overhauling                                                     |
| FARIDABAD CCGT                   | ST   | 156.08        | 01-Sep-26   | 15-Oct-26 | 45              | ST DCS R&M                                                             |




## Planned Thermal Outage Schedule (October 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                  |
|-------------------------|------|---------------|-------------|-----------|-----------------|------------------------------------------------------------------------------------------|
| PANIPAT TPS             | 7    | 250           | 16-Sep-26   | 24-Nov-26 | 70              | Capital Overhauling                                                                      |
| PANIPAT TPS             | 8    | 250           | 05-Oct-26   | 29-Oct-26 | 25              | Annual Overhauling                                                                       |
| JSW ENERGY (BARMER) TPP | 5    | 135           | 26-Sep-26   | 07-Oct-26 | 12              | Annual Overhaul/ Boiler overhaul                                                         |
| JSW ENERGY (BARMER) TPP | 7    | 135           | 15-Oct-26   | 28-Oct-26 | 14              | Refractory maintenance & Boiler Inspection                                               |
| BARSINGSAR LIGNITE      | 1    | 125           | 01-Oct-26   | 30-Oct-26 | 30              | Annual Routine Maintenance                                                               |
| SSTPS SURATGARH         | 3    | 250           | 10-Sep-26   | 04-Oct-26 | 25              | Annual Boiler Overhaul                                                                   |
| SSCTPP SURATGARH        | 8    | 660           | 15-Oct-26   | 13-Nov-26 | 30              | Annual Boiler Overhaul                                                                   |
| CTPP CHHABRA            | 3    | 250           | 26-Sep-26   | 20-Oct-26 | 26              | Annual Boiler Overhaul                                                                   |
| CSCTPP CHHABRA          | 5    | 660           | 26-Sep-26   | 25-Oct-26 | 30              | Annual Boiler Overhaul                                                                   |
| PPS-III BAWANA          | GT-4 | 216           | 09-Oct-26   | 13-Oct-26 | 5               | BI, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment |
| RAPS-D                  | 7    | 700           | 15-Sep-26   | 30-Oct-26 | 46              | Biennial Shutdown                                                                        |

Oct 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

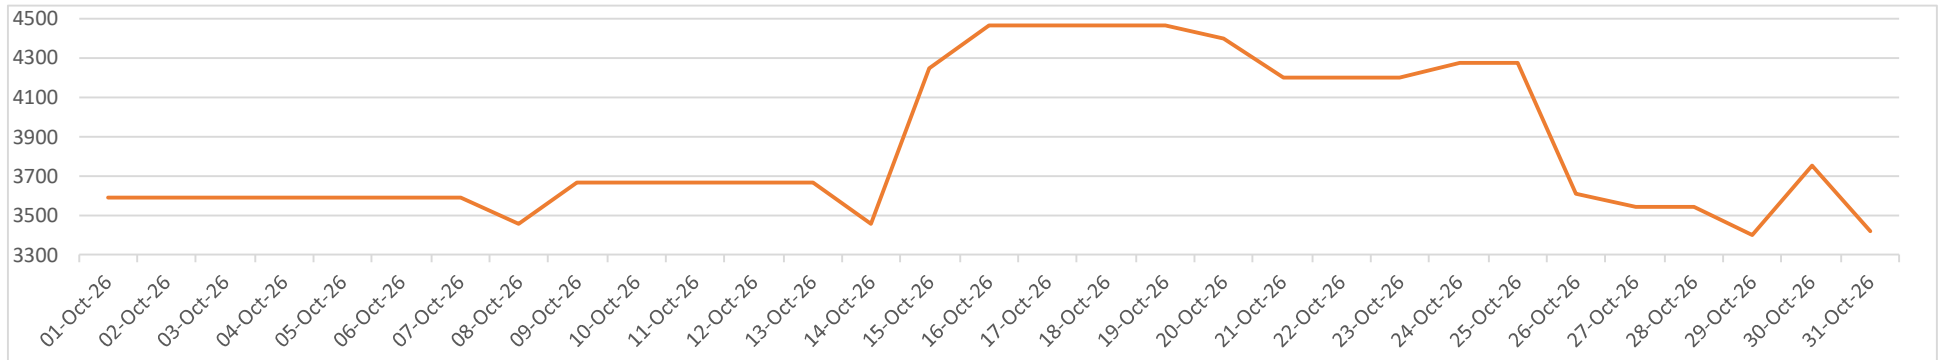

## 2026-27 Planned Outage Schedule (NR)

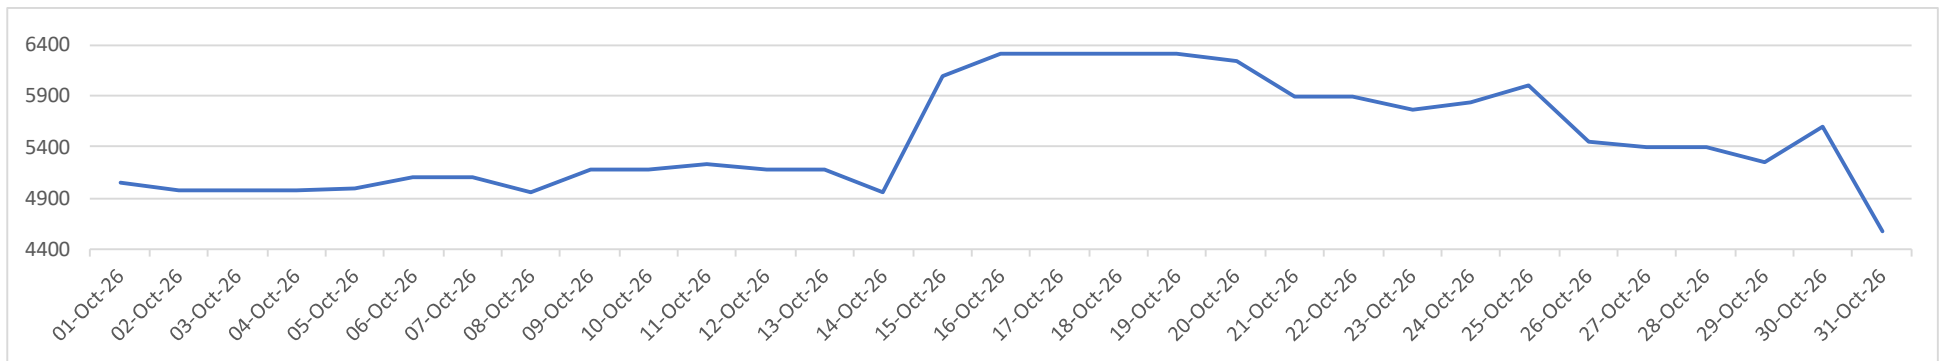

## Planned Thermal Outage Schedule (November 2026)

| Station          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                |
|------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------------------|
| MEJA STPP        | 1    | 660           | 01-Oct-26   | 04-Nov-26 | 35              | Overhauling of Boiler, Turbine, Turbine Stop valves and Control Valves                 |
| KHAMBARKHERA TPS | 1    | 45            | 10-Nov-26   | 29-Nov-26 | 20              | Annual Overhauling                                                                     |
| KHAMBARKHERA TPS | 2    | 45            | 19-Nov-26   | 08-Dec-26 | 20              | Annual Overhauling                                                                     |
| LALITPUR TPS     | 1    | 660           | 15-Nov-26   | 24-Nov-26 | 10              | Boiler License renewal                                                                 |
| ROSA TPP Ph-I    | 4    | 300           | 15-Nov-26   | 14-Dec-26 | 30              | Boiler Capital Overhaul                                                                |
| SINGRAULI STPS   | 7    | 500           | 16-Oct-26   | 14-Nov-26 | 55              | Boiler+TG Brg Inspection+LPT (PAUT)+ TG Valves                                         |
| RIHAND-I STPS    | 1    | 500           | 01-Oct-26   | 24-Nov-26 | 55              | Boiler +Turbine (all 4 modules)+Gen                                                    |
| UNCHAHAHAR-I TPS | 1    | 210           | 25-Nov-26   | 29-Dec-26 | 35              | Boiler+TG Brg & Valves Inspection + LPT + Gen (Bearing pedestal no. 4 & 5 re-grouting) |
| DADRI-II (NCTPP) | 6    | 490           | 21-Nov-26   | 20-Dec-26 | 30              | Boiler + TG BEARINGS & + TG Valves+GCB                                                 |
| BARKHERA TPS     | 1    | 45            | 15-Nov-26   | 04-Dec-26 | 20              | Annual Overhauling                                                                     |
| BARKHERA TPS     | 2    | 45            | 24-Nov-26   | 13-Dec-26 | 20              | Annual Overhauling                                                                     |

## Planned Thermal Outage Schedule (November 2026)


| Station                          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                               |
|----------------------------------|------|---------------|-------------|-----------|-----------------|---------------------------------------|
| MAQSOODPUR TPS                   | 1    | 45            | 20-Nov-26   | 09-Dec-26 | 20              | Annual Overhauling                    |
| MAQSOODPUR TPS                   | 2    | 45            | 29-Nov-26   | 18-Dec-26 | 20              | Annual Overhauling                    |
| KUNDARKI TPS                     | 1    | 45            | 25-Nov-26   | 14-Dec-26 | 20              | Annual Overhauling                    |
| UTRAULA TPS                      | 1    | 45            | 30-Nov-26   | 19-Dec-26 | 20              | Annual Overhauling                    |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-2 | 71.5          | 06-Nov-26   | 09-Nov-26 | 4               | Offline water wash, Boiler inspection |
| BARA TPP (PRAYAGRAJ)             | 2    | 660           | 20-Nov-26   | 22-Dec-26 | 33              | Annual Overhauling                    |
| ANPARA TPS                       | 4    | 210           | 12-Nov-26   | 26-Dec-26 | 45              | Annual Overhauling                    |
| OBRA TPS                         | 10   | 200           | 12-Nov-26   | 11-Dec-26 | 30              | Annual Overhauling                    |
| HARDUAGANJ TPS                   | 8    | 250           | 21-Oct-26   | 19-Nov-26 | 30              | Annual Overhauling                    |
| ANPARA C TPS (LANCO)             | 1    | 600           | 30-Oct-26   | 08-Dec-26 | 40              | Annual Overhauling                    |

## Planned Thermal Outage Schedule (November 2026)


| Station                 | Unit   | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                    |
|-------------------------|--------|---------------|-------------|-----------|-----------------|--------------------------------------------|
| NABHA POWER LTD RAJPURA | 2      | 700           | 16-Nov-26   | 06-Dec-26 | 21              | Annual Overhauling                         |
| TALWANDI SABO TPP       | 1      | 660           | 01-Nov-26   | 15-Dec-26 | 45              | Annual Overhauling                         |
| GGSTP ROPAR             | 3      | 210           | 01-Nov-26   | 15-Dec-26 | 45              | Capital Overhauling                        |
| PANIPAT TPS             | 7      | 250           | 16-Sep-26   | 24-Nov-26 | 70              | Capital Overhauling                        |
| DCR TPS YAMUNA NAGAR    | 1      | 300           | 25-Nov-26   | 28-Dec-26 | 34              | Annual Overhauling                         |
| JSW ENERGY (BARMER) TPP | 3      | 135           | 05-Nov-26   | 12-Nov-26 | 8               | Boiler License renewal                     |
| JSW ENERGY (BARMER) TPP | 6      | 135           | 15-Nov-26   | 28-Nov-26 | 14              | Refractory maintenance & Boiler Inspection |
| SSCTPP SURATGARH        | 8      | 660           | 15-Oct-26   | 13-Nov-26 | 30              | Annual Boiler Overhaul                     |
| GTPS IPGCL              | GT- 2  | 30            | 01-Nov-26   | 25-Nov-26 | 25              | Hot gas path Inspection of GT-2            |
| GTPS IPGCL              | STG- 1 | 30            | 01-Nov-26   | 30-Nov-26 | 30              | Overhauling of STG-1                       |

Nov 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

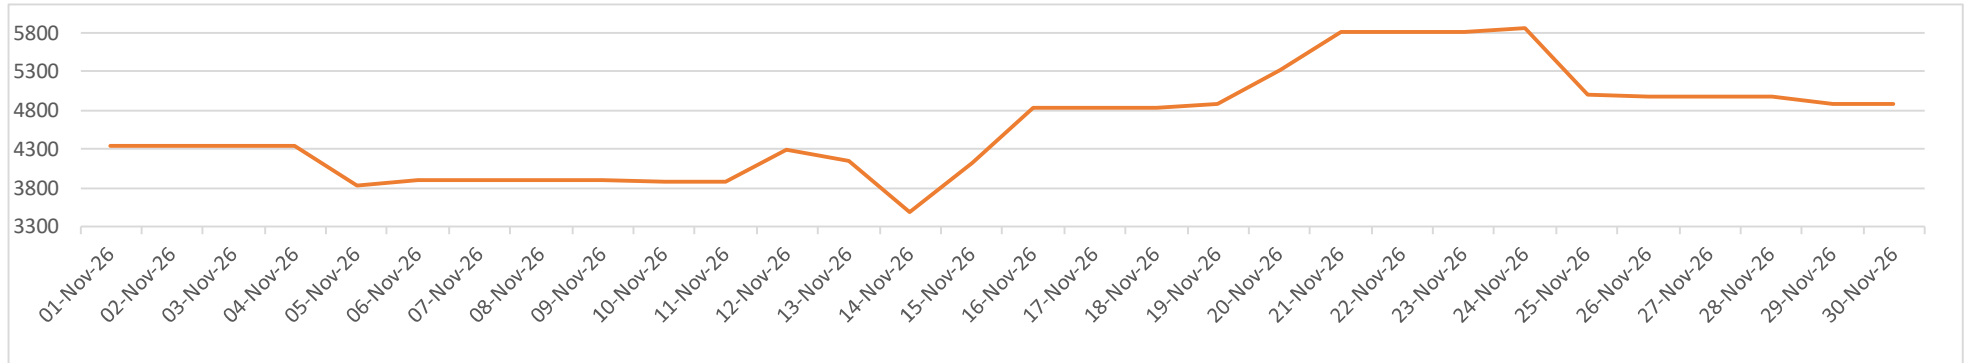

## 2026-27 Planned Outage Schedule (NR)

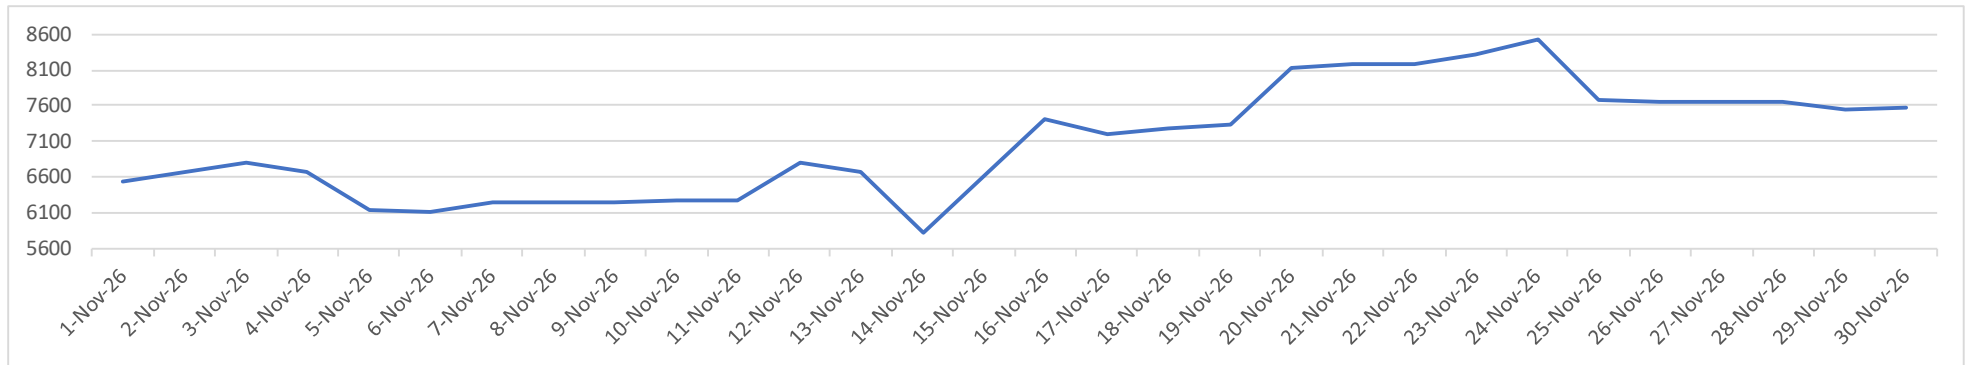

## Planned Thermal Outage Schedule (December 2026)

| Station           | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                                                                          |
|-------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| IGSTPP Jhajjar    | 2    | 500           | 01-Dec-26   | 07-Dec-26 | 7               | BLR                                                                                                                                                                                                                              |
| GHATAMPUR TPP     | 1    | 660           | 22-Dec-26   | 20-Jan-27 | 30              | Boiler Licence renewal,furnace inspection and cleaning, RAPH washing, Cen rotor threadout, Gen slip ring inspection, turbine bearing inspection, turbine governor valve stroke checking and other major works to be carried out. |
| KHAMBARKHERA TPS  | 2    | 45            | 19-Nov-26   | 08-Dec-26 | 20              | Annual Overhauling                                                                                                                                                                                                               |
| ROSA TPP Ph-I     | 4    | 300           | 15-Nov-26   | 14-Dec-26 | 30              | Boiler Capital Overhaul                                                                                                                                                                                                          |
| SINGRAULI STPS    | 4    | 200           | 15-Dec-26   | 08-Jan-27 | 25              | Boiler+TG Brg Inspection+ TG Valves+ Gov system                                                                                                                                                                                  |
| UNCHAHAHAR-I TPS  | 1    | 210           | 25-Nov-26   | 29-Dec-26 | 35              | Boiler+TG Brg & Valves Inspection + LPT + Gen (Bearing pedestal no. 4 & 5 re-grouting)                                                                                                                                           |
| TANDA STAGE-2 TPS | 1    | 660           | 18-Dec-26   | 15-Feb-27 | 60              | Boiler+Turbine                                                                                                                                                                                                                   |
| DADRI-II (NCTPP)  | 6    | 490           | 21-Nov-26   | 20-Dec-26 | 30              | Boiler + TG BEARINGS & + TG Valves+GCB                                                                                                                                                                                           |

## Planned Thermal Outage Schedule (December 2026)

| Station        | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                       |
|----------------|------|---------------|-------------|-----------|-----------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| DADRI CCPP     | GT-1 | 130.19        | 01-Dec-26   | 07-Dec-26 | 7               | M8 Inspection & Boiler License Renewal                                                                                                                                        |
| DADRI CCPP     | GT-3 | 130.19        | 26-Dec-26   | 27-Dec-26 | 2               | Boiler License renewal                                                                                                                                                        |
| ANTA CCPP      | GT-3 | 88.71         | 18-Dec-26   | 16-Jan-27 | 30              | Turbine : Major Inspection (OEM/OES)<br>Generator : Minor Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#3 20 days (Capital Addition Budget) |
| BARKHERA TPS   | 1    | 45            | 15-Nov-26   | 04-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |
| BARKHERA TPS   | 2    | 45            | 24-Nov-26   | 13-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |
| MAQSOODPUR TPS | 1    | 45            | 20-Nov-26   | 09-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |
| MAQSOODPUR TPS | 2    | 45            | 29-Nov-26   | 18-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |
| KUNDARKI TPS   | 1    | 45            | 25-Nov-26   | 14-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |
| KUNDARKI TPS   | 2    | 45            | 04-Dec-26   | 23-Dec-26 | 20              | Annual Overhauling                                                                                                                                                            |



## Planned Thermal Outage Schedule (December 2026)


| Station                    | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                |
|----------------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------|
| UTRAULA TPS                | 1    | 45            | 30-Nov-26   | 19-Dec-26 | 20              | Annual Overhauling                     |
| UTRAULA TPS                | 2    | 45            | 09-Dec-26   | 28-Dec-26 | 20              | Annual Overhauling                     |
| BARA TPP (PRAYAGRAJ)       | 2    | 660           | 20-Nov-26   | 22-Dec-26 | 33              | Annual Overhauling                     |
| ANPARA TPS                 | 4    | 210           | 12-Nov-26   | 26-Dec-26 | 45              | Annual Overhauling                     |
| OBRA TPS                   | 10   | 200           | 12-Nov-26   | 11-Dec-26 | 30              | Annual Overhauling                     |
| HARDUAGANJ EXT-II TPS      | 10   | 660           | 01-Dec-26   | 20-Feb-27 | 82              | 1st Inspection and Capital Overhauling |
| ANPARA C TPS (LANCO)       | 1    | 600           | 30-Oct-26   | 08-Dec-26 | 40              | Annual Overhauling                     |
| NABHA POWER LTD<br>RAJPURA | 2    | 700           | 16-Nov-26   | 06-Dec-26 | 21              | Annual Overhauling                     |
| TALWANDI SABO TPP          | 1    | 660           | 01-Nov-26   | 15-Dec-26 | 45              | Annual Overhauling                     |
| DADRI-I (NCTPP)            | 3    | 210           | 26-Sep-26   | 30-Oct-26 | 35              | Boiler+LPT+Gen + TG valves             |
| DADRI-I (NCTPP)            | 4    | 210           | 01-Feb-27   | 07-Mar-26 | 35              | Boiler+LPT+Gen + TG valves             |

## Planned Thermal Outage Schedule (December 2026)


| Station                 | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                  |
|-------------------------|------|---------------|-------------|-----------|-----------------|------------------------------------------------------------------------------------------|
| GGSTP ROPAR             | 3    | 210           | 01-Nov-26   | 15-Dec-26 | 45              | Capital Overhauling                                                                      |
| GGSTP ROPAR             | 4    | 210           | 22-Dec-26   | 20-Jan-27 | 30              | Capital Overhauling                                                                      |
| DCR TPS YAMUNA NAGAR    | 1    | 300           | 25-Nov-26   | 28-Dec-26 | 34              | Annual Overhauling                                                                       |
| JSW ENERGY (BARMER) TPP | 4    | 135           | 02-Dec-26   | 09-Dec-26 | 8               | Boiler License renewal                                                                   |
| JSW ENERGY (BARMER) TPP | 8    | 135           | 14-Dec-26   | 27-Dec-26 | 14              | Refractory maintenance & Boiler Inspection                                               |
| PPS-III BAWANA          | GT-3 | 216           | 05-Dec-26   | 09-Dec-26 | 5               | BI, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment |

Dec 2026

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

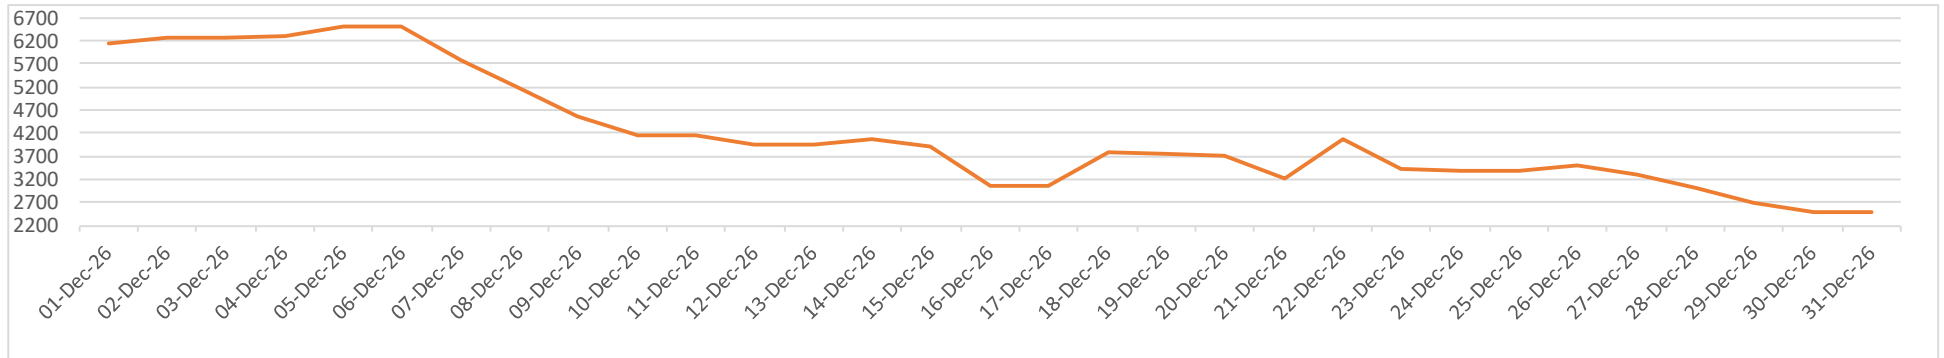

## 2026-27 Planned Outage Schedule (NR)

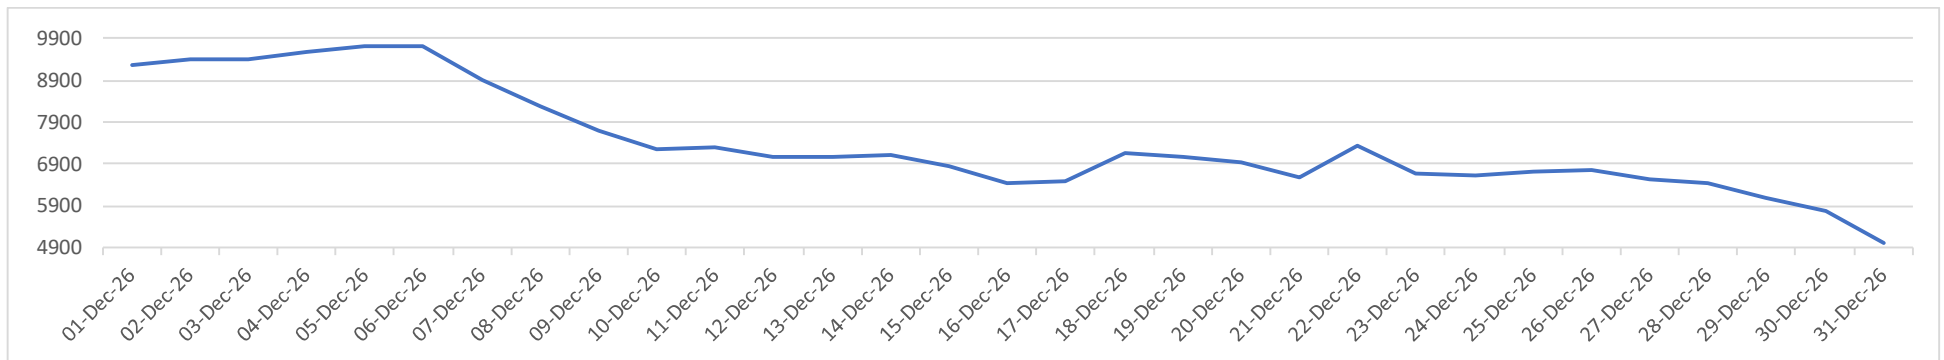

## Planned Thermal Outage Schedule (January 2027)


| Station           | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                                                                           |
|-------------------|------|---------------|-------------|-----------|-----------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| RAPS-B            | 4    | 220           | 11-Jan-27   | 19-Feb-27 | 40              | Biennial Shutdown                                                                                                                                                                                                                 |
| GHATAMPUR TPP     | 1    | 660           | 22-Dec-26   | 20-Jan-27 | 30              | Boiler Licence renewal, furnace inspection and cleaning, RAPH washing, Cen rotor threadout, Gen slip ring inspection, turbine bearing inspection, turbine governor valve stroke checking and other major works to be carried out. |
| KHURJA TPP        | 1    | 660           | 30-Jan-27   | 28-Feb-27 | 30              | Annual maintenance                                                                                                                                                                                                                |
| LALITPUR TPS      | 3    | 660           | 05-Jan-27   | 03-Feb-27 | 30              | Annual Overhauling                                                                                                                                                                                                                |
| SINGRAULI STPS    | 4    | 200           | 15-Dec-26   | 08-Jan-27 | 25              | Boiler+TG Brg Inspection+ TG Valves+ Gov system                                                                                                                                                                                   |
| TANDA STAGE-2 TPS | 1    | 660           | 18-Dec-26   | 15-Feb-27 | 60              | Boiler+Turbine                                                                                                                                                                                                                    |
| ANTA CCPP         | GT-3 | 88.71         | 18-Dec-26   | 16-Jan-27 | 30              | Turbine : Major Inspection (OEM/OES)<br>Generator : Minor Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#3<br>20 days (Capital Addition Budget)                                                  |

## Planned Thermal Outage Schedule (January 2027)


| Station                          | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                    |
|----------------------------------|------|---------------|-------------|-----------|-----------------|--------------------------------------------|
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-1 | 71.5          | 14-Jan-27   | 17-Jan-27 | 4               | Offline water wash                         |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-3 | 71.5          | 02-Jan-27   | 04-Jan-27 | 3               | Offline water wash                         |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | 71.5          | 24-Jan-27   | 26-Jan-27 | 3               | Offline water wash                         |
| ANPARA TPS                       | 2    | 210           | 05-Jan-27   | 03-Feb-27 | 30              | Annual Overhauling                         |
| OBRA TPS                         | 11   | 200           | 30-Jan-27   | 15-Mar-27 | 45              | Capital Overhauling                        |
| HARDUAGANJ EXT-II TPS            | 10   | 660           | 01-Dec-26   | 20-Feb-27 | 82              | 1st Inspection and Capital Overhauling     |
| PARICHHA TPS                     | 4    | 210           | 30-Jan-27   | 28-Feb-27 | 30              | Annual Overhauling                         |
| GGSTP ROPAR                      | 4    | 210           | 22-Dec-26   | 20-Jan-27 | 30              | Capital Overhauling                        |
| GURU AMARDASS TPP                | 1    | 270           | 01-Jan-27   | 31-Jan-27 | 31              | Annual Overhaul                            |
| RAJIV GANDHI TPS HISAR           | 1    | 600           | 16-Jan-27   | 31-Mar-27 | 75              | Capital Overhauling                        |
| JSW ENERGY (BARMER) TPP          | 5    | 135           | 15-Jan-27   | 28-Jan-27 | 14              | Refractory maintenance & Boiler Inspection |
| JSW ENERGY (BARMER) TPP          | 6    | 135           | 01-Jan-27   | 12-Jan-27 | 12              | Annual Overhaul/ Boiler overhaul           |

Jan 2027

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

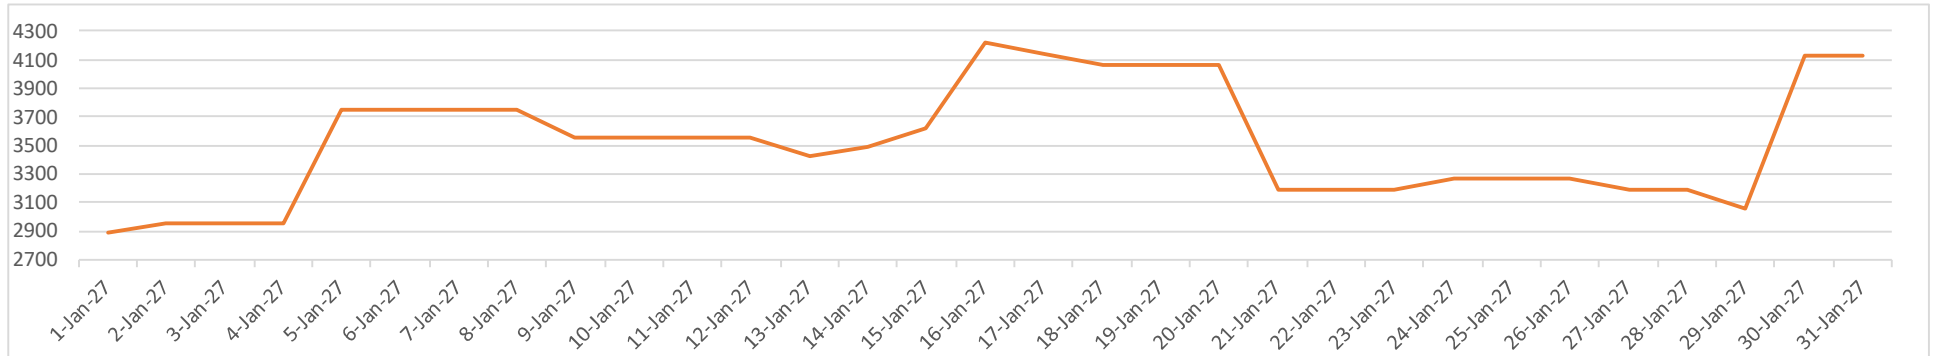

## 2026-27 Planned Outage Schedule (NR)

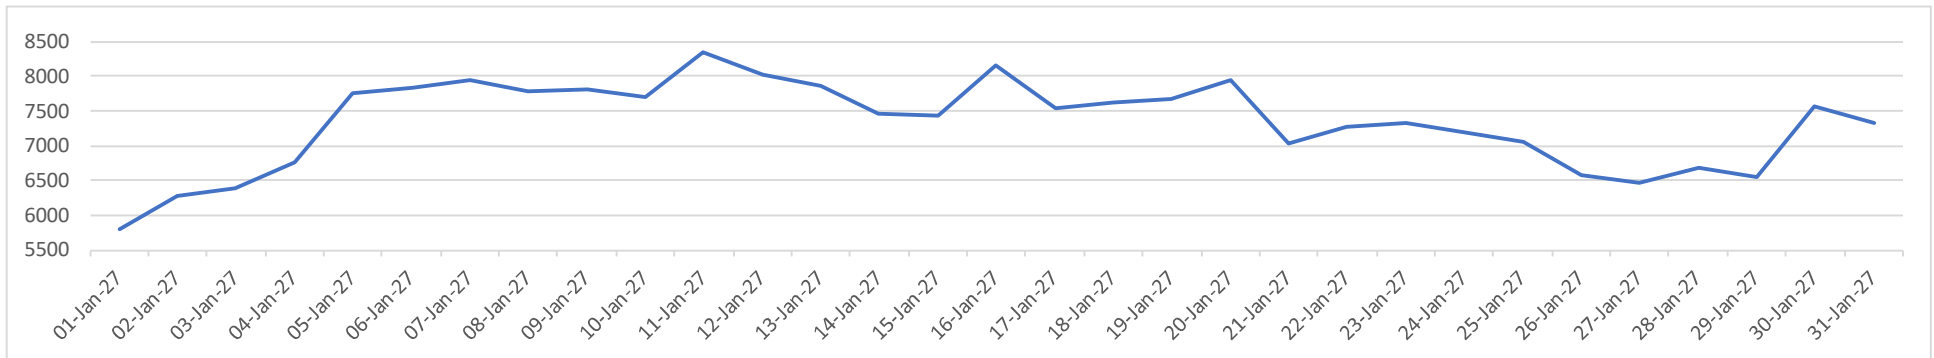

## Planned Thermal Outage Schedule (February 2027)

| Station           | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                          |
|-------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| IGSTPP Jhajjar    | 1    | 500           | 15-Feb-27   | 17-Mar-27 | 31              | Overhauling                                                                                                                                                                      |
| RAPS-B            | 4    | 220           | 11-Jan-27   | 19-Feb-27 | 40              | Biennial Shutdown                                                                                                                                                                |
| RAPS-C            | 5    | 220           | 16-Feb-27   | 31-Mar-27 | 44              | Biennial Shutdown                                                                                                                                                                |
| KHURJA TPP        | 1    | 660           | 30-Jan-27   | 28-Feb-27 | 30              | Annual maintenance                                                                                                                                                               |
| LALITPUR TPS      | 2    | 660           | 15-Feb-27   | 16-Mar-27 | 30              | Annual Overhauling                                                                                                                                                               |
| LALITPUR TPS      | 3    | 660           | 05-Jan-27   | 03-Feb-27 | 30              | Annual Overhauling                                                                                                                                                               |
| ROSA TPP Ph-I     | 2    | 300           | 16-Feb-27   | 25-Feb-27 | 10              | Boiler Mini Overhaul                                                                                                                                                             |
| RIHAND-III STPS   | 2    | 500           | 07-Feb-27   | 08-Mar-27 | 30              | Boiler + Boiler RLA + LPT (Rotor replacement)                                                                                                                                    |
| TANDA STAGE-2 TPS | 1    | 660           | 18-Dec-26   | 15-Feb-27 | 60              | Boiler+Turbine                                                                                                                                                                   |
| ANTA CCPP         | GT-2 | 88.71         | 18-Feb-27   | 19-Mar-27 | 30              | Turbine : Major Inspection (OEM/OES)<br>Generator : Major Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#2<br>20 days (Capital Addition Budget) |

## Planned Thermal Outage Schedule (February 2027)

| Station                             | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                |
|-------------------------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------|
| AURAIYA CCPP                        | GT-1 | 111.19        | 02-Feb-27   | 02-Feb-27 | 1               | Boiler Licence LP                      |
| AURAIYA CCPP                        | GT-4 | 111.19        | 02-Feb-27   | 02-Feb-27 | 1               | Boiler Licence                         |
| DADRI-I (NCTPP)                     | 4    | 210           | 01-Feb-27   | 07-Mar-27 | 35              | Boiler+LPT + Gen+ TG Valves            |
| DADRI CCPP                          | GT-2 | 130.19        | 17-Feb-27   | 23-Feb-27 | 7               | M8 Inspection & Boiler License Renewal |
| DADRI CCPP                          | GT-4 | 130.19        | 01-Feb-27   | 05-Feb-27 | 5               | M4 Inspection & Boiler License Renewal |
| KASHIPUR CCPP<br>(SRAVANTHI ENERGY) | GT-2 | 71.5          | 07-Feb-27   | 09-Feb-27 | 3               | Offline water wash                     |
| ANPARA TPS                          | 2    | 210           | 05-Jan-27   | 03-Feb-27 | 30              | Annual Overhauling                     |
| OBRA TPS                            | 11   | 200           | 30-Jan-27   | 15-Mar-27 | 45              | Capital Overhauling                    |
| HARDUAGANJ EXT-II TPS               | 10   | 660           | 01-Dec-26   | 20-Feb-27 | 82              | 1st Inspection and Capital Overhauling |
| PARICHHA TPS                        | 4    | 210           | 30-Jan-27   | 28-Feb-27 | 30              | Annual Overhauling                     |
| NABHA POWER LTD<br>RAJPURA          | 1    | 700           | 15-Feb-27   | 07-Mar-27 | 21              | Annual Overhauling                     |
| TALWANDI SABO TPP                   | 2    | 660           | 13-Feb-27   | 30-Mar-27 | 46              | Annual Overhauling                     |




## Planned Thermal Outage Schedule (February 2027)


| Station                 | Unit  | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                                   |
|-------------------------|-------|---------------|-------------|-----------|-----------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| GGSSTP ROPAR            | 6     | 210           | 01-Feb-27   | 17-Mar-27 | 45              | Capital Overhauling                                                                                                                                                                       |
| GURU AMARDASS TPP       | 2     | 270           | 15-Feb-27   | 16-Mar-27 | 30              | Annual Overhaul                                                                                                                                                                           |
| RAJIV GANDHI TPS HISAR  | 1     | 600           | 16-Jan-27   | 31-Mar-27 | 75              | Capital Overhauling                                                                                                                                                                       |
| JSW ENERGY (BARMER) TPP | 4     | 135           | 02-Feb-27   | 15-Feb-27 | 14              | Refractory maintenance & Boiler Inspection                                                                                                                                                |
| JSW ENERGY (BARMER) TPP | 7     | 135           | 23-Feb-27   | 02-Mar-27 | 8               | Boiler License renewal                                                                                                                                                                    |
| PPS-III BAWANA          | STG-1 | 253.6         | 08-Feb-27   | 04-Mar-27 | 25              | Replacement of Diffuser assembly of IPCV#2, critical valves servicing of HRSGs, Condenser cleaning, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment. |
| PPS-III BAWANA          | GT-1  | 216           | 02-Feb-27   | 06-Feb-27 | 5               | Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                      |
| PPS-III BAWANA          | GT-2  | 216           | 08-Feb-27   | 19-Mar-27 | 40              | Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                      |

Feb 2027

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

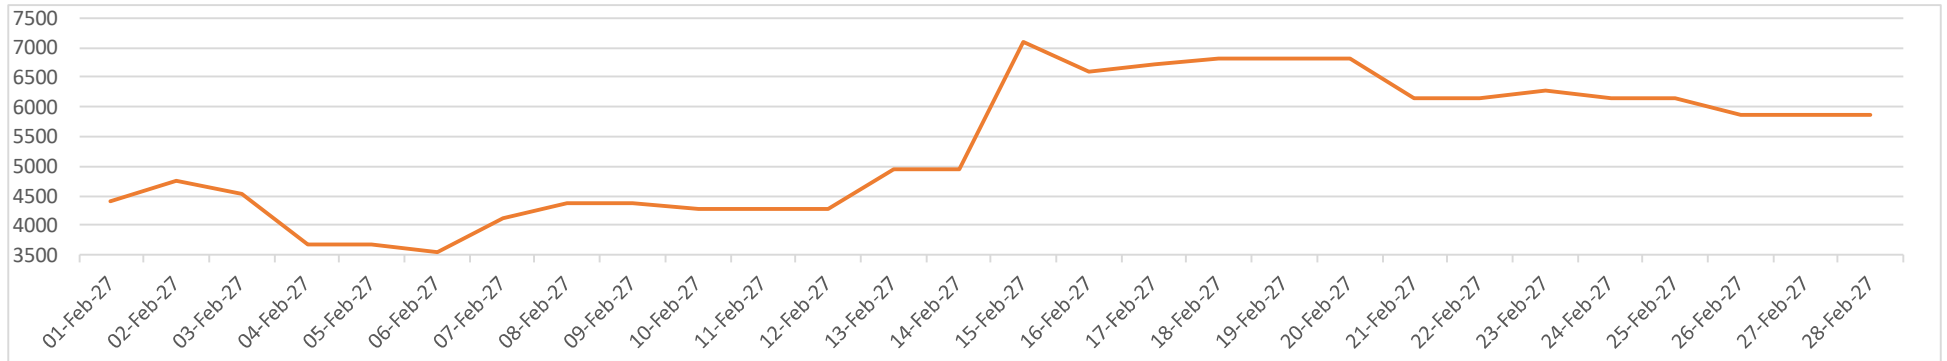

## 2026-27 Planned Outage Schedule (NR)

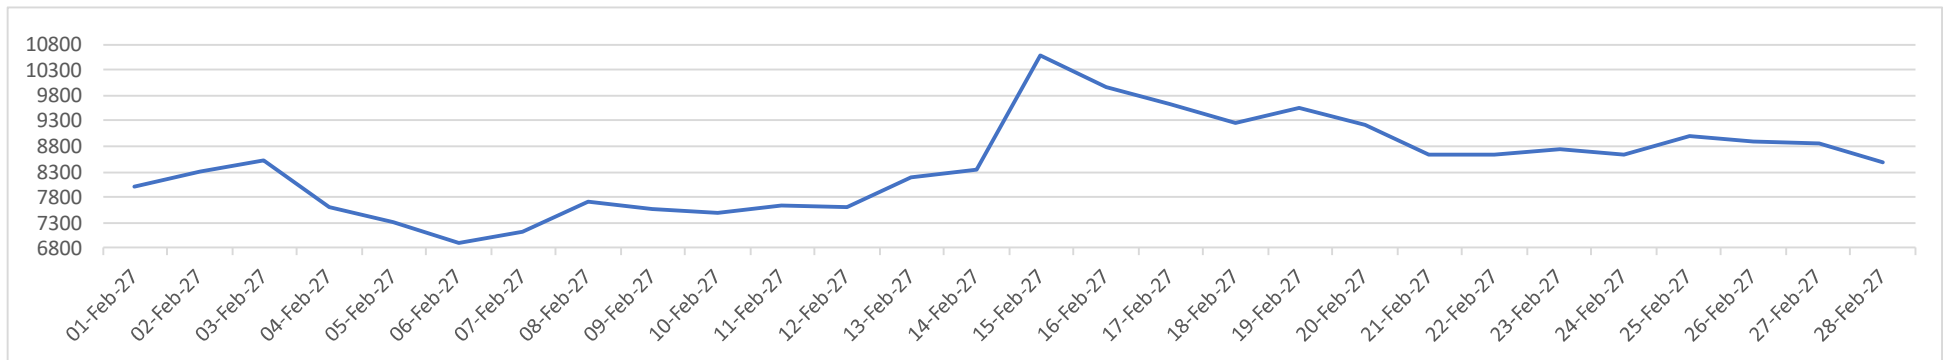

## Planned Thermal Outage Schedule (March 2027)

| Station            | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                          |
|--------------------|------|---------------|-------------|-----------|-----------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| IGSTPP Jhajjar     | 1    | 500           | 15-Feb-27   | 17-Mar-27 | 31              | Overhauling                                                                                                                                                                      |
| IGSTPP Jhajjar     | 3    | 500           | 12-Mar-27   | 18-Mar-27 | 7               | BLR                                                                                                                                                                              |
| RAPS-C             | 5    | 220           | 16-Feb-27   | 31-Mar-27 | 44              | Biennial Shutdown                                                                                                                                                                |
| LALITPUR TPS       | 2    | 660           | 15-Feb-27   | 16-Mar-27 | 30              | Annual Overhauling                                                                                                                                                               |
| RIHAND-III STPS    | 2    | 500           | 07-Feb-27   | 08-Mar-27 | 30              | Boiler + Boiler RLA + LPT (Rotor replacement)                                                                                                                                    |
| UNCHAHAHAR-III TPS | 1    | 210           | 1-Mar-27    | 10-Apr-27 | 41              | Boiler+Turbine +Turbine RLA                                                                                                                                                      |
| DADRI-I (NCTPP)    | 4    | 210           | 01-Feb-27   | 07-Mar-27 | 35              | Boiler+LPT + Gen+ TG Valves                                                                                                                                                      |
| ANTA CCPP          | GT-1 | 88.71         | 01-Mar-27   | 07-Mar-27 | 7               | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                       |
| ANTA CCPP          | GT-2 | 88.71         | 18-Feb-27   | 19-Mar-27 | 30              | Turbine : Major Inspection (OEM/OES)<br>Generator : Major Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#2<br>20 days (Capital Addition Budget) |

## Planned Thermal Outage Schedule (March 2027)


| Station                    | Unit | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                    |
|----------------------------|------|---------------|-------------|-----------|-----------------|--------------------------------------------|
| OBRA TPS                   | 11   | 200           | 30-Jan-27   | 15-Mar-27 | 45              | Capital Overhauling                        |
| NABHA POWER LTD<br>RAJPURA | 1    | 700           | 15-Feb-27   | 07-Mar-27 | 21              | Annual Overhauling                         |
| TALWANDI SABO TPP          | 2    | 660           | 13-Feb-27   | 30-Mar-27 | 46              | Annual Overhauling                         |
| GHTPS (LEHRA MOHBBAT)      | 1    | 210           | 01-Mar-27   | 14-Apr-27 | 45              | Annual Overhauling                         |
| GGSSTP ROPAR               | 6    | 210           | 01-Feb-27   | 17-Mar-27 | 45              | Capital Overhauling                        |
| GURU AMARDASS TPP          | 2    | 270           | 15-Feb-27   | 16-Mar-27 | 30              | Annual Overhaul                            |
| FARIDABAD CCGT             | GT-1 | 137.758       | 02-Mar-27   | 06-Mar-27 | 5               | Minor Inspection                           |
| FARIDABAD CCGT             | GT-2 | 137.758       | 23-Mar-27   | 27-Mar-27 | 5               | Minor Inspection                           |
| RAJIV GANDHI TPS HISAR     | 1    | 600           | 16-Jan-27   | 31-Mar-27 | 75              | Capital Overhauling                        |
| JSW ENERGY (BARMER) TPP    | 1    | 135           | 18-Mar-27   | 31-Mar-27 | 14              | Refractory maintenance & Boiler Inspection |
| JSW ENERGY (BARMER) TPP    | 7    | 135           | 23-Feb-27   | 02-Mar-27 | 8               | Boiler License renewal                     |
| JSW ENERGY (BARMER) TPP    | 8    | 135           | 05-Mar-27   | 16-Mar-27 | 12              | Annual Overhaul/ Boiler overhaul           |

## Planned Thermal Outage Schedule (March 2027)


| Station               | Unit  | Capacity (MW) | Outage from | Outage To | Duration (days) | Remarks                                                                                                                                                                                   |
|-----------------------|-------|---------------|-------------|-----------|-----------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| KALISINDH TPS (KATPP) | 1     | 600           | 01-Mar-27   | 30-Mar-27 | 30              | Annual Boiler Overhaul                                                                                                                                                                    |
| PPS-III BAWANA        | STG-1 | 253.6         | 08-Feb-27   | 04-Mar-27 | 25              | Replacement of Diffuser assembly of IPCV#2, critical valves servicing of HRSGs, Condenser cleaning, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment. |
| PPS-III BAWANA        | STG-2 | 253.6         | 21-Mar-27   | 28-Mar-27 | 8               | Condenser Cleaning , Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                 |
| PPS-III BAWANA        | GT-2  | 216           | 08-Feb-27   | 19-Mar-27 | 40              | Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                      |

Mar 2027

## 2026-27 Thermal Planned Outage Schedule (MW) of NR

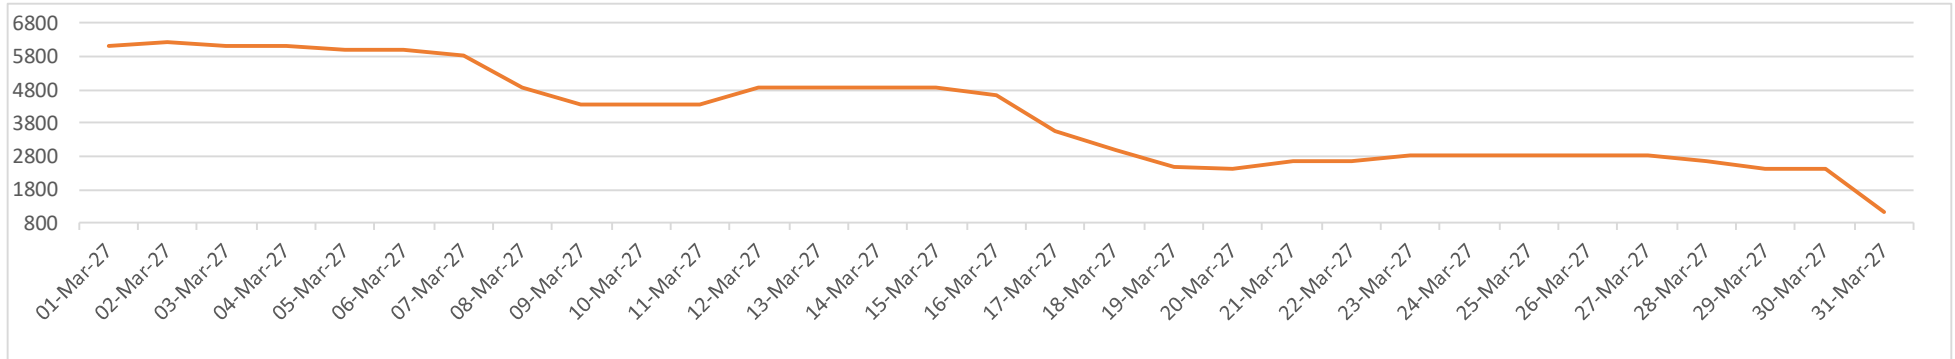

## 2026-27 Planned Outage Schedule (NR)

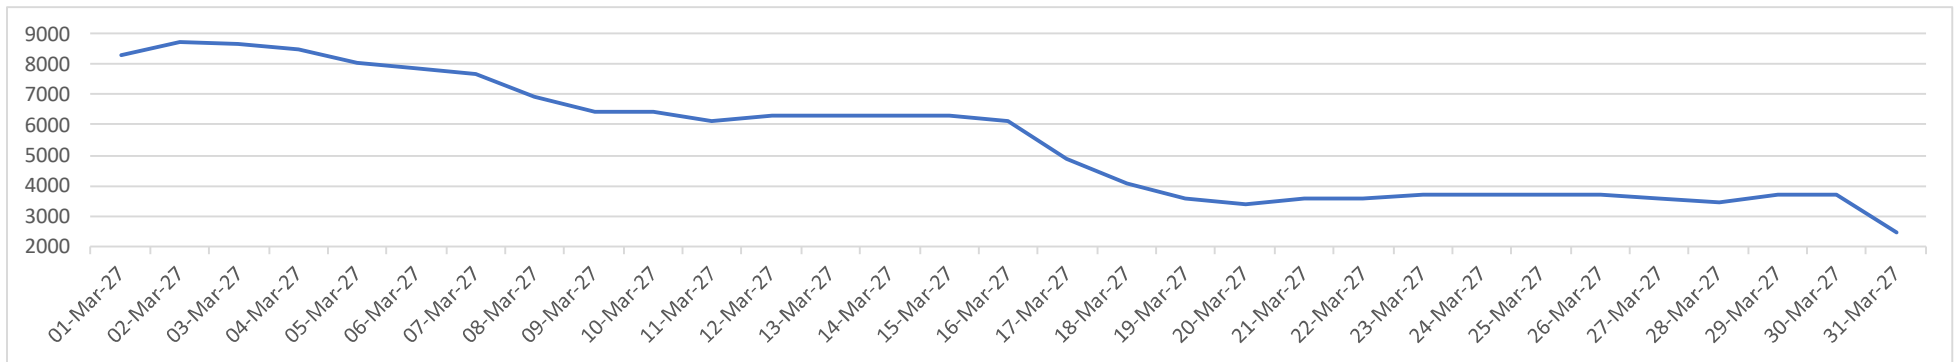

# Demand Forecasting

---

- Demand data received from:
  - Delhi
  - Haryana
  - J&K
  - Chandigarh
  - Punjab
  - Rajasthan
  - Uttar Pradesh
  - Uttarakhand
  - Himachal Pradesh
- NRPC Sectt computed Demand for FY 2026-27 from two methodologies:
  - Weightage Average method
  - CAGR method (Forecasting done on last 8 year's data)




**Energy Requirement**

**&**

**Unrestricted Peak Demand  
for F.Y. 2026-27**




# Energy Requirement (MU) - Chandigarh

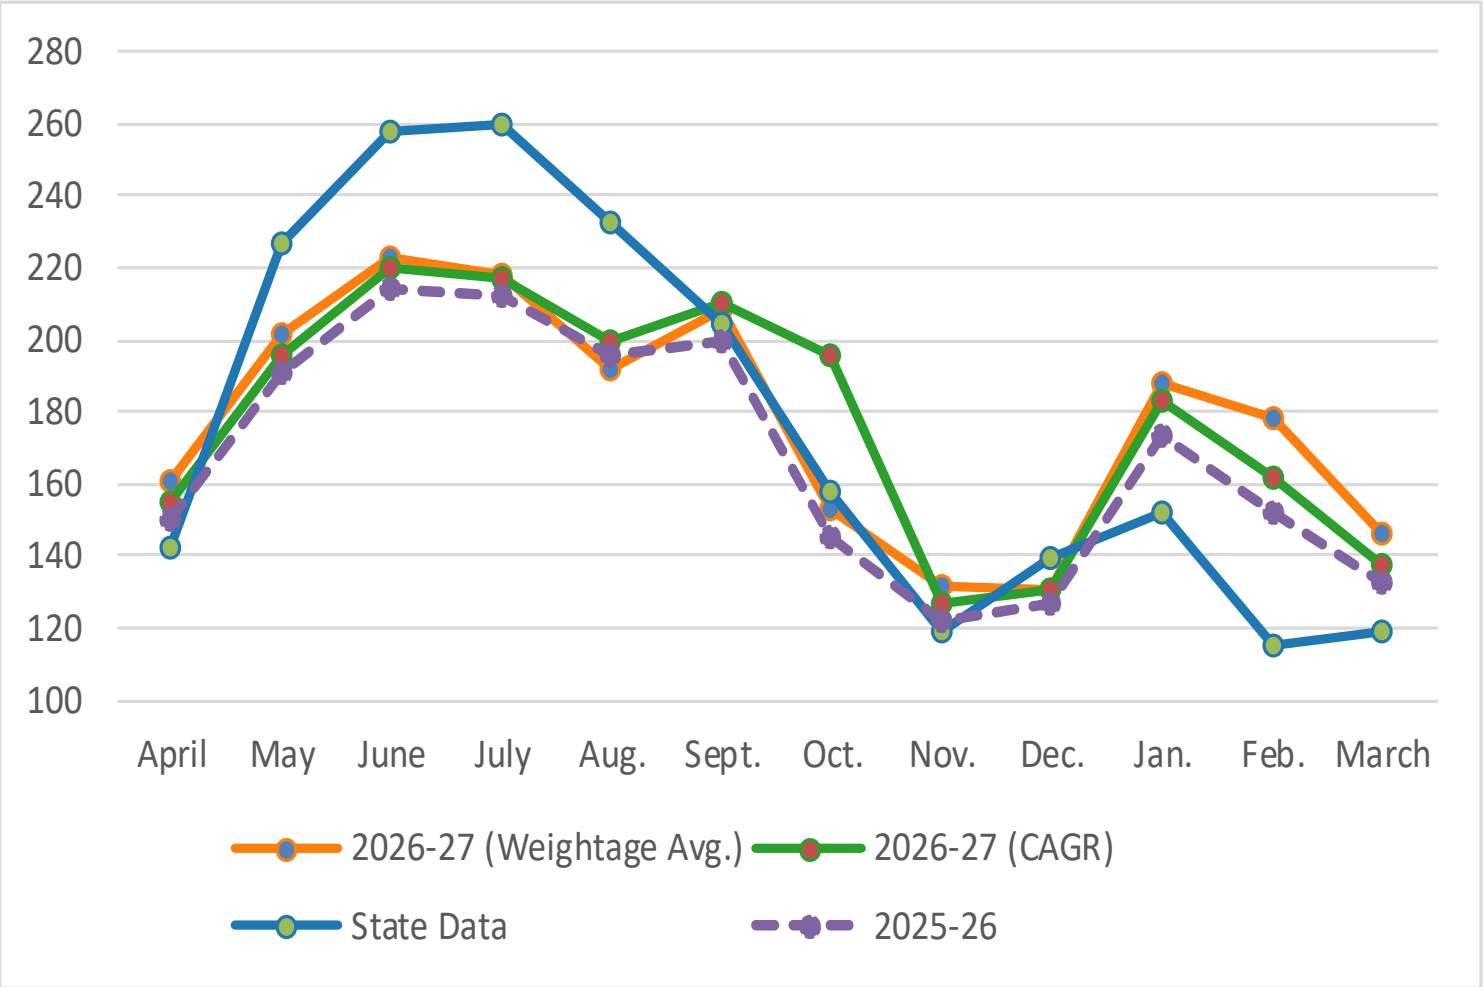


|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 161                      | 155            | 143        |
| May   | 202                      | 196            | 227        |
| June  | 223                      | 220            | 258        |
| July  | 218                      | 218            | 260        |
| Aug   | 192                      | 200            | 232        |
| Sept  | 208                      | 210            | 205        |
| Oct   | 153                      | 196            | 158        |
| Nov   | 131                      | 127            | 119        |
| Dec   | 131                      | 130            | 139        |
| Jan   | 188                      | 183            | 152        |
| Feb   | 178                      | 162            | 116        |
| March | 146                      | 137            | 119        |

# Unrestricted Peak Demand (MW) - Chandigarh

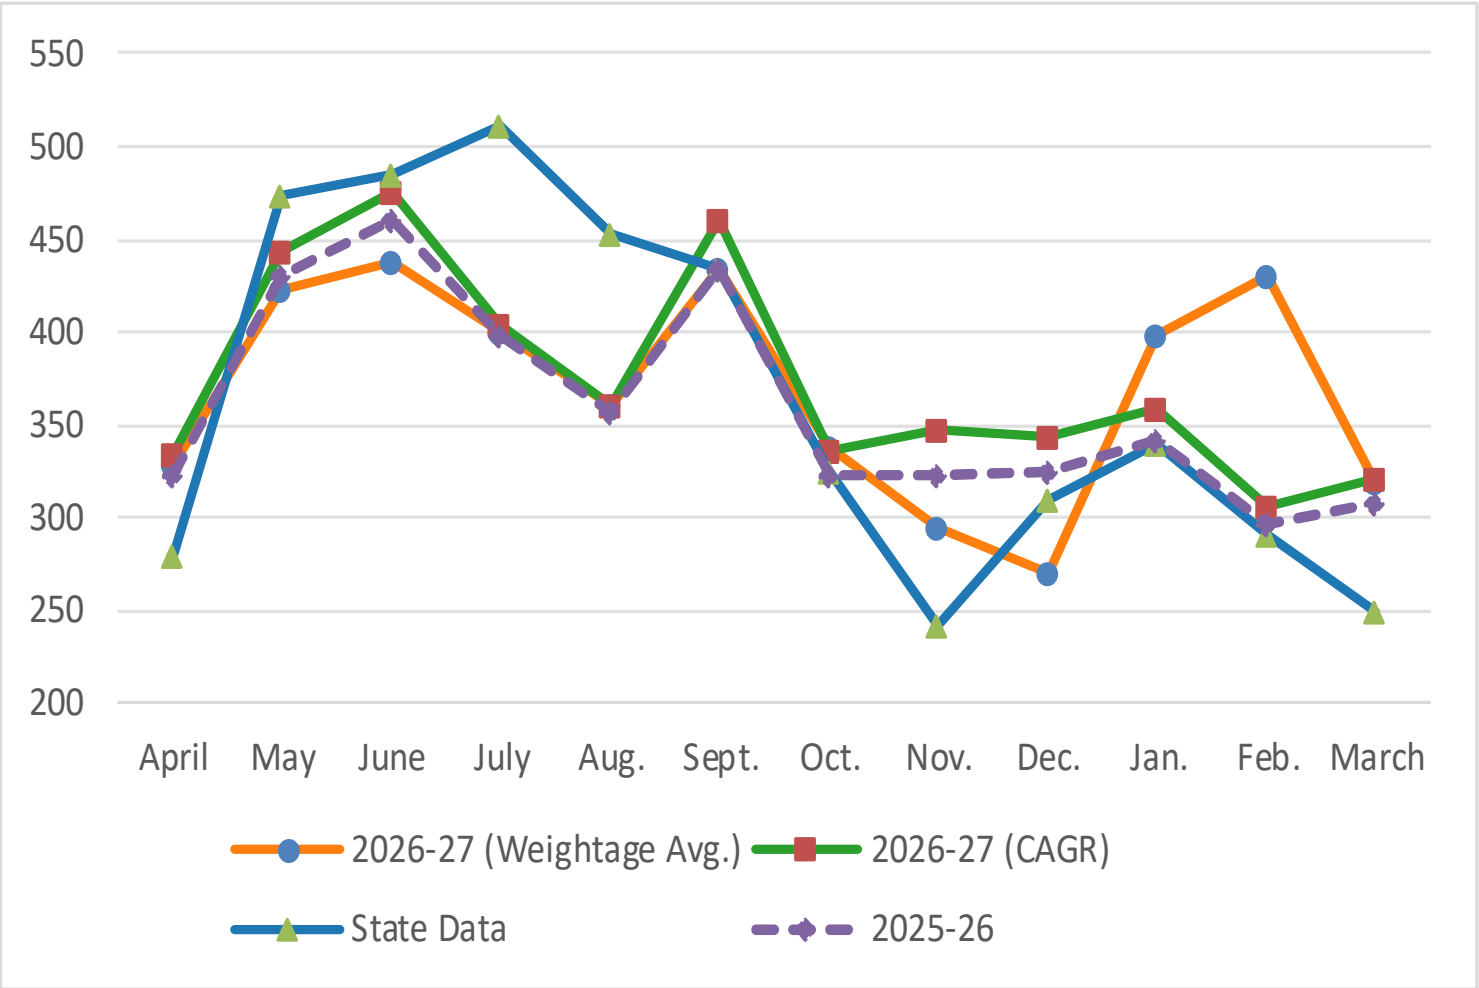


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 329                            | 333               | 279        |
| May   | 422                            | 444               | 473        |
| June  | 438                            | 475               | 485        |
| July  | 400                            | 404               | 511        |
| Aug   | 360                            | 360               | 454        |
| Sept  | 433                            | 460               | 434        |
| Oct   | 338                            | 335               | 324        |
| Nov   | 294                            | 347               | 241        |
| Dec   | 269                            | 344               | 309        |
| Jan   | 398                            | 358               | 339        |
| Feb   | 430                            | 306               | 291        |
| March | 320                            | 321               | 248        |

# Energy Requirement (MU) - Delhi

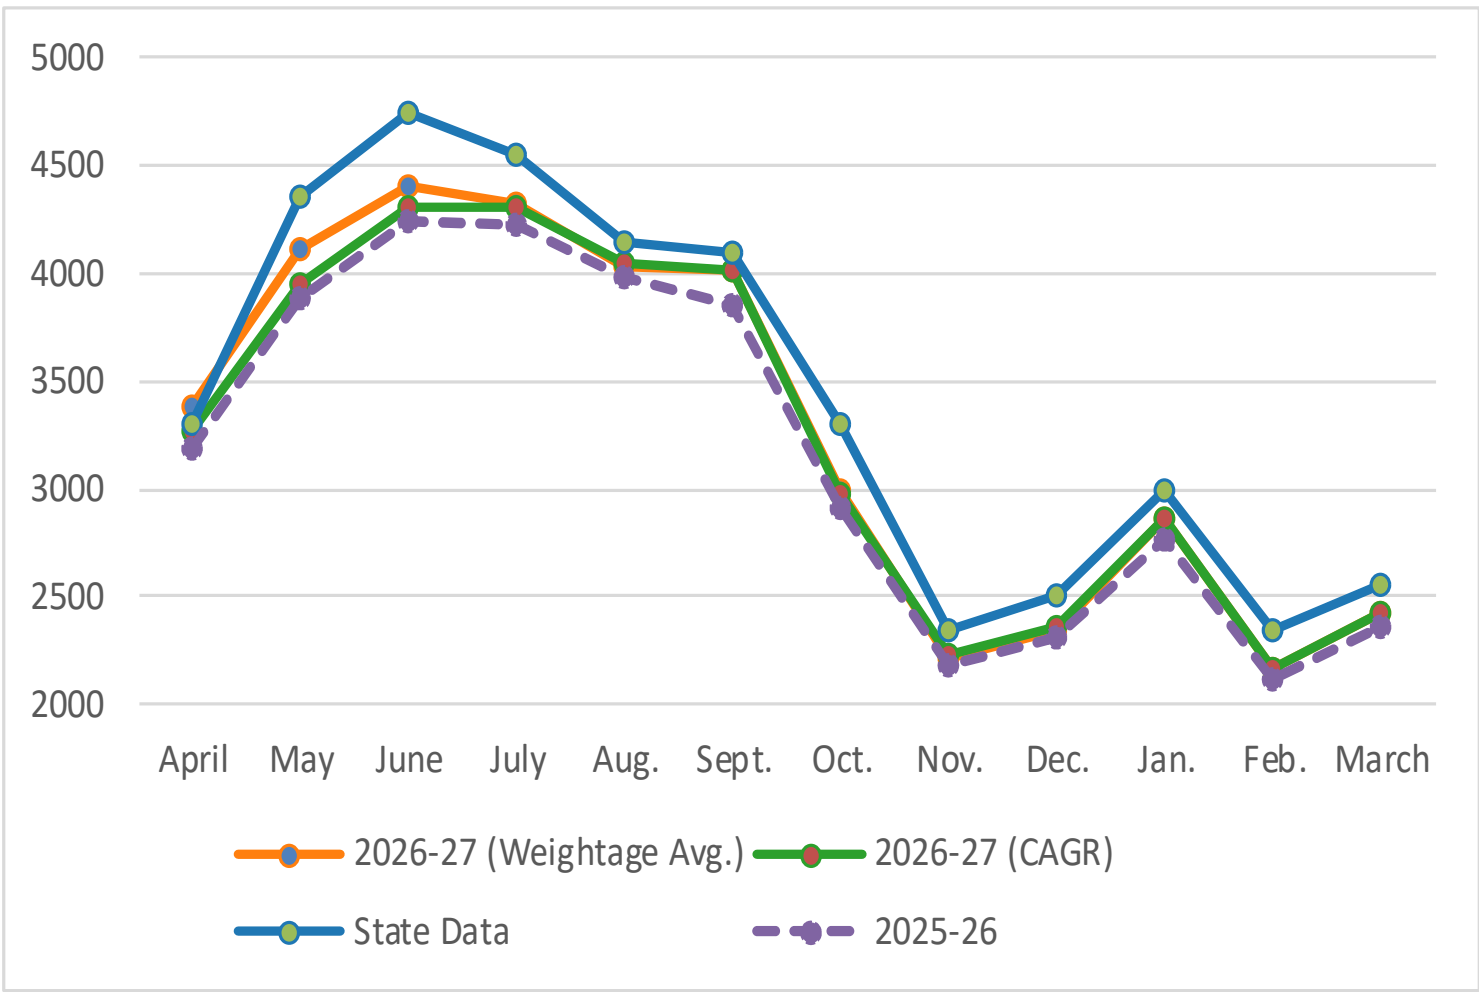


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 3387                           | 3268              | 3300       |
| May   | 4104                           | 3949              | 4350       |
| June  | 4401                           | 4305              | 4750       |
| July  | 4327                           | 4311              | 4550       |
| Aug   | 4027                           | 4051              | 4150       |
| Sept  | 4013                           | 4016              | 4100       |
| Oct   | 2987                           | 2980              | 3300       |
| Nov   | 2221                           | 2238              | 2350       |
| Dec   | 2342                           | 2354              | 2500       |
| Jan   | 2857                           | 2869              | 3000       |
| Feb   | 2160                           | 2163              | 2350       |
| March | 2434                           | 2427              | 2550       |

# Unrestricted Peak Demand (MW) - Delhi

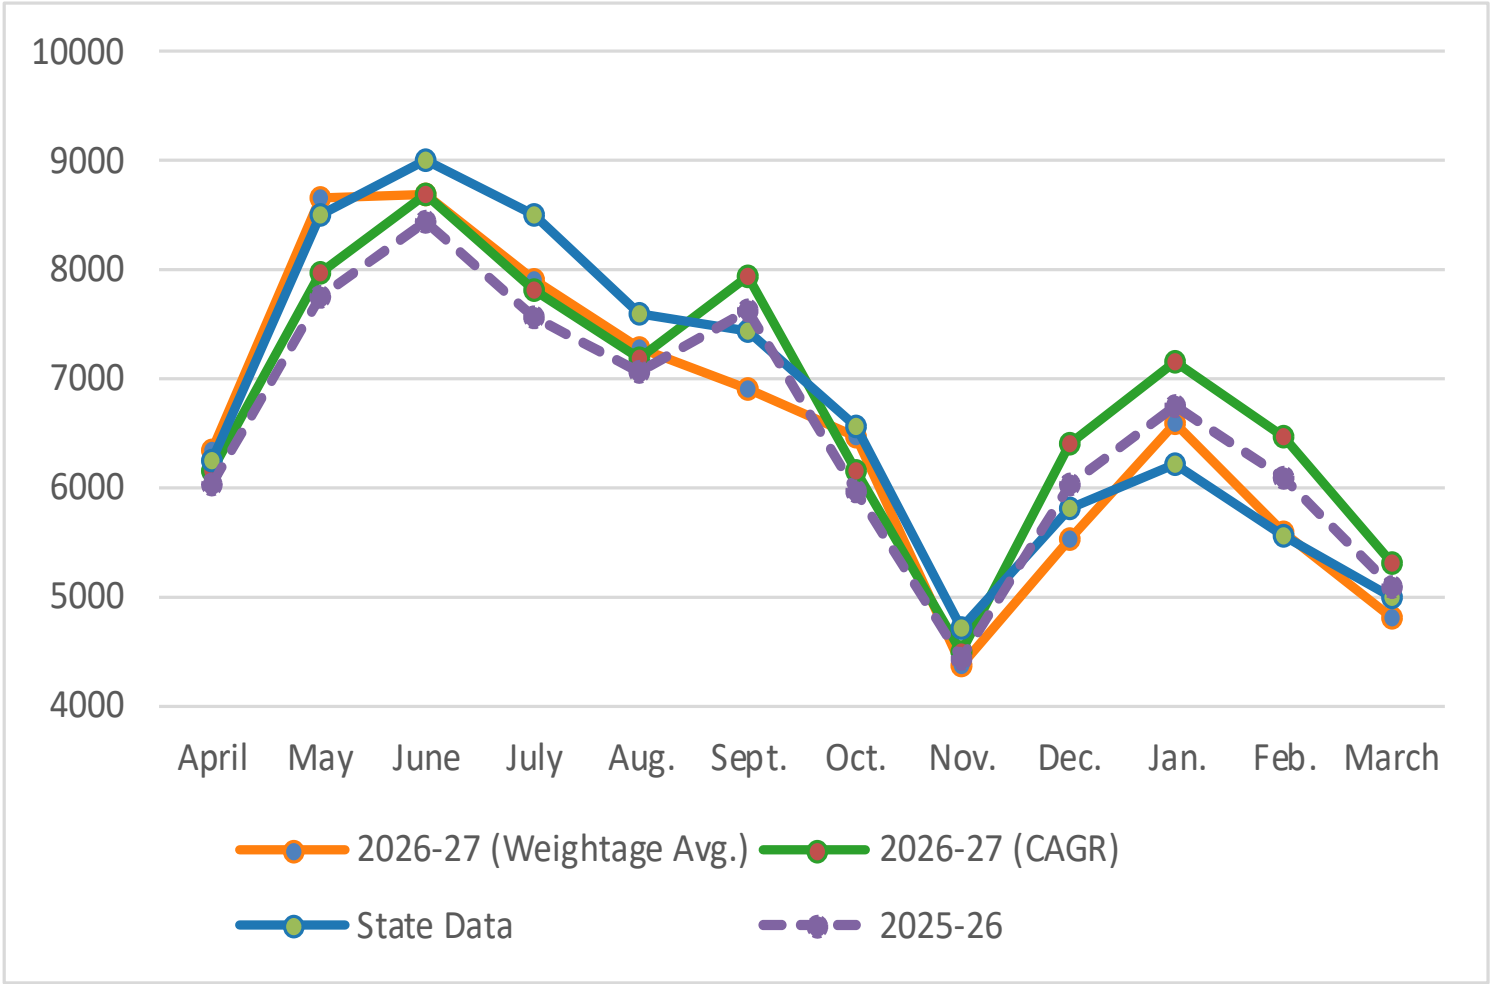


|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 6333                     | 6140           | 6250       |
| May   | 8660                     | 7955           | 8500       |
| June  | 8685                     | 8682           | 9000       |
| July  | 7910                     | 7800           | 8500       |
| Aug   | 7272                     | 7192           | 7600       |
| Sept  | 6900                     | 7947           | 7450       |
| Oct   | 6456                     | 6160           | 6550       |
| Nov   | 4359                     | 4479           | 4700       |
| Dec   | 5533                     | 6387           | 5800       |
| Jan   | 6574                     | 7146           | 6200       |
| Feb   | 5582                     | 6477           | 5550       |
| March | 4809                     | 5303           | 5000       |

## Energy Requirement (MU) - Haryana

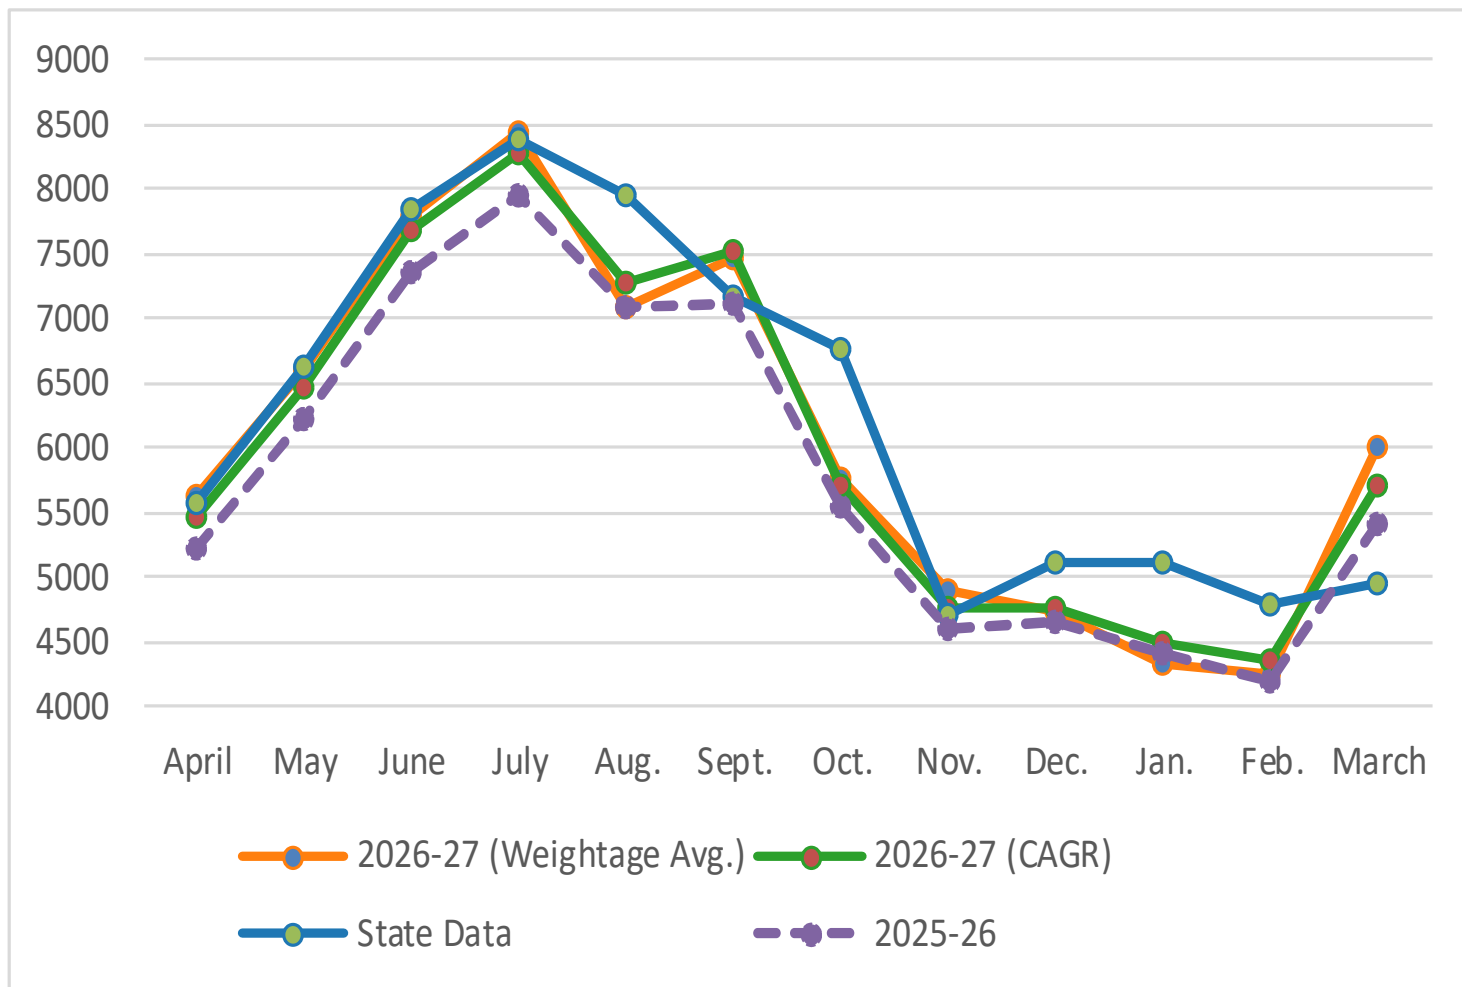


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 5624                           | 5473              | 5578       |
| May   | 6612                           | 6463              | 6616       |
| June  | 7802                           | 7690              | 7842       |
| July  | 8435                           | 8287              | 8392       |
| Aug   | 7092                           | 7280              | 7940       |
| Sept  | 7470                           | 7517              | 7159       |
| Oct   | 5763                           | 5717              | 6764       |
| Nov   | 4892                           | 4777              | 4708       |
| Dec   | 4751                           | 4758              | 5118       |
| Jan   | 4344                           | 4492              | 5124       |
| Feb   | 4251                           | 4350              | 4791       |
| March | 6016                           | 5710              | 4965       |

# Unrestricted Peak Demand (MW) - Haryana

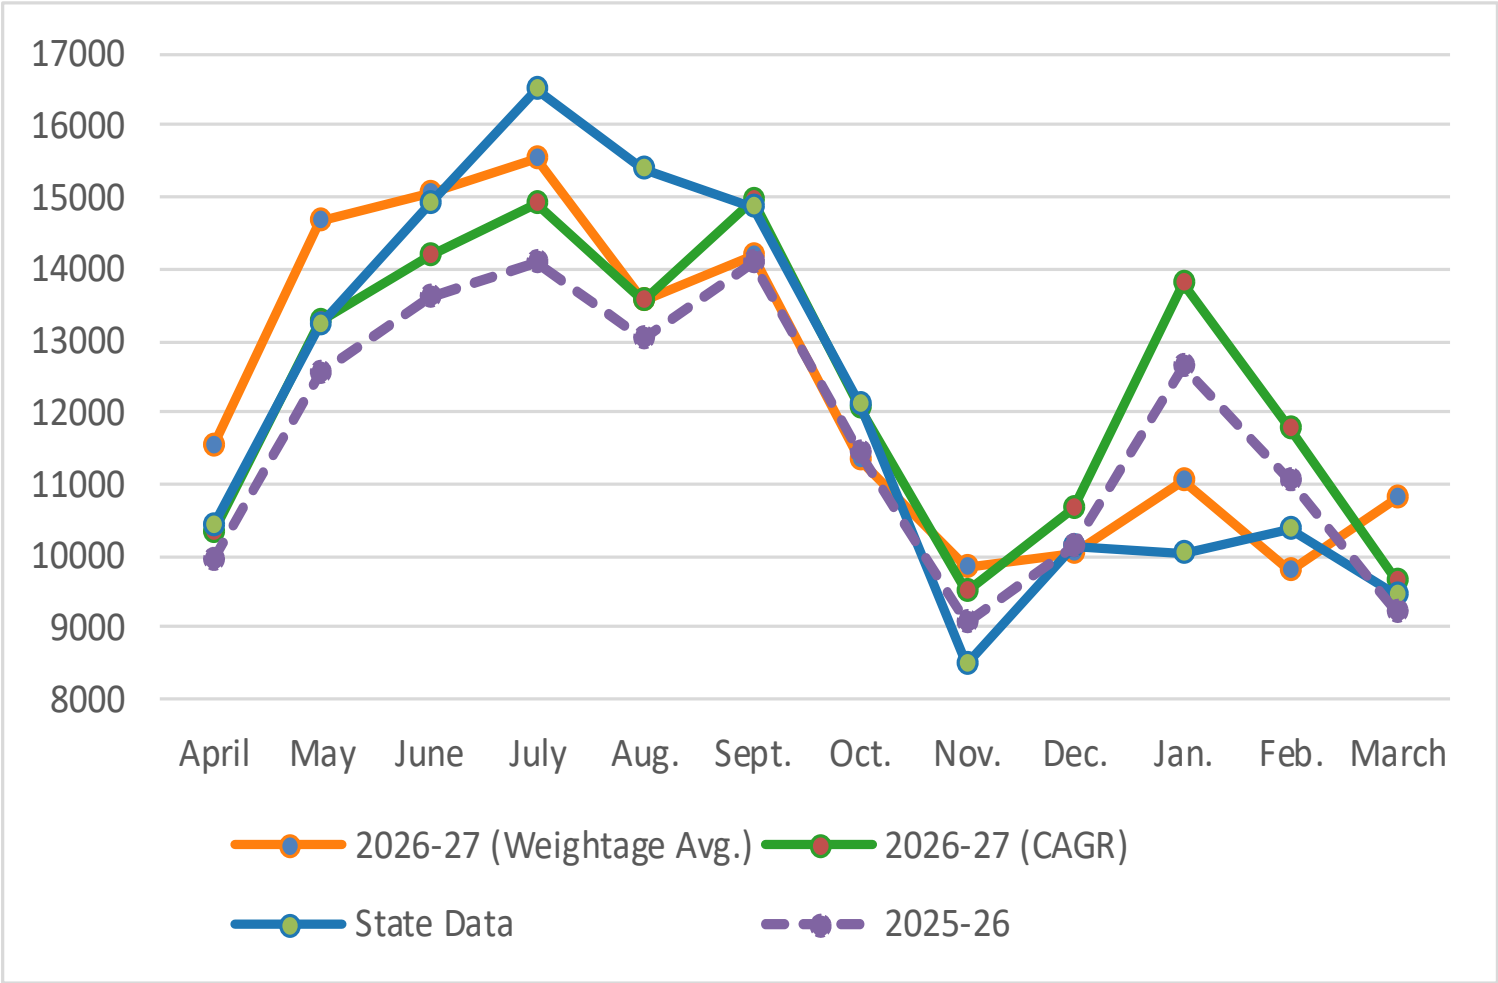


|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 11556                    | 10305          | 10440      |
| May   | 14669                    | 13273          | 13207      |
| June  | 15042                    | 14201          | 14910      |
| July  | 15539                    | 14890          | 16510      |
| Aug   | 13558                    | 13573          | 15379      |
| Sept  | 14177                    | 14980          | 14866      |
| Oct   | 11319                    | 12053          | 12109      |
| Nov   | 9842                     | 9523           | 8488       |
| Dec   | 10031                    | 10646          | 10114      |
| Jan   | 11031                    | 13786          | 10037      |
| Feb   | 9807                     | 11795          | 10386      |
| March | 10823                    | 9632           | 9464       |

# Energy Requirement (MU) - HP

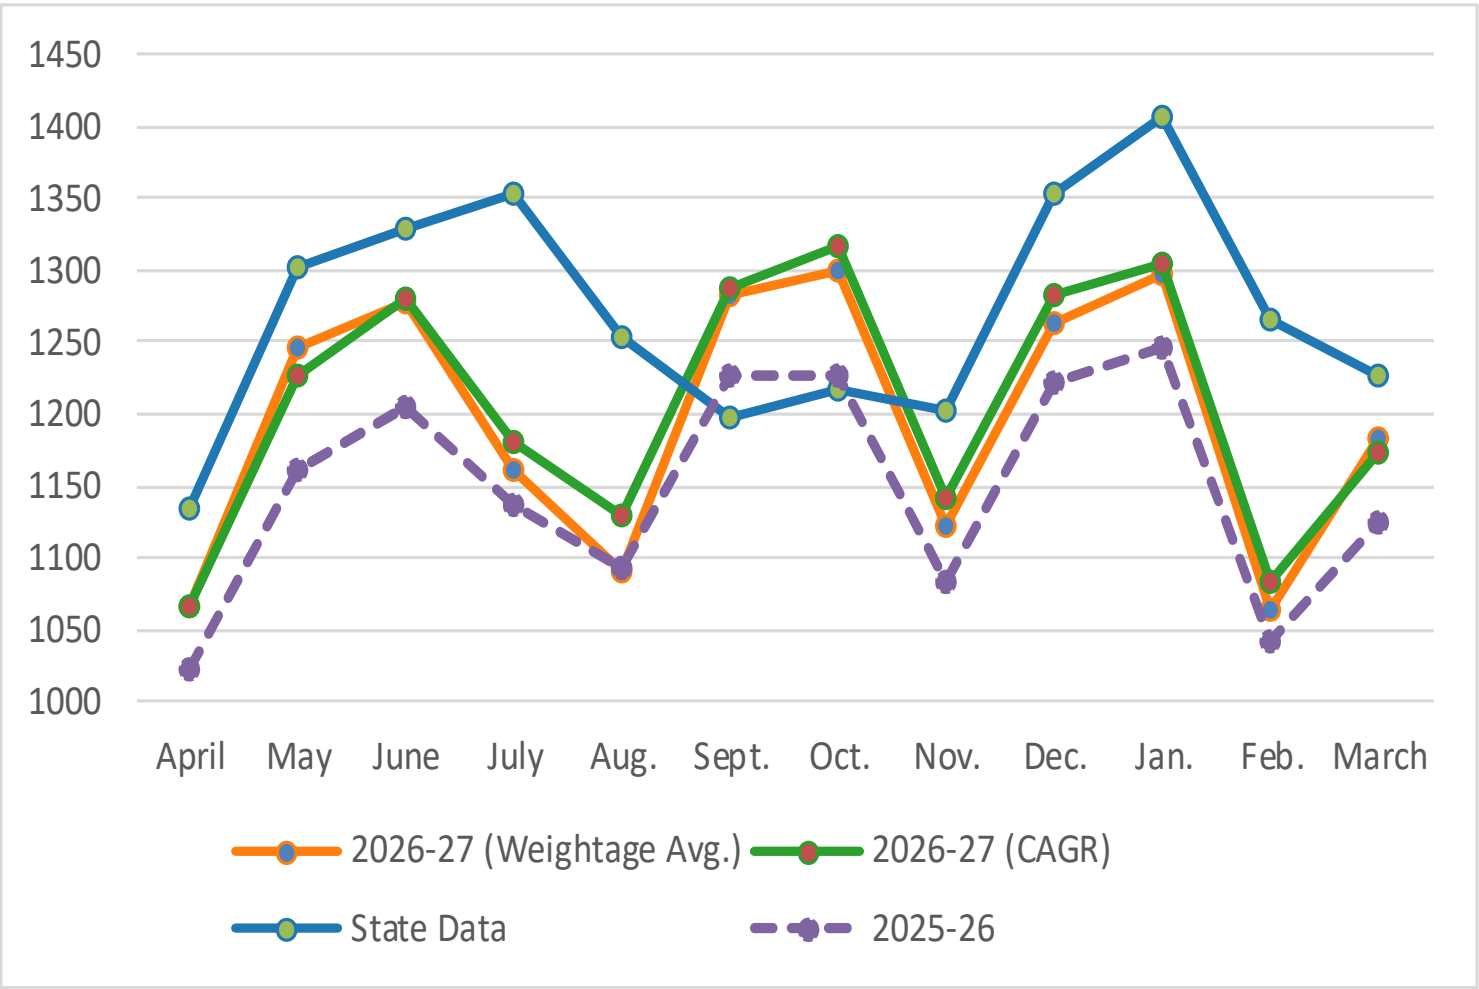

|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 1067                           | 1068              | 1134       |
| May   | 1247                           | 1228              | 1301       |
| June  | 1277                           | 1281              | 1328       |
| July  | 1161                           | 1181              | 1352       |
| Aug   | 1091                           | 1129              | 1253       |
| Sept  | 1283                           | 1289              | 1197       |
| Oct   | 1301                           | 1316              | 1218       |
| Nov   | 1123                           | 1141              | 1203       |
| Dec   | 1264                           | 1283              | 1353       |
| Jan   | 1297                           | 1305              | 1406       |
| Feb   | 1064                           | 1083              | 1266       |
| March | 1183                           | 1175              | 1228       |


# Unrestricted Peak Demand (MW) - HP

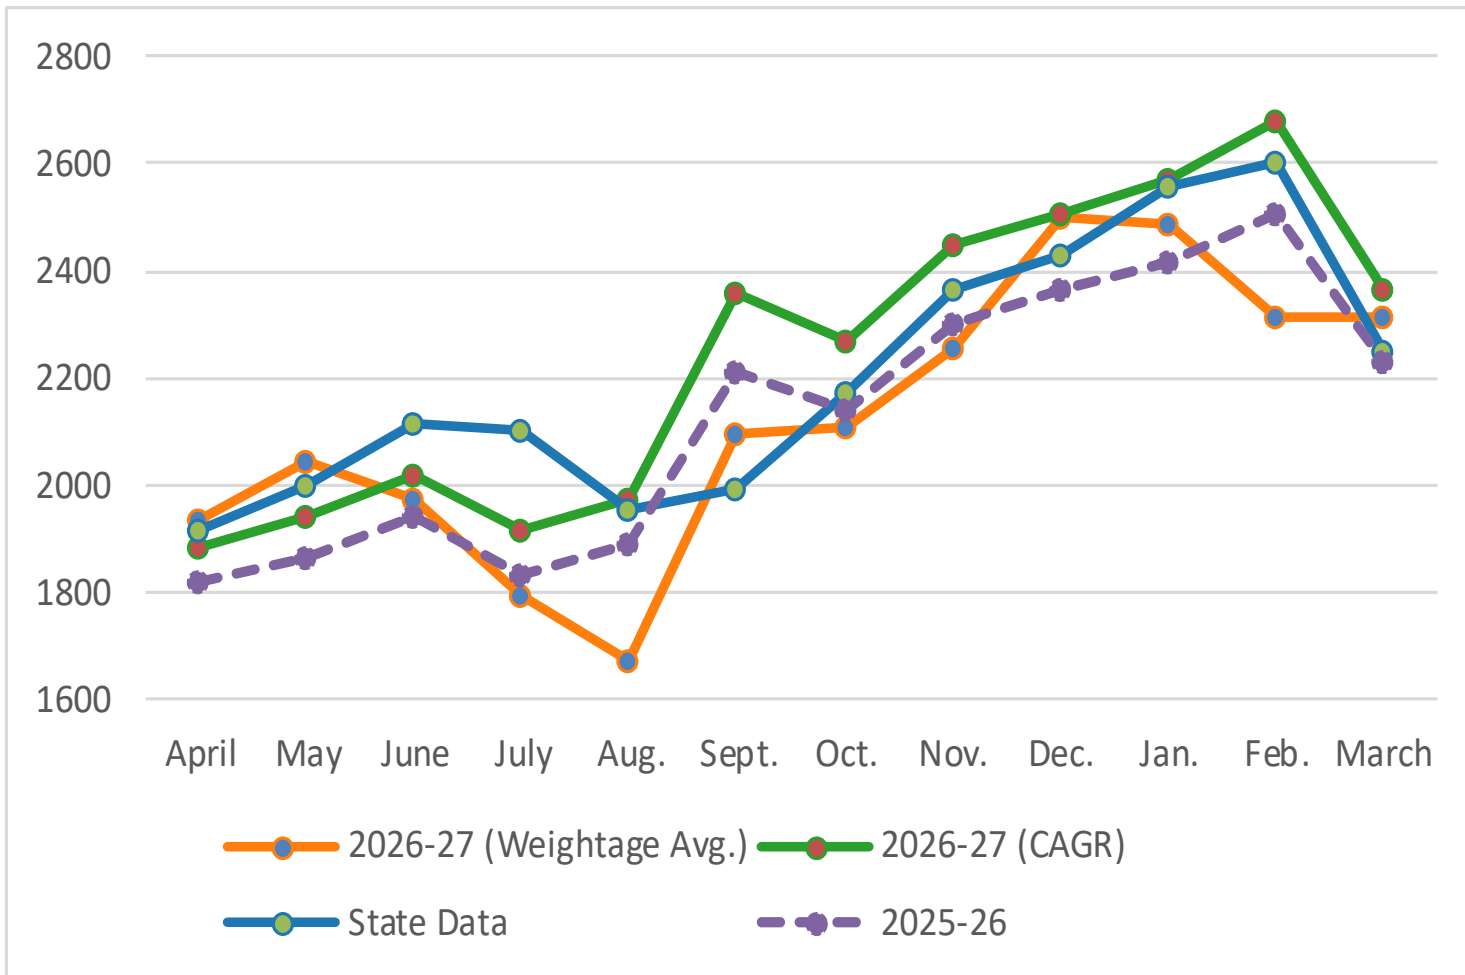

|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 1934                           | 1883              | 1917       |
| May   | 2047                           | 1943              | 2003       |
| June  | 1974                           | 2021              | 2117       |
| July  | 1798                           | 1918              | 2101       |
| Aug   | 1670                           | 1977              | 1954       |
| Sept  | 2096                           | 2361              | 1996       |
| Oct   | 2106                           | 2267              | 2175       |
| Nov   | 2255                           | 2447              | 2364       |
| Dec   | 2502                           | 2507              | 2431       |
| Jan   | 2485                           | 2569              | 2558       |
| Feb   | 2316                           | 2682              | 2605       |
| March | 2312                           | 2363              | 2247       |




# Energy Requirement (MU) - J&K

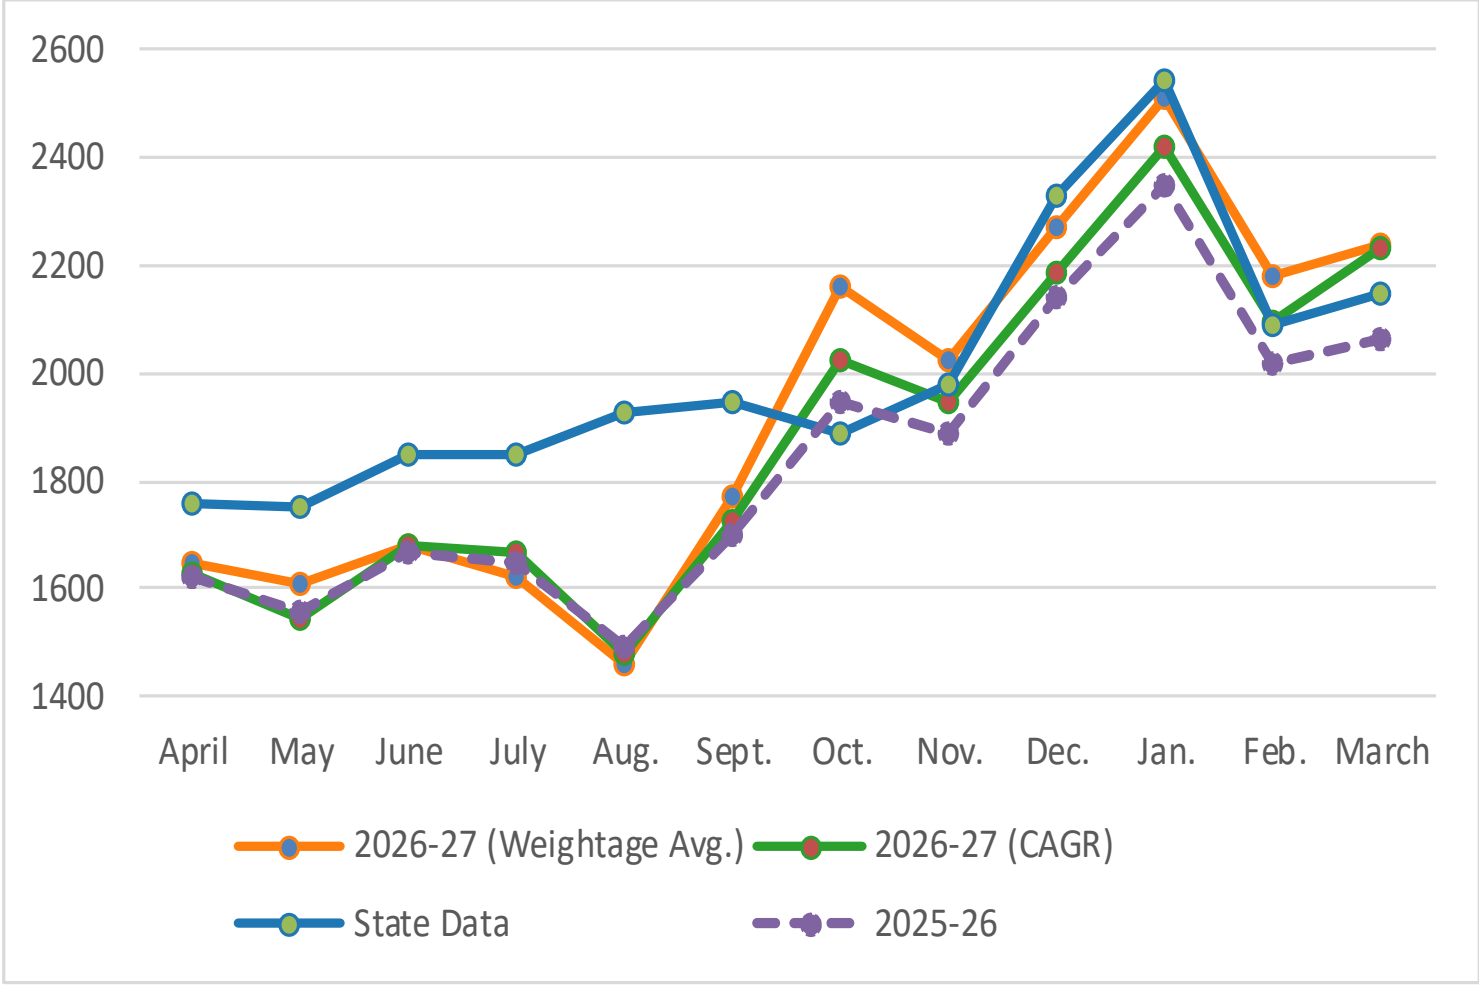


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 1646                           | 1631              | 1755       |
| May   | 1609                           | 1542              | 1750       |
| June  | 1684                           | 1683              | 1849       |
| July  | 1622                           | 1670              | 1848       |
| Aug   | 1458                           | 1479              | 1929       |
| Sept  | 1772                           | 1725              | 1944       |
| Oct   | 2161                           | 2026              | 1889       |
| Nov   | 2022                           | 1949              | 1981       |
| Dec   | 2268                           | 2184              | 2330       |
| Jan   | 2509                           | 2423              | 2542       |
| Feb   | 2177                           | 2095              | 2086       |
| March | 2240                           | 2233              | 2150       |

# Unrestricted Peak Demand (MW) - J&K

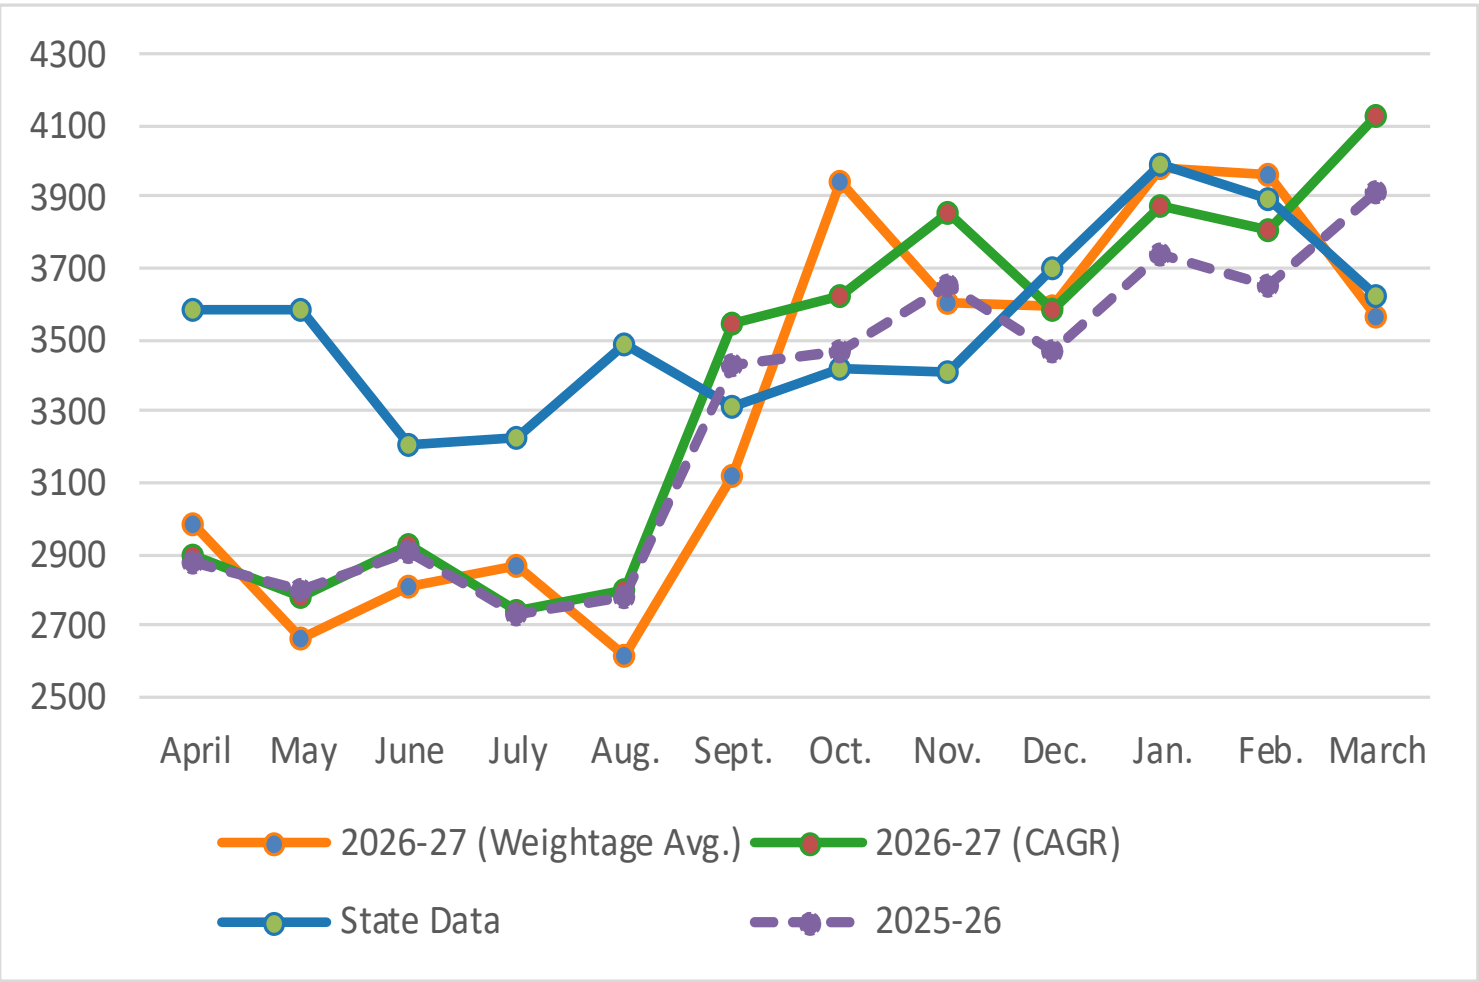


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 2984                           | 2896              | 3586       |
| May   | 2665                           | 2776              | 3582       |
| June  | 2806                           | 2930              | 3202       |
| July  | 2864                           | 2742              | 3227       |
| Aug   | 2615                           | 2797              | 3486       |
| Sept  | 3119                           | 3547              | 3317       |
| Oct   | 3945                           | 3620              | 3422       |
| Nov   | 3607                           | 3860              | 3415       |
| Dec   | 3597                           | 3589              | 3701       |
| Jan   | 3983                           | 3875              | 3995       |
| Feb   | 3962                           | 3808              | 3897       |
| March | 3568                           | 4125              | 3620       |

## Energy Requirement (MU) - Punjab

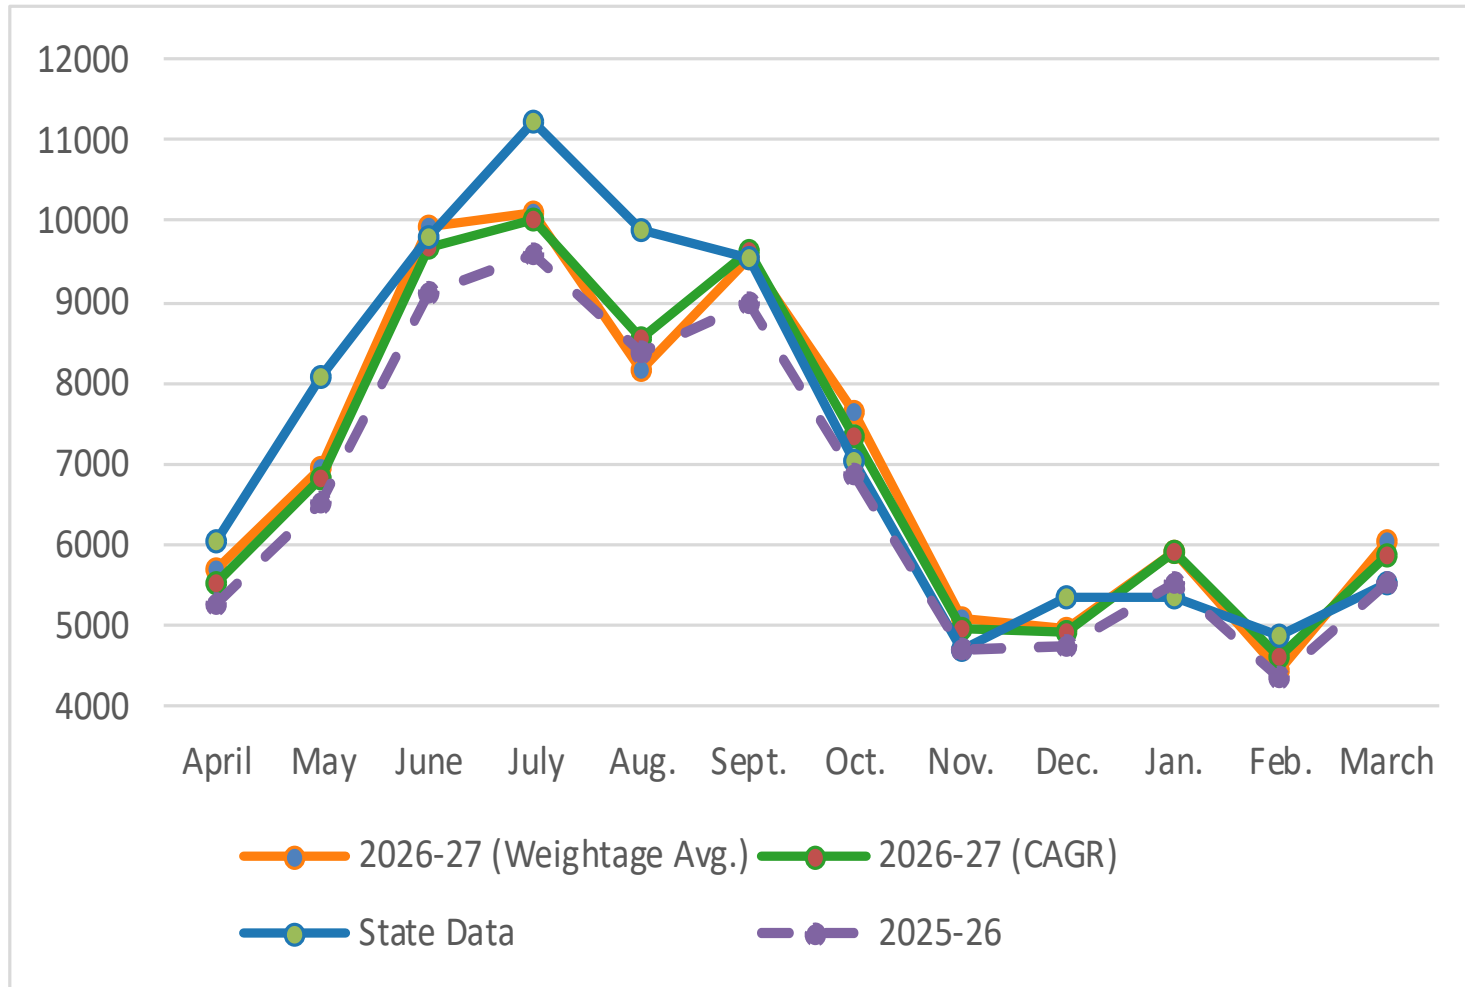


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 5698                           | 5543              | 6047       |
| May   | 6954                           | 6806              | 8075       |
| June  | 9920                           | 9684              | 9816       |
| July  | 10124                          | 10021             | 11239      |
| Aug   | 8152                           | 8542              | 9900       |
| Sept  | 9550                           | 9620              | 9556       |
| Oct   | 7633                           | 7361              | 7058       |
| Nov   | 5091                           | 4967              | 4703       |
| Dec   | 4943                           | 4942              | 5364       |
| Jan   | 5929                           | 5900              | 5375       |
| Feb   | 4450                           | 4620              | 4858       |
| March | 6037                           | 5858              | 5515       |

## Unrestricted Peak Demand (MW) - Punjab

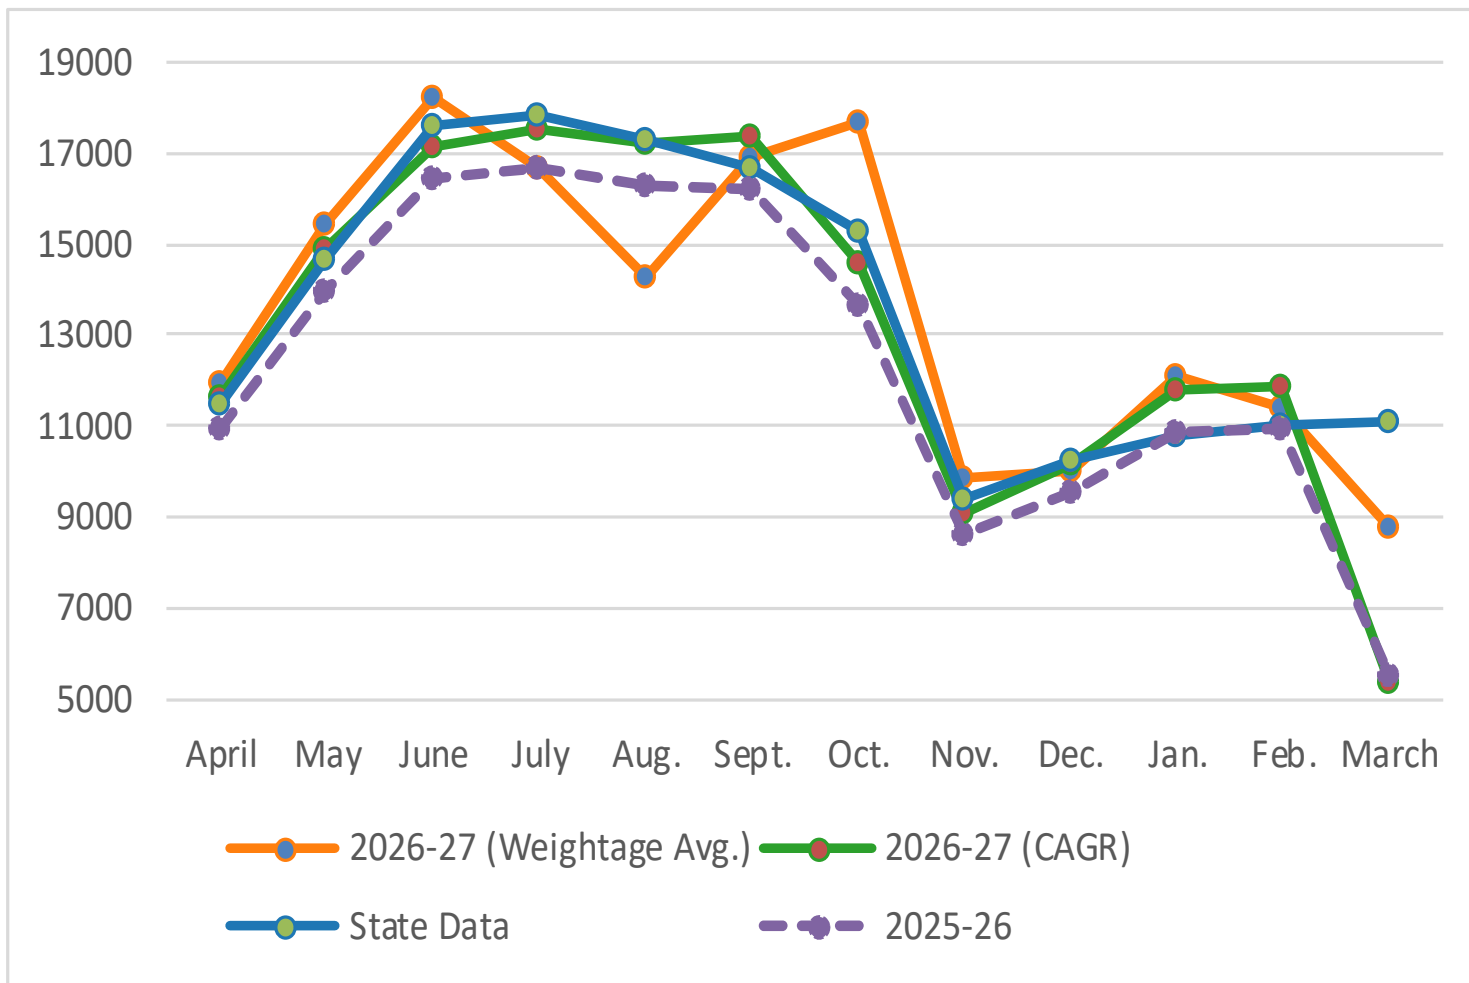


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 11929                          | 11615             | 11465      |
| May   | 15443                          | 14893             | 14667      |
| June  | 18258                          | 17106             | 17578      |
| July  | 16710                          | 17534             | 17873      |
| Aug   | 14285                          | 17238             | 17289      |
| Sept  | 16916                          | 17378             | 16639      |
| Oct   | 17663                          | 14607             | 15256      |
| Nov   | 9877                           | 9104              | 9424       |
| Dec   | 9980                           | 10187             | 10245      |
| Jan   | 12073                          | 11759             | 10777      |
| Feb   | 11429                          | 11881             | 11048      |
| March | 8735                           | 5365              | 11097      |

# Energy Requirement (MU) - Rajasthan

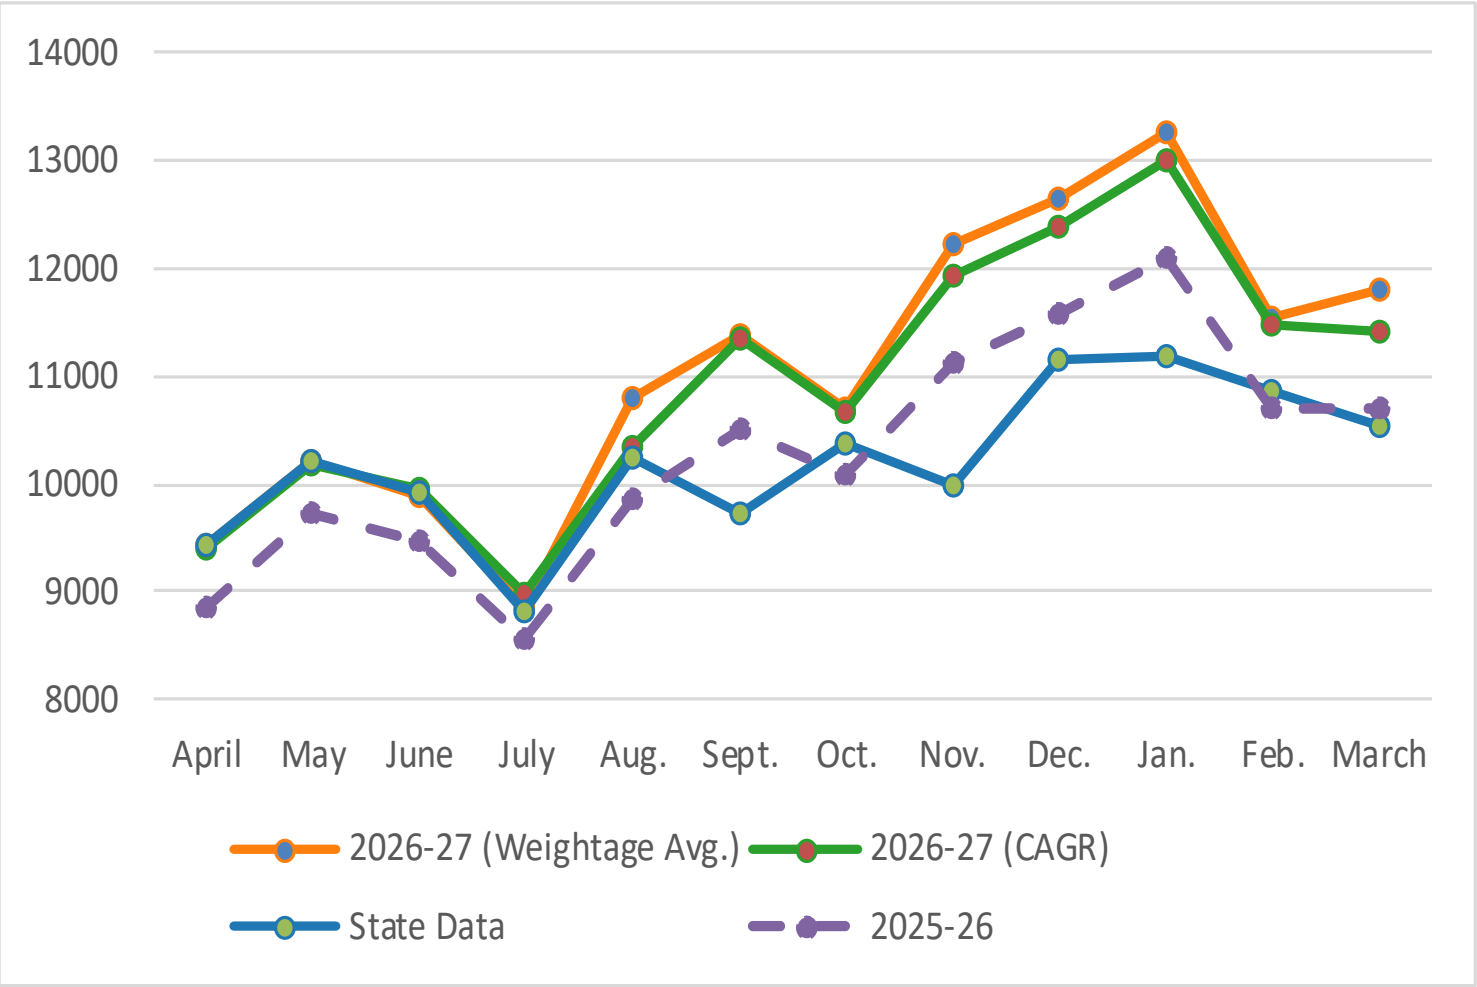


|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 9438                     | 9415           | 9437       |
| May   | 10203                    | 10193          | 10202      |
| June  | 9904                     | 9966           | 9926       |
| July  | 8838                     | 8997           | 8817       |
| Aug   | 10810                    | 10356          | 10255      |
| Sept  | 11392                    | 11340          | 9743       |
| Oct   | 10709                    | 10670          | 10364      |
| Nov   | 12238                    | 11932          | 9978       |
| Dec   | 12660                    | 12400          | 11157      |
| Jan   | 13259                    | 12999          | 11197      |
| Feb   | 11552                    | 11483          | 10873      |
| March | 11817                    | 11408          | 10537      |

# Unrestricted Peak Demand (MW) - Rajasthan

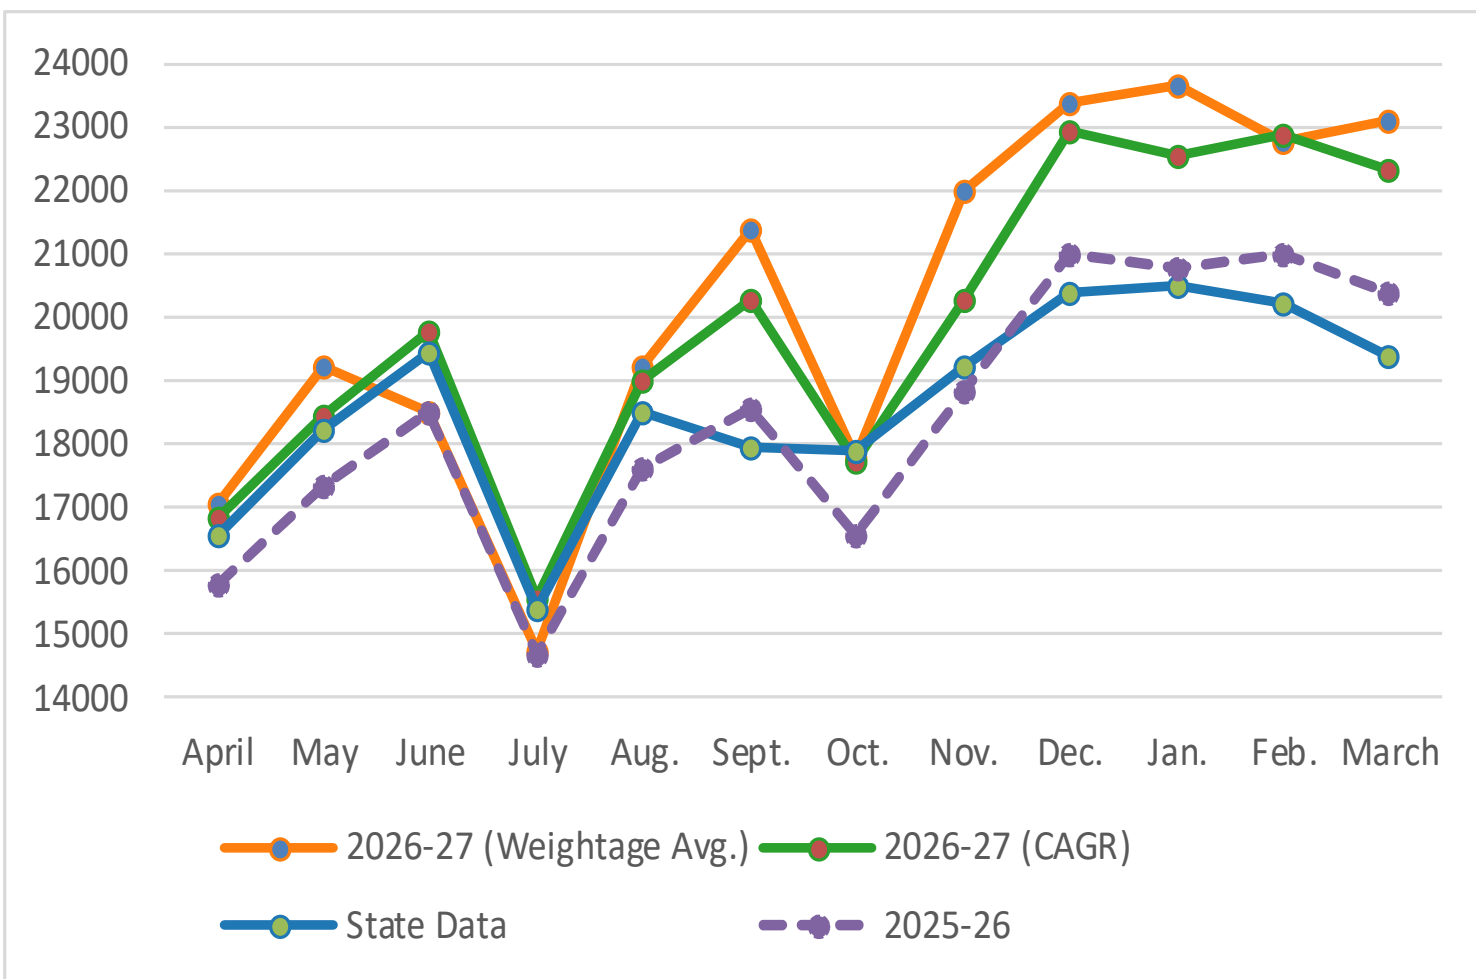


|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 17079                          | 16854             | 16590      |
| May   | 19212                          | 18429             | 18203      |
| June  | 18519                          | 19763             | 19434      |
| July  | 14726                          | 15560             | 15419      |
| Aug   | 19195                          | 19010             | 18487      |
| Sept  | 21384                          | 20273             | 17962      |
| Oct   | 17768                          | 17744             | 17867      |
| Nov   | 21972                          | 20247             | 19221      |
| Dec   | 23380                          | 22904             | 20354      |
| Jan   | 23649                          | 22509             | 20474      |
| Feb   | 22770                          | 22849             | 20229      |
| March | 23078                          | 22308             | 19384      |

# Energy Requirement (MU) - UP

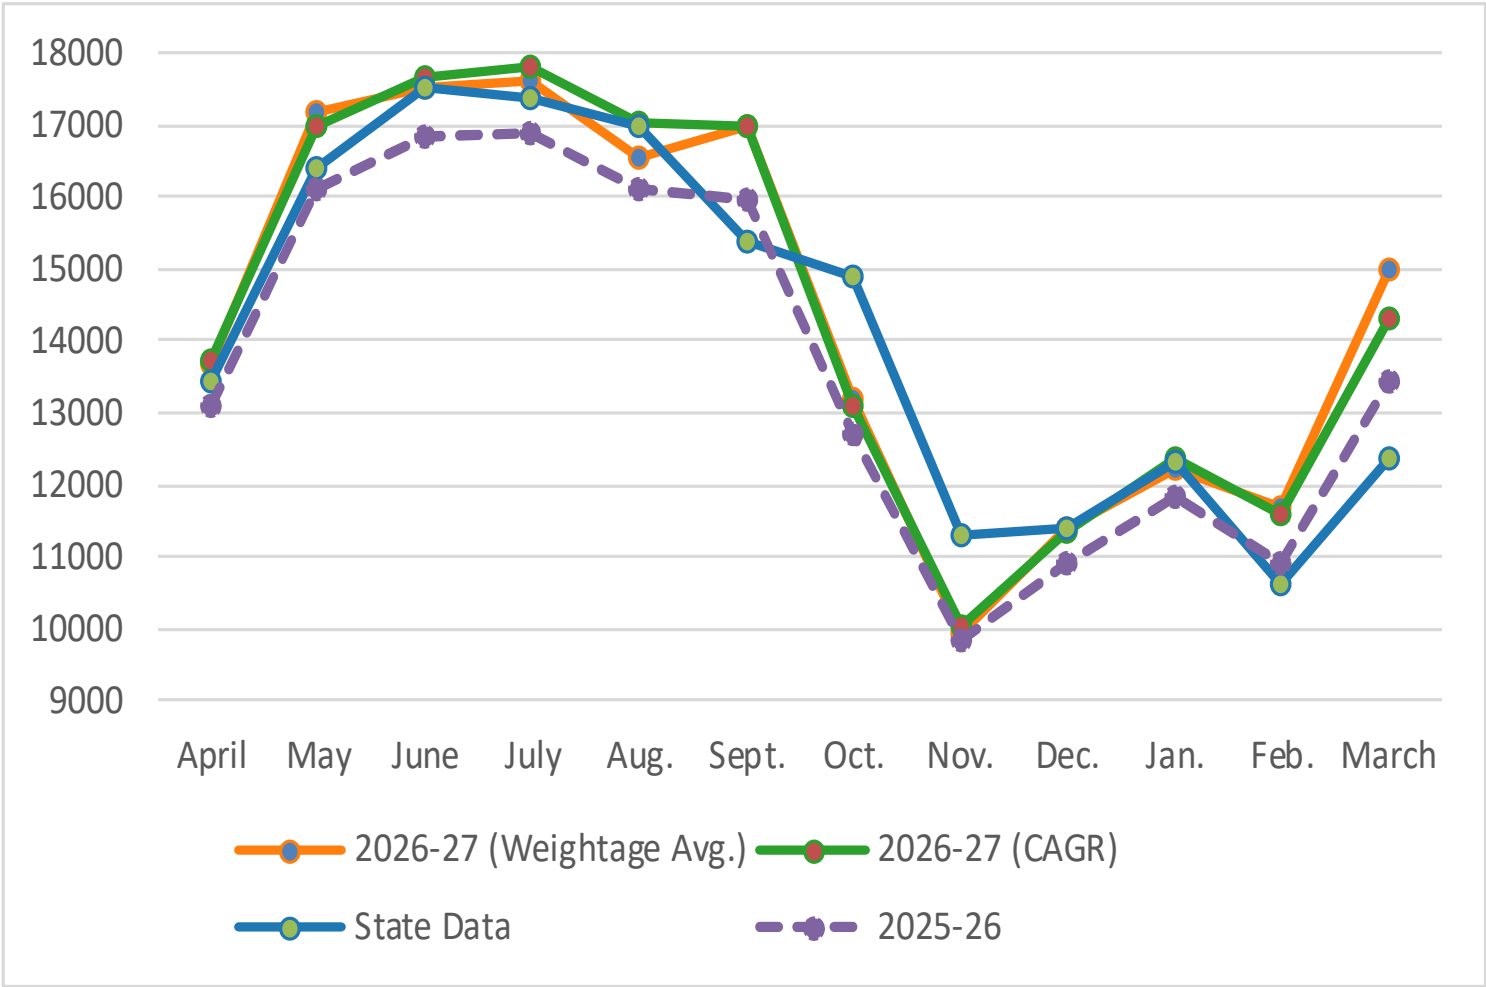

|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 13669                    | 13717          | 13424      |
| May   | 17176                    | 16978          | 16427      |
| June  | 17513                    | 17679          | 17500      |
| July  | 17601                    | 17811          | 17400      |
| Aug   | 16551                    | 17039          | 17000      |
| Sept  | 16981                    | 17011          | 15400      |
| Oct   | 13178                    | 13093          | 14900      |
| Nov   | 9942                     | 10058          | 11300      |
| Dec   | 11406                    | 11332          | 11400      |
| Jan   | 12208                    | 12390          | 12300      |
| Feb   | 11703                    | 11572          | 10600      |
| March | 15007                    | 14301          | 12360      |


# Unrestricted Peak Demand (MW) - UP

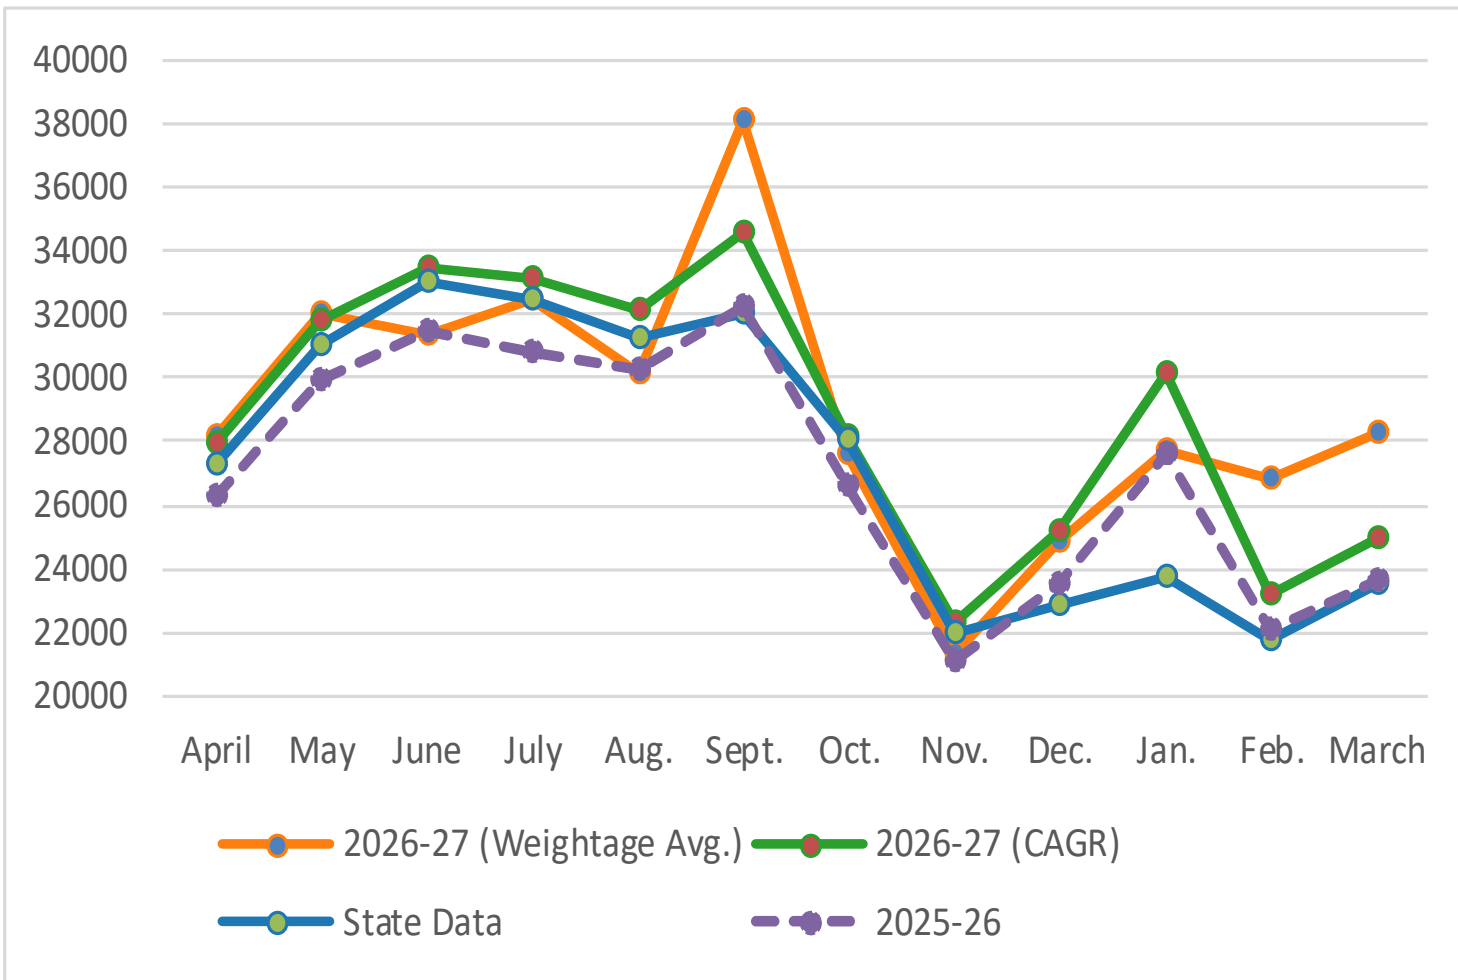

|       | 2026-27<br>(WEIGHTAGE<br>AVG.) | 2026-27<br>(CAGR) | STATE DATA |
|-------|--------------------------------|-------------------|------------|
| April | 28155                          | 27978             | 27300      |
| May   | 32054                          | 31760             | 31000      |
| June  | 31316                          | 33477             | 33000      |
| July  | 32447                          | 33097             | 32500      |
| Aug   | 30138                          | 32080             | 31300      |
| Sept  | 38057                          | 34545             | 32000      |
| Oct   | 27593                          | 28127             | 28000      |
| Nov   | 21273                          | 22317             | 22000      |
| Dec   | 24856                          | 25119             | 22800      |
| Jan   | 27746                          | 30133             | 23700      |
| Feb   | 26775                          | 23218             | 21800      |
| March | 28215                          | 25001             | 23500      |




# Energy Requirement (MU) - Uttarakhand

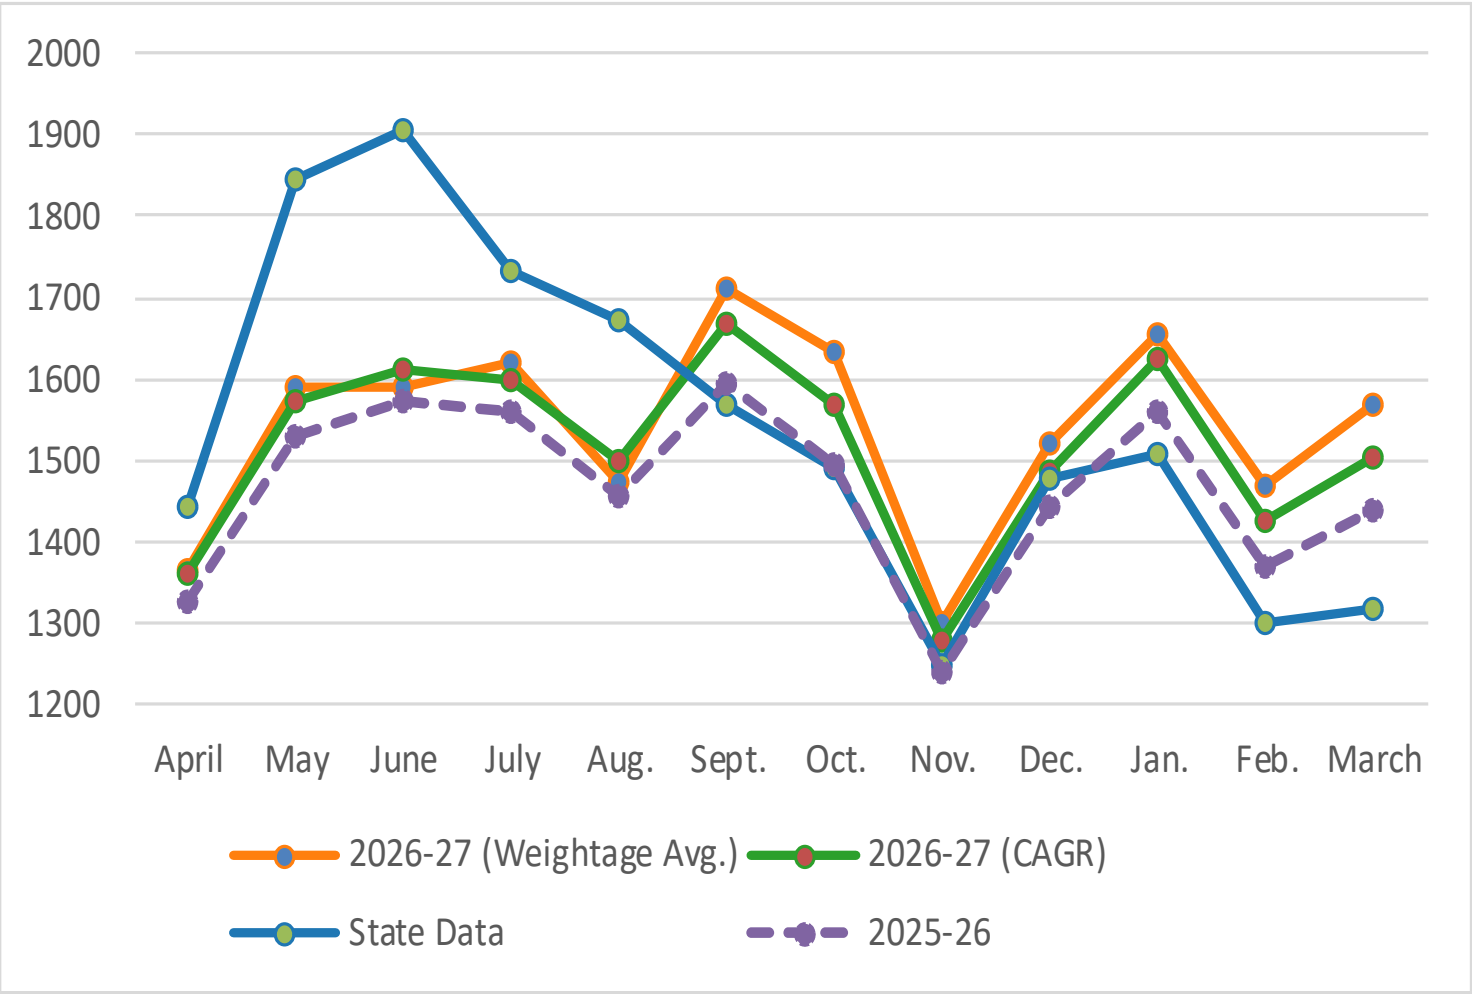

|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 1365                     | 1360           | 1442       |
| May   | 1591                     | 1574           | 1845       |
| June  | 1592                     | 1614           | 1907       |
| July  | 1620                     | 1601           | 1734       |
| Aug   | 1475                     | 1500           | 1674       |
| Sept  | 1710                     | 1670           | 1569       |
| Oct   | 1634                     | 1570           | 1489       |
| Nov   | 1301                     | 1277           | 1251       |
| Dec   | 1522                     | 1488           | 1476       |
| Jan   | 1655                     | 1624           | 1507       |
| Feb   | 1470                     | 1428           | 1300       |
| March | 1570                     | 1504           | 1320       |

# Unrestricted Peak Demand (MW) - Uttarakhand

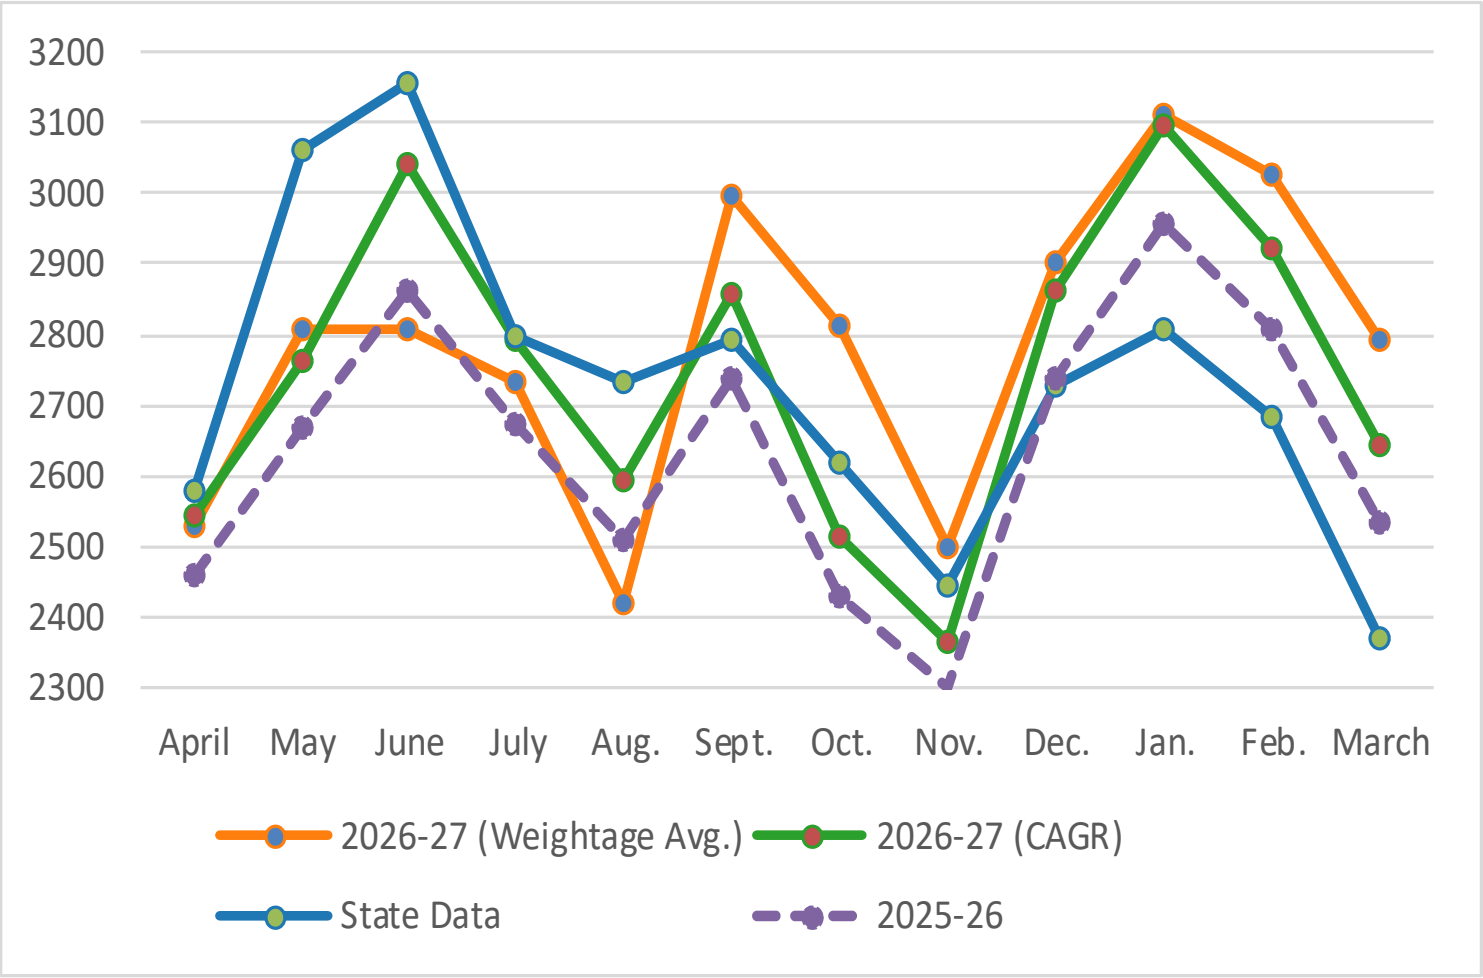

|       | 2026-27 (WEIGHTAGE AVG.) | 2026-27 (CAGR) | STATE DATA |
|-------|--------------------------|----------------|------------|
| April | 2529                     | 2542           | 2577       |
| May   | 2807                     | 2761           | 3062       |
| June  | 2807                     | 3042           | 3158       |
| July  | 2731                     | 2792           | 2799       |
| Aug   | 2418                     | 2595           | 2731       |
| Sept  | 2996                     | 2858           | 2792       |
| Oct   | 2811                     | 2516           | 2619       |
| Nov   | 2501                     | 2365           | 2444       |
| Dec   | 2901                     | 2861           | 2730       |
| Jan   | 3114                     | 3097           | 2806       |
| Feb   | 3028                     | 2923           | 2685       |
| March | 2792                     | 2642           | 2369       |



*Thank You*

# ANNEXURE - II

Format for unit wise outage schedule of generating stations

|                        |          |              |        |               |                      |          | Outage 1  |           |                                                                                        |                                                |  |
|------------------------|----------|--------------|--------|---------------|----------------------|----------|-----------|-----------|----------------------------------------------------------------------------------------|------------------------------------------------|--|
| STATION NAME           | UNIT NO. | STATION TYPE | REGION | STATE         | ORGANIZATION/UTILITY | CAPACITY | From_Date | To_Date   | Outage_Reason                                                                          | Remarks                                        |  |
| SINGRAULI STPS         | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 200      | 1/Jul/26  | 15/Aug/26 | Boiler + Turbine + Gen (Stator trunnion stud replacement) + Turbine RLA                |                                                |  |
| SINGRAULI STPS         | 2        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 200      | 1/Sep/26  | 15/Oct/26 | Boiler+Gen + Turbine + Turbine RLA                                                     |                                                |  |
| SINGRAULI STPS         | 4        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 200      | 15/Dec/26 | 8/Jan/27  | Boiler+TG Brq Inspection+ TG Valves+ Gov system                                        |                                                |  |
| SINGRAULI STPS         | 7        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 500      | 16/Oct/26 | 14/Nov/26 | Boiler+TG Brq Inspection+LPT (PAUT)+ TG Valves                                         |                                                |  |
| RIHAND-I STPS          | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 500      | 1/Oct/26  | 24/Nov/26 | Boiler +Turbine (all 4 modules)+Gen                                                    |                                                |  |
| RIHAND-II STPS         | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 500      | 10/Mar/26 | 10/Apr/26 | Boiler +LPT (LSB replacement with de-tunned) + TG Bearing & Valves                     |                                                |  |
| RIHAND-III STPS        | 2        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 500      | 7/Feb/27  | 8/Mar/27  | Boiler + Boiler RLA + LPT (Rotor replacement)                                          |                                                |  |
| UNCHAHAR-I TPS         | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 210      | 25/Nov/26 | 29/Dec/26 | Boiler+TG Brq & Valves Inspection + LPT + Gen (Bearing pedestal no. 4 & 5 re-grouting) |                                                |  |
| UNCHAHAR-II TPS        | 2        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 210      | 1/Aug/26  | 30/Aug/26 | Boiler+LPT + Gen+TG Brq & valves Inspection                                            |                                                |  |
| UNCHAHAR-III TPS       | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 210      | 1/Mar/27  | 10/Apr/27 | Boiler+Turbine +Turbine RLA                                                            |                                                |  |
| TANDA STAGE-2 TPS      | 1        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 660      | 18/Dec/26 | 15/Feb/27 | Boiler+Turbine                                                                         |                                                |  |
| DADRI-I (NCTPP)        | 3        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 210      | 26/Sep/26 | 30/Oct/26 | Boiler+LPT+Gen + TG valves                                                             |                                                |  |
| DADRI-I (NCTPP)        | 4        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 210      | 1/Feb/27  | 7/Mar/27  | Boiler+LPT + Gen+ TG Valves                                                            |                                                |  |
| DADRI-II (NCTPP)       | 6        | THERMAL      | NR     | UTTAR PRADESH | NTPC                 | 490      | 21/Nov/26 | 20/Dec/26 | Boiler + TG BEARINGS & + TG Valves+GCB                                                 |                                                |  |
| IGSTPP Jhajjar         | 1        | THERMAL      | NR     | HARYANA       | APCPL                | 500      | 15-Feb-27 | 17-Mar-27 | Overhauling                                                                            |                                                |  |
| IGSTPP Jhajjar         | 2        | THERMAL      | NR     | HARYANA       | APCPL                | 500      | 1-Dec-26  | 7-Dec-26  | BLR                                                                                    |                                                |  |
| IGSTPP Jhajjar         | 3        | THERMAL      | NR     | HARYANA       | APCPL                | 500      | 12-Mar-27 | 18-Mar-27 | BLR                                                                                    |                                                |  |
| ANPARA TPS             | 2        | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 210      | 5/Jan/27  | 3/Feb/27  | Annual Overhauling                                                                     |                                                |  |
| ANPARA TPS             | 4        | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 210      | 12/Nov/26 | 26/Dec/26 | Annual Overhauling                                                                     |                                                |  |
| OBRA TPS               | 10       | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 200      | 12/Nov/26 | 11/Dec/26 | Annual Overhauling                                                                     |                                                |  |
| OBRA TPS               | 11       | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 200      | 30/Jan/27 | 15/Mar/27 | Capital Overhauling                                                                    |                                                |  |
| HARDUAGANJ TPS         | 8        | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 250      | 21/Oct/26 | 19/Nov/26 | Annual Overhauling                                                                     |                                                |  |
| HARDUAGANJ EXT-II TPS  | 10       | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 660      | 1/Dec/26  | 20/Feb/27 | 1st Inspection and Capital Overhauling                                                 |                                                |  |
| PARICHHA TPS           | 4        | THERMAL      | NR     | UTTAR PRADESH | UPRVUNL              | 210      | 30/Jan/27 | 28/Feb/27 | Annual Overhauling                                                                     |                                                |  |
| GHTPS (LEHRA MOHBBAT)  | 1        | THERMAL      | NR     | PUNJAB        | PSPCL                | 210      | 1/Mar/27  | 31/Mar/27 | Annual Overhauling                                                                     | Capital Overhauling continued till 14-04-2027' |  |
| GGSSTP ROPAR           | 3        | THERMAL      | NR     | PUNJAB        | PSPCL                | 210      | 1/Nov/26  | 15/Dec/26 | Capital Overhauling                                                                    |                                                |  |
| GGSSTP ROPAR           | 4        | THERMAL      | NR     | PUNJAB        | PSPCL                | 210      | 22/Dec/26 | 20/Jan/27 | Capital Overhauling                                                                    |                                                |  |
| GGSSTP ROPAR           | 6        | THERMAL      | NR     | PUNJAB        | PSPCL                | 210      | 1/Feb/27  | 17/Mar/27 | Capital Overhauling                                                                    |                                                |  |
| GURU AMARDASS TPP      | 1        | THERMAL      | NR     | PUNJAB        | PSPCL                | 270      | 1/Jan/27  | 31/Jan/27 | Annual Overhaul                                                                        |                                                |  |
| GURU AMARDASS TPP      | 2        | THERMAL      | NR     | PUNJAB        | PSPCL                | 270      | 15/Feb/27 | 16/Mar/27 | Annual Overhaul                                                                        |                                                |  |
| PANIPAT TPS            | 7        | THERMAL      | NR     | HARYANA       | HPGCL                | 250      | 16/Sep/26 | 24/Nov/26 | Capital Overhauling                                                                    |                                                |  |
| PANIPAT TPS            | 8        | THERMAL      | NR     | HARYANA       | HPGCL                | 250      | 5/Oct/26  | 29/Oct/26 | Annual Overhauling                                                                     |                                                |  |
| DCR TPS YAMUNA NAGAR   | 1        | THERMAL      | NR     | HARYANA       | HPGCL                | 300      | 25/Nov/26 | 28/Dec/26 | Annual Overhauling                                                                     |                                                |  |
| DCR TPS YAMUNA NAGAR   | 2        | THERMAL      | NR     | HARYANA       | HPGCL                | 300      | 16/Feb/26 | 1/May/26  | Capital Overhauling                                                                    |                                                |  |
| RAJIV GANDHI TPS HISAR | 1        | THERMAL      | NR     | HARYANA       | HPGCL                | 600      | 16/Jan/27 | 31/Mar/27 | Capital Overhauling                                                                    |                                                |  |
| RAJIV GANDHI TPS HISAR | 2        | THERMAL      | NR     | HARYANA       | HPGCL                | 600      | 20/Mar/26 | 13/May/26 | Capital Overhauling                                                                    |                                                |  |
| SSTPS SURATGARH        | 6        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 1/Sep/26  | 25/Sep/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| SSTPS SURATGARH        | 4        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 7/Jul/26  | 31/Jul/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| SSTPS SURATGARH        | 2        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 1/Jul/26  | 25/Jul/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| SSTPS SURATGARH        | 3        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 10/Sep/26 | 4/Oct/26  | Annual Boiler Overhaul                                                                 |                                                |  |
| SSTPS SURATGARH        | 5        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 1/Apr/26  | 25/Apr/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| SSTPS SURATGARH        | 1        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 250      | 1/May/26  | 14/Jun/26 | Annual Boiler Overhaul + C&I system Upgradation                                        |                                                |  |
| SSCTPP SURATGARH       | 7        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 660      | 16/Jul/26 | 3/Sep/26  | Capital Overhaul of Turbine                                                            |                                                |  |
| SSCTPP SURATGARH       | 8        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 660      | 15/Oct/26 | 13/Nov/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| KOTA TPS (KSTPS)       | 1        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 210      | 1/Aug/26  | 25/Aug/26 | Annual Boiler Overhaul                                                                 |                                                |  |
| KOTA TPS (KSTPS)       | 2        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 210      | 16/Aug/26 | 9/Sep/26  | Annual Boiler Overhaul                                                                 |                                                |  |
| KOTA TPS (KSTPS)       | 3        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 210      | 16/Jul/26 | 9/Aug/26  | Annual Overhaul of Turbine (Replacement of LPT Blades)                                 |                                                |  |
| KOTA TPS (KSTPS)       | 4        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 210      | 15/Jun/26 | 3/Aug/26  | Capital Overhaul of Turbine (Replacement of LPT Blades)                                |                                                |  |
| KOTA TPS (KSTPS)       | 5        | THERMAL      | NR     | RAJASTHAN     | RVUNL                | 210      | 6/Sep/26  | 30/Sep/26 | Annual Boiler Overhaul                                                                 |                                                |  |

|                                  |   |         |    |               |                            |     |           |           |                                              |                                                                        |
|----------------------------------|---|---------|----|---------------|----------------------------|-----|-----------|-----------|----------------------------------------------|------------------------------------------------------------------------|
| KOTA TPS (KSTPS)                 | 7 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 195 | 1/Jul/26  | 25/Jul/26 | Annual Boiler Overhaul                       |                                                                        |
| KOTA TPS (KSTPS)                 | 6 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 195 | 1/Sep/26  | 20/Oct/26 | Strengthen of Boiler tubes                   |                                                                        |
| KALISINDH TPS (KATPP)            | 1 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 600 | 1/May/26  | 19/Jun/26 | Replacement of Economiser Boiler Tube Panels |                                                                        |
| KALISINDH TPS (KATPP)            | 2 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 600 | 1/Mar/27  | 30/Mar/27 | Annual Boiler Overhaul                       |                                                                        |
| CTPP CHHABRA                     | 4 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 250 | 22/Aug/26 | 15/Sep/26 | Annual Boiler Overhaul                       |                                                                        |
| CTPP CHHABRA                     | 2 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 250 | 1/Jun/26  | 20/Jul/26 | Capital Overhaul of Turbine                  |                                                                        |
| CTPP CHHABRA                     | 1 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 250 | 16/Jul/26 | 9/Aug/26  | Annual Boiler Overhaul                       |                                                                        |
| CTPP CHHABRA                     | 3 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 250 | 26/Sep/26 | 20/Oct/26 | Annual Boiler Overhaul                       |                                                                        |
| CSCTPP CHHABRA                   | 5 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 660 | 26/Sep/26 | 25/Oct/26 | Annual Boiler Overhaul                       |                                                                        |
| CSCTPP CHHABRA                   | 6 | THERMAL | NR | RAJASTHAN     | RVUNL                      | 660 | 1/Aug/26  | 30/Aug/26 | Annual Boiler Overhaul                       |                                                                        |
| KHURJA TPP                       | 1 | THERMAL | NR | UTTAR PRADESH | THDC                       | 660 | 30-Jan-27 | 28-Feb-27 | Annual maintenance                           |                                                                        |
| KAWAI TPS (ADANI POWER)          | 2 | THERMAL | NR | RAJASTHAN     | ADANI POWER LIMITED        | 660 | 1-Aug-26  | 25-Aug-26 | AOH HIP, Boiler Licence renewal              |                                                                        |
| NABHA POWER LTD RAJPURA          | 1 | THERMAL | NR | PUNJAB        | Nabha Power Limited        | 700 | 15/Feb/27 | 7/Mar/27  | Annual Overhauling                           |                                                                        |
| NABHA POWER LTD RAJPURA          | 2 | THERMAL | NR | PUNJAB        | Nabha Power Limited        | 700 | 16/Nov/26 | 6/Dec/26  | Annual Overhauling                           |                                                                        |
| TALWANDI SABO TPP                | 1 | THERMAL | NR | PUNJAB        | Vedanta Limited            | 660 | 1/Nov/26  | 15/Dec/26 | Annual Overhauling                           |                                                                        |
| TALWANDI SABO TPP                | 2 | THERMAL | NR | PUNJAB        | Vedanta Limited            | 660 | 13/Feb/27 | 30/Mar/27 | Annual Overhauling                           |                                                                        |
| MAHATMA GANDHI TPS (CLP JHAJJAR) | 1 | THERMAL | NR | HARYANA       | JHAJJAR POWER LIMITED      | 660 | 1/Mar/26  | 7/Apr/26  | Planned Overhaul                             | Outage is tentatively starting from 1st March'26 onwards in FY 2025-26 |
| BARA TPP (PRAYAGRAJ)             | 2 | THERMAL | NR | UTTAR PRADESH | PPGCL                      | 660 | 20/Nov/26 | 22/Dec/26 | Annual Overhauling                           |                                                                        |
| ANPARA C TPS (LANCO)             | 1 | THERMAL | NR | UTTAR PRADESH | MEIL Anpara Energy Limited | 600 | 30/Oct/26 | 8/Dec/26  | Annual Overhauling                           |                                                                        |
| ROSA TPP Ph-I                    | 4 | THERMAL | NR | UTTAR PRADESH | Reliance Power             | 300 | 15-Nov-26 | 14-Dec-26 | Boiler Capital Overhaul                      |                                                                        |

|                         |      |         |    |               |                             |       |           |           |                                                                                                                                                                                                                                   |  |
|-------------------------|------|---------|----|---------------|-----------------------------|-------|-----------|-----------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| ROSA TPP Ph-I           | 2    | THERMAL | NR | UTTAR PRADESH | Reliance Power              | 300   | 16-Feb-27 | 25-Feb-27 | Boiler Mini Overhaul                                                                                                                                                                                                              |  |
| GHATAMPUR TPP           | 1    | THERMAL | NR | UTTAR PRADESH | NLC+UPRVUNL                 | 660   | 27-Aug-26 | 30-Aug-26 | Boiler Licence renewal, furnace inspection and cleaning, RAPH washing, Cen rotor threadout, Gen slip ring inspection, turbine bearing inspection, turbine governor valve stroke checking and other major works to be carried out. |  |
| GHATAMPUR TPP           | 1    | THERMAL | NR | UTTAR PRADESH | NLC+UPRVUNL                 | 660   | 22-Dec-26 | 20-Jan-27 | Boiler Licence renewal, furnace inspection and cleaning, RAPH washing, Cen rotor threadout, Gen slip ring inspection, turbine bearing inspection, turbine governor valve stroke checking and other major works to be carried out. |  |
| MEJA STPP               | 1    | THERMAL | NR | UTTAR PRADESH | NLC+UPRVUNL                 | 660   | 1-Oct-26  | 4-Nov-26  | Overhauling of Boiler, Turbine, Turbine Stop valves and Control Valves                                                                                                                                                            |  |
| BARSINGSAR LIGNITE      | 1    | THERMAL | NR | RAJASTHAN     | NLC                         | 125   | 1/Oct/26  | 30/Oct/26 | Annual Routine Maintenance                                                                                                                                                                                                        |  |
| BARSINGSAR LIGNITE      | 2    | THERMAL | NR | RAJASTHAN     | NLC                         | 125   | 1/May/26  | 30/May/26 | Annual Routine Maintenance                                                                                                                                                                                                        |  |
| KHAMBARKHERA TPS        | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 1-Aug-26  | 5-Aug-26  | Refractory Inspection                                                                                                                                                                                                             |  |
| KHAMBARKHERA TPS        | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 10-Nov-26 | 29-Nov-26 | Annual Overhauling                                                                                                                                                                                                                |  |
| KHAMBARKHERA TPS        | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 5-Aug-26  | 9-Aug-26  | Refractory Inspection                                                                                                                                                                                                             |  |
| KHAMBARKHERA TPS        | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 19-Nov-26 | 8-Dec-26  | Annual Overhauling                                                                                                                                                                                                                |  |
| LALITPUR TPS            | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 660   | 15/Nov/26 | 24/Nov/26 | Boiler Licence renewal                                                                                                                                                                                                            |  |
| LALITPUR TPS            | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 660   | 15/Feb/27 | 16/Mar/27 | Annual Overhauling                                                                                                                                                                                                                |  |
| LALITPUR TPS            | 3    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 660   | 5/Jan/27  | 3/Feb/27  | Annual Overhauling                                                                                                                                                                                                                |  |
| BARKHERA TPS            | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 9/Aug/26  | 13/Aug/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| BARKHERA TPS            | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 15/Nov/26 | 4/Dec/26  | Annual Overhauling                                                                                                                                                                                                                |  |
| BARKHERA TPS            | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 13/Aug/26 | 17/Aug/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| BARKHERA TPS            | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 24/Nov/26 | 13/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| MAQSODDPUR TPS          | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 17/Aug/26 | 21/Aug/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| MAQSODDPUR TPS          | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 20/Nov/26 | 9/Dec/26  | Annual Overhauling                                                                                                                                                                                                                |  |
| MAQSODDPUR TPS          | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 21/Aug/26 | 25/Aug/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| MAQSODDPUR TPS          | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 29/Nov/26 | 18/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| KUNDARKI TPS            | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 25/Aug/26 | 29/Aug/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| KUNDARKI TPS            | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 25/Nov/26 | 14/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| KUNDARKI TPS            | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 29/Aug/26 | 2/Sep/26  | Refractory Inspection                                                                                                                                                                                                             |  |
| KUNDARKI TPS            | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 4/Dec/26  | 23/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| UTRAULA TPS             | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 2/Sep/26  | 6/Sep/26  | Refractory Inspection                                                                                                                                                                                                             |  |
| UTRAULA TPS             | 1    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 30/Nov/26 | 19/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| UTRAULA TPS             | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 6/Sep/26  | 10/Sep/26 | Refractory Inspection                                                                                                                                                                                                             |  |
| UTRAULA TPS             | 2    | THERMAL | NR | UTTAR PRADESH | Bajaj Energy Limited        | 45    | 9/Dec/26  | 28/Dec/26 | Annual Overhauling                                                                                                                                                                                                                |  |
| JSW ENERGY (BARMER) TPP | 1    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 6/May/26  | 13/May/26 | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 1    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 23/Jul/26 | 3/Aug/26  | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 1    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 18/Mar/27 | 31/Mar/27 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 2    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 25/Apr/26 | 2/May/26  | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 2    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 22/May/26 | 26/Jun/26 | Capital Overhaul                                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 3    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 19/Aug/26 | 23/Sep/26 | Capital Overhaul                                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 3    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 5/Nov/26  | 12/Nov/26 | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 4    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 5/Aug/26  | 16/Aug/26 | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 4    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 2/Dec/26  | 9/Dec/26  | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 4    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 2/Feb/27  | 15/Feb/27 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 5    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 14/Jul/26 | 21/Jul/26 | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 5    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 26/Sep/26 | 7/Oct/26  | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 5    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 15/Jan/27 | 28/Jan/27 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 6    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 5/Jul/26  | 12/Jul/26 | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 6    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 15/Nov/26 | 28/Nov/26 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 6    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 1/Jan/27  | 12/Jan/27 | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 7    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 12/Apr/26 | 23/Apr/26 | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| JSW ENERGY (BARMER) TPP | 7    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 15/Oct/26 | 28/Oct/26 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 7    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 23/Feb/27 | 2/Mar/27  | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 8    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 1/Apr/26  | 8/Apr/26  | Boiler Licence renewal                                                                                                                                                                                                            |  |
| JSW ENERGY (BARMER) TPP | 8    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 14/Dec/26 | 27/Dec/26 | Refractory maintenance & Boiler Inspection                                                                                                                                                                                        |  |
| JSW ENERGY (BARMER) TPP | 8    | THERMAL | NR | RAJASTHAN     | JSW Energy (Barmer) Limited | 135   | 5/Mar/27  | 16/Mar/27 | Annual Overhaul/ Boiler overhaul                                                                                                                                                                                                  |  |
| ANTA CCPP               | GT-1 | GAS     | NR | RAJASTHAN     | NTPC                        | 88.71 | 9/Sep/26  | 15/Sep/26 | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                                                                        |  |
| ANTA CCPP               | GT-1 | GAS     | NR | RAJASTHAN     | NTPC                        | 88.71 | 1/Mar/27  | 7/Mar/27  | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                                                                        |  |
| ANTA CCPP               | GT-2 | GAS     | NR | RAJASTHAN     | NTPC                        | 88.71 | 29/Aug/26 | 4/Sep/26  | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                                                                        |  |

|                                  |              |     |    |               |                        |         |           |           |                                                                                                                                                                                            |  |
|----------------------------------|--------------|-----|----|---------------|------------------------|---------|-----------|-----------|--------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| ANTA CCGP                        | GT-2         | GAS | NR | RAJASTHAN     | NTPC                   | 88.71   | 18/Feb/27 | 19/Mar/27 | Turbine : Major Inspection (OEM/OES)<br>Generator : Major Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#2 20 days (Capital Addition Budget)              |  |
| ANTA CCGP                        | GT-3         | GAS | NR | RAJASTHAN     | NTPC                   | 88.71   | 28/Jun/26 | 4/Jul/26  | Turbine minor Inspection (by regular Maint - AMC contract)                                                                                                                                 |  |
| ANTA CCGP                        | GT-3         | GAS | NR | RAJASTHAN     | NTPC                   | 88.71   | 18/Dec/26 | 16/Jan/27 | Turbine : Major Inspection (OEM/OES)<br>Generator : Minor Inspection (OEM/OES)<br>WHRB : Hydro External<br>And DDCMIS Upgradation of WHRB#3 20 days (Capital Addition Budget)              |  |
| FARIDABAD CCGT                   | GT-1         | GAS | NR | HARYANA       | NTPC                   | 137.758 | 22/Jul/26 | 26/Jul/26 | Minor Inspection + Boiler Lic Renewal                                                                                                                                                      |  |
| FARIDABAD CCGT                   | GT-1         | GAS | NR | HARYANA       | NTPC                   | 137.758 | 2/Mar/27  | 6/Mar/27  | Minor Inspection                                                                                                                                                                           |  |
| FARIDABAD CCGT                   | GT-2         | GAS | NR | HARYANA       | NTPC                   | 137.758 | 29/Jul/26 | 2/Aug/26  | Minor Inspection + Boiler Lic Renewal                                                                                                                                                      |  |
| FARIDABAD CCGT                   | GT-2         | GAS | NR | HARYANA       | NTPC                   | 137.758 | 23/Mar/27 | 27/Mar/27 | Minor Inspection                                                                                                                                                                           |  |
| FARIDABAD CCGT                   | ST           | GAS | NR | HARYANA       | NTPC                   | 156.08  | 1/Sep/26  | 15/Oct/26 | ST DCS R&M                                                                                                                                                                                 |  |
| AURAIYA CCGP                     | GT-1         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 2/Jul/26  | 16/Jul/26 | Turbine Inspection + Filter Replacement                                                                                                                                                    |  |
| AURAIYA CCGP                     | GT-1         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 2/Feb/27  | 2/Feb/27  | Boiler Licence LP                                                                                                                                                                          |  |
| AURAIYA CCGP                     | GT-2         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 6/Apr/26  | 6/Apr/26  | Boiler Licence                                                                                                                                                                             |  |
| AURAIYA CCGP                     | GT-3         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 25/Jul/26 | 8/Aug/26  | Combustor Inspection + Filter Replacement + Fourth stage Blade Replacement                                                                                                                 |  |
| AURAIYA CCGP                     | GT-3         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 15/Jul/26 | 15/Jul/26 | Boiler Licence HP                                                                                                                                                                          |  |
| AURAIYA CCGP                     | GT-4         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 22/Aug/26 | 5/Sep/26  | Combustor Inspection + Filter Replacement + Fourth stage Blade Replacement                                                                                                                 |  |
| AURAIYA CCGP                     | GT-4         | GAS | NR | UTTAR PRADESH | NTPC                   | 111.19  | 2/Feb/27  | 2/Feb/27  | Boiler Licence                                                                                                                                                                             |  |
| DADRI CCGP                       | GT-1         | GAS | NR | UTTAR PRADESH | NTPC                   | 130.19  | 1/Dec/26  | 7/Dec/26  | M8 Inspection & Boiler License Renewal                                                                                                                                                     |  |
| DADRI CCGP                       | GT-2         | GAS | NR | UTTAR PRADESH | NTPC                   | 130.19  | 17/Feb/27 | 23/Feb/27 | M8 Inspection & Boiler License Renewal                                                                                                                                                     |  |
| DADRI CCGP                       | GT-3         | GAS | NR | UTTAR PRADESH | NTPC                   | 130.19  | 7/Aug/26  | 11/Aug/26 | M4 Inspection                                                                                                                                                                              |  |
| DADRI CCGP                       | GT-4         | GAS | NR | UTTAR PRADESH | NTPC                   | 130.19  | 1/Feb/27  | 5/Feb/27  | M4 Inspection & Boiler License Renewal                                                                                                                                                     |  |
| DADRI CCGP                       | GT-3         | GAS | NR | UTTAR PRADESH | NTPC                   | 130.19  | 26/Dec/26 | 27/Dec/26 | Boiler License renewal                                                                                                                                                                     |  |
| RAMGARH CCGP                     | GT-1         | GAS | NR | RAJASTHAN     | RVUNL                  | 35.5    | 1-Aug-26  | 14-Sep-26 | HGPI of Gas Turbine                                                                                                                                                                        |  |
| GAMA CCGP                        | Module 1 GT  | GAS | NR | UTTARAKHAND   | GAMA INFRAPROP PVT LTD | 71      | 1/Aug/26  | 30/Aug/26 | HGPI Inspection                                                                                                                                                                            |  |
| GAMA CCGP                        | Module 1 STG | GAS | NR | UTTARAKHAND   | GAMA INFRAPROP PVT LTD | 72      | 1/Aug/26  | 15/Aug/26 | Bearing Inspection                                                                                                                                                                         |  |
| GTPS IPGCL                       | GT- 1        | GAS | NR | DELHI         | IPGCL                  | 30      | 1-Apr-26  | 30-Apr-26 | Major Inspection of GT-1                                                                                                                                                                   |  |
| GTPS IPGCL                       | GT- 2        | GAS | NR | DELHI         | IPGCL                  | 30      | 1-Nov-26  | 25-Nov-26 | Hot gas path Inspection of GT-2                                                                                                                                                            |  |
| GTPS IPGCL                       | STG- 1       | GAS | NR | DELHI         | IPGCL                  | 30      | 1-Nov-26  | 30-Nov-26 | Overhauling of STG-1                                                                                                                                                                       |  |
| PPS-III BAWANA                   | GT-1         | GAS | NR | DELHI         | PPCL                   | 216     | 6-Apr-26  | 8-Apr-26  | Boiler Inspection                                                                                                                                                                          |  |
| PPS-III BAWANA                   | GT-2         | GAS | NR | DELHI         | PPCL                   | 216     | 3-Apr-26  | 5-Apr-26  | Boiler Inspection                                                                                                                                                                          |  |
| PPS-III BAWANA                   | GT-3         | GAS | NR | DELHI         | PPCL                   | 216     | 5-Dec-26  | 9-Dec-26  | BI, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                   |  |
| PPS-III BAWANA                   | GT-4         | GAS | NR | DELHI         | PPCL                   | 216     | 9-Oct-26  | 13-Oct-26 | BI, Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                   |  |
| PPS-III BAWANA                   | STG-1        | GAS | NR | DELHI         | PPCL                   | 253.6   | 8-Feb-27  | 4-Mar-27  | Replacement of Diffuser assembly of IPCV#2 , critical valves servicing of HRSGs ,Condenser cleaning ,Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment. |  |
| PPS-III BAWANA                   | STG-2        | GAS | NR | DELHI         | PPCL                   | 253.6   | 21-Mar-27 | 28-Mar-27 | Condenser Cleaning , Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                  |  |
| PPS-III BAWANA                   | GT-1         | GAS | NR | DELHI         | PPCL                   | 216     | 2-Feb-27  | 6-Feb-27  | Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                       |  |
| PPS-III BAWANA                   | GT-2         | GAS | NR | DELHI         | PPCL                   | 216     | 8-Feb-27  | 19-Mar-27 | Transformer Testing & 48 Weekly Preventive Maintenance of various critical equipment                                                                                                       |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-1         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 16-Jul-26 | 18-Jul-26 | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-1         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 16-Oct-26 | 19-Oct-26 | Offline water wash, Boiler inspection                                                                                                                                                      |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-1         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 14/Jan/27 | 17/Jan/27 | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-1         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 17/Apr/27 | 19/Apr/27 | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-2         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 6/Nov/26  | 9/Nov/26  | Offline water wash, Boiler inspection                                                                                                                                                      |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-2         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 7/Feb/27  | 9/Feb/27  | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-2         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 10/May/27 | 12/May/27 | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-2         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 10/Aug/27 | 12/Aug/27 | Offline water wash                                                                                                                                                                         |  |
| KASHIPUR CCGP (SRAVANTHI ENERGY) | GT-3         | GAS | NR | UTTARAKHAND   | SRAVANTHI ENERGY       | 71.5    | 4/Jul/25  | 7/Jul/25  | Offline water wash                                                                                                                                                                         |  |

|                                  |      |         |    |                  |                        |       |           |           |                                                                                                                                                       |  |
|----------------------------------|------|---------|----|------------------|------------------------|-------|-----------|-----------|-------------------------------------------------------------------------------------------------------------------------------------------------------|--|
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-3 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 1/Jul/26  | 4/Jul/26  | Offline water wash                                                                                                                                    |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-3 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 2/Jan/27  | 4/Jan/27  | Offline water wash                                                                                                                                    |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-3 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 14/May/27 | 17/May/27 | Offline water wash, Boiler inspection                                                                                                                 |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 24/Oct/26 | 26/Oct/26 | Offline water wash                                                                                                                                    |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 24/Jan/27 | 26/Jan/27 | Offline water wash                                                                                                                                    |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 26/Apr/27 | 28/Apr/27 | Offline water wash                                                                                                                                    |  |
| KASHIPUR CCPP (SRAVANTHI ENERGY) | GT-4 | GAS     | NR | UTTARAKHAND      | SRAVANTHI ENERGY       | 71.5  | 5/Jun/27  | 8/Jun/27  | Offline water wash, Boiler inspection                                                                                                                 |  |
| RAPS-B                           | 3    | NUCLEAR | NR | RAJASTHAN        | NPCIL                  | 220   | 13-Jul-26 | 21-Aug-26 | Biennial Shutdown                                                                                                                                     |  |
| RAPS-B                           | 4    | NUCLEAR | NR | RAJASTHAN        | NPCIL                  | 220   | 11-Jan-27 | 19-Feb-27 | Biennial Shutdown                                                                                                                                     |  |
| RAPS-C                           | 5    | NUCLEAR | NR | RAJASTHAN        | NPCIL                  | 220   | 16-Feb-27 | 31-Mar-27 | Biennial Shutdown                                                                                                                                     |  |
| RAPS-D                           | 7    | NUCLEAR | NR | RAJASTHAN        | NPCIL                  | 700   | 15-Sep-26 | 30-Oct-26 | Biennial Shutdown                                                                                                                                     |  |
| KOLDAM HPS                       | 1    | HYDRO   | NR | HIMACHAL PRADESH | NTPC                   | 200   | 10/Feb/27 | 17/Feb/27 | Annual Inspection                                                                                                                                     |  |
| KOLDAM HPS                       | 2    | HYDRO   | NR | HIMACHAL PRADESH | NTPC                   | 200   | 23/Jan/27 | 30/Jan/27 | Annual Inspection                                                                                                                                     |  |
| KOLDAM HPS                       | 3    | HYDRO   | NR | HIMACHAL PRADESH | NTPC                   | 200   | 4/Jan/27  | 11/Jan/27 | Annual Inspection                                                                                                                                     |  |
| KOLDAM HPS                       | 4    | HYDRO   | NR | HIMACHAL PRADESH | NTPC                   | 200   | 26/Feb/27 | 5/Mar/27  | Annual Inspection                                                                                                                                     |  |
| SHANAN HPS                       | 1    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 1/Oct/26  | 25/Oct/26 | Annual Maintenance                                                                                                                                    |  |
| SHANAN HPS                       | 2    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 26/Oct/26 | 19/Nov/26 | Annual Maintenance                                                                                                                                    |  |
| SHANAN HPS                       | 3    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 20/Nov/26 | 14/Dec/26 | Annual Maintenance                                                                                                                                    |  |
| SHANAN HPS                       | 4    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 15/Dec/26 | 8/Jan/27  | Annual Maintenance                                                                                                                                    |  |
| SHANAN HPS                       | 5    | HYDRO   | NR | PUNJAB           | PSPCL                  | 50    | 9/Jan/27  | 8/Apr/27  | Annual Maintenance                                                                                                                                    |  |
| RANJIT SAGAR DAM HPS             | 1    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 5/Oct/26  | 3/Nov/26  | Annual Maintenance                                                                                                                                    |  |
| RANJIT SAGAR DAM HPS             | 2    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15.45 | 10/Nov/26 | 9/Dec/26  | Annual Maintenance                                                                                                                                    |  |
| RANJIT SAGAR DAM HPS             | 3    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15    | 14/Dec/26 | 12/Jan/27 | Annual Maintenance                                                                                                                                    |  |
| RANJIT SAGAR DAM HPS             | 4    | HYDRO   | NR | PUNJAB           | PSPCL                  | 15.45 | 18/Jan/27 | 16/Feb/27 | Annual Maintenance                                                                                                                                    |  |
| KOTESHWAR HPS                    | 1    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 100   | 1-May-26  | 30-Jun-26 | Annual maintenance                                                                                                                                    |  |
| KOTESHWAR HPS                    | 2    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 100   | 6-Oct-26  | 5-Nov-26  | Annual maintenance                                                                                                                                    |  |
| KOTESHWAR HPS                    | 3    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 100   | 7-Nov-26  | 6-Dec-26  | Annual maintenance                                                                                                                                    |  |
| KOTESHWAR HPS                    | 4    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 100   | 1-Apr-26  | 30-Apr-26 | Annual maintenance                                                                                                                                    |  |
| TEHRI HPS                        | 1    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 250   | 23-Mar-26 | 16-Apr-26 | Annual maintenance                                                                                                                                    |  |
| TEHRI HPS                        | 2    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 250   | 14-Apr-26 | 13-May-26 | Major maintenance                                                                                                                                     |  |
| TEHRI HPS                        | 3    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 250   | 11-May-26 | 4-Jun-26  | Annual maintenance                                                                                                                                    |  |
| TEHRI HPS                        | 4    | HYDRO   | NR | UTTARAKHAND      | THDC                   | 250   | 2-Jun-26  | 26-Jun-26 | Annual maintenance                                                                                                                                    |  |
| AD HYDRO HEP                     | 1    | HYDRO   | NR | HIMACHAL PRADESH | AD HYDRO Power Limited | 96    | 1-Dec-26  | 25-Dec-26 | Annual Maintenance                                                                                                                                    |  |
| AD HYDRO HEP                     | 2    | HYDRO   | NR | HIMACHAL PRADESH | AD HYDRO Power Limited | 96    | 1-Jan-27  | 25-Jan-27 | Annual Maintenance                                                                                                                                    |  |
| ALAKNANDA HPS                    | 1    | HYDRO   | NR | UTTAR PRADESH    | AHPCL                  | 82.5  | 1/Dec/26  | 31/Dec/26 | Annual maintenance                                                                                                                                    |  |
| ALAKNANDA HPS                    | 2    | HYDRO   | NR | UTTAR PRADESH    | AHPCL                  | 82.5  | 1/Jan/27  | 31/Jan/27 | Annual maintenance                                                                                                                                    |  |
| ALAKNANDA HPS                    | 3    | HYDRO   | NR | UTTAR PRADESH    | AHPCL                  | 82.5  | 1/Feb/27  | 28/Feb/27 | Annual maintenance                                                                                                                                    |  |
| ALAKNANDA HPS                    | 4    | HYDRO   | NR | UTTAR PRADESH    | AHPCL                  | 82.5  | 1/Mar/27  | 31/Mar/27 | Annual maintenance                                                                                                                                    |  |
| GANGUWAL HPS                     | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 27.99 | 2-Nov-26  | 16-Nov-26 | Annual Maintenance                                                                                                                                    |  |
| GANGUWAL HPS                     | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 27.99 | 1-Apr-26  | 6-Apr-26  | Half yearly Maintenance                                                                                                                               |  |
| GANGUWAL HPS                     | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 27.99 | 1-Jul-26  | 4-Jul-26  | Quarterly Maintenance                                                                                                                                 |  |
| GANGUWAL HPS                     | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 17-Nov-26 | 1-Dec-26  | Annual Maintenance                                                                                                                                    |  |
| GANGUWAL HPS                     | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 7-Apr-26  | 12-Apr-26 | Half yearly Maintenance                                                                                                                               |  |
| GANGUWAL HPS                     | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 7-Apr-26  | 12-Apr-26 | Quarterly Maintenance                                                                                                                                 |  |
| GANGUWAL HPS                     | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 2-Dec-26  | 16-Dec-26 | Annual Maintenance                                                                                                                                    |  |
| GANGUWAL HPS                     | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 13-Apr-26 | 18-Apr-26 | Half yearly Maintenance                                                                                                                               |  |
| GANGUWAL HPS                     | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 9-Jul-26  | 12-Jul-26 | Quarterly Maintenance                                                                                                                                 |  |
| KOTLA HPS                        | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 28.94 | 2-Nov-26  | 16-Nov-26 | Annual Maintenance                                                                                                                                    |  |
| KOTLA HPS                        | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 28.94 | 1-Apr-26  | 6-Apr-26  | Half yearly Maintenance                                                                                                                               |  |
| KOTLA HPS                        | 1    | HYDRO   | NR | PUNJAB           | BBMB                   | 28.94 | 1-Jul-26  | 4-Jul-26  | Quarterly Maintenance                                                                                                                                 |  |
| KOTLA HPS                        | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 17-Nov-26 | 1-Dec-26  | Annual Maintenance                                                                                                                                    |  |
| KOTLA HPS                        | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 7-Apr-26  | 12-Apr-26 | Half yearly Maintenance                                                                                                                               |  |
| KOTLA HPS                        | 2    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 5-Jul-26  | 8-Jul-26  | Quarterly Maintenance                                                                                                                                 |  |
| KOTLA HPS                        | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 2-Dec-26  | 16-Dec-26 | Annual Maintenance                                                                                                                                    |  |
| KOTLA HPS                        | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 13-Apr-26 | 18-Apr-26 | Half yearly Maintenance                                                                                                                               |  |
| KOTLA HPS                        | 3    | HYDRO   | NR | PUNJAB           | BBMB                   | 24.2  | 9-Jul-26  | 12-Jul-26 | Quarterly Maintenance                                                                                                                                 |  |
| BHAKRA LEFT & RIGHT HPS          | L-1  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 1-Oct-26  | 22-Oct-26 | Annual Maintenance                                                                                                                                    |  |
| BHAKRA LEFT & RIGHT HPS          | L-2  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 26-Oct-26 | 16-Nov-26 | Annual Maintenance                                                                                                                                    |  |
| BHAKRA LEFT & RIGHT HPS          | L-2  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 18-Jan-27 | 16-Feb-27 | Capital Mtc. of PSHG by Irrigation Wing & Gate hoist & its control by PW.                                                                             |  |
| BHAKRA LEFT & RIGHT HPS          | L-3  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 21-Sep-26 | 30-May-27 | Replacement of Generator Shaft, Rotor Spider, Rim and other components by carrying out dismantlement, assembly, testing and commissioning of the Unit |  |
| BHAKRA LEFT & RIGHT HPS          | L-4  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 21-Dec-26 | 11-Jan-27 | Annual Maintenance                                                                                                                                    |  |
| BHAKRA LEFT & RIGHT HPS          | L-5  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 126   | 23-Nov-26 | 14-Dec-26 | Annual Maintenance                                                                                                                                    |  |
| BHAKRA LEFT & RIGHT HPS          | R-1  | HYDRO   | NR | HIMACHAL PRADESH | BBMB                   | 157   | 1-Oct-26  | 20-Oct-26 | Annual Maintenance                                                                                                                                    |  |



|                         |     |       |    |                  |                                      |      |           |           |                            |  |
|-------------------------|-----|-------|----|------------------|--------------------------------------|------|-----------|-----------|----------------------------|--|
| BHAKRA LEFT & RIGHT HPS | R-2 | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 157  | 25-Oct-26 | 13-Nov-26 | Annual Maintenance         |  |
| BHAKRA LEFT & RIGHT HPS | R-3 | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 157  | 20-Nov-26 | 9-Dec-26  | Annual Maintenance         |  |
| BHAKRA LEFT & RIGHT HPS | R-4 | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 157  | 10-Dec-26 | 29-Dec-26 | Annual Maintenance         |  |
| BHAKRA LEFT & RIGHT HPS | R-5 | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 157  | 3-Jan-27  | 22-Jan-27 | Annual Maintenance         |  |
| DEHAR HPS               | 1   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 1-Oct-26  | 30-Dec-26 | Capital Maintenance        |  |
| DEHAR HPS               | 2   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 2-Jan-27  | 1-Feb-27  | Annual Maintenance         |  |
| DEHAR HPS               | 3   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 1-Nov-26  | 1-Dec-26  | Annual Maintenance         |  |
| DEHAR HPS               | 4   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 2-Dec-26  | 1-Jan-27  | Annual Maintenance         |  |
| DEHAR HPS               | 5   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 2-Feb-27  | 4-Mar-27  | Annual Maintenance         |  |
| DEHAR HPS               | 6   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 165  | 5-Mar-27  | 4-Apr-27  | Annual Maintenance         |  |
| PONG HPS                | 1   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 2-Nov-26  | 16-Nov-26 | Annual Maintenance         |  |
| PONG HPS                | 2   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 18-Nov-26 | 2-Dec-26  | Annual Maintenance         |  |
| PONG HPS                | 3   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 3-Dec-26  | 17-Dec-26 | Annual Maintenance         |  |
| PONG HPS                | 4   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 19-Dec-26 | 2-Jan-27  | Annual Maintenance         |  |
| PONG HPS                | 5   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 4-Jan-27  | 18-Jan-27 | Annual Maintenance         |  |
| PONG HPS                | 6   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 20-Jan-27 | 3-Feb-27  | Annual Maintenance         |  |
| PONG HPS                | 1   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 4-May-26  | 11-May-26 | Half Yearly Maintenance    |  |
| PONG HPS                | 2   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 12-May-26 | 18-May-26 | Half Yearly Maintenance    |  |
| PONG HPS                | 3   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 19-May-26 | 25-May-26 | Half Yearly Maintenance    |  |
| PONG HPS                | 4   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 26-May-26 | 1-Jun-26  | Half Yearly Maintenance    |  |
| PONG HPS                | 5   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 2-Jun-26  | 8-Jun-26  | Half Yearly Maintenance    |  |
| PONG HPS                | 6   | HYDRO | NR | HIMACHAL PRADESH | BBMB                                 | 66   | 9-Jun-26  | 15-Jun-26 | Half Yearly Maintenance    |  |
| MALANA-II HPS           | 1   | HYDRO | NR | HIMACHAL PRADESH | Everest Power Pvt. Ltd.              | 50   | 1/Dec/26  | 15/Dec/26 | Annual maintenance         |  |
| MALANA-II HPS           | 2   | HYDRO | NR | HIMACHAL PRADESH | Everest Power Pvt. Ltd.              | 50   | 16/Dec/26 | 26/Dec/26 | Annual maintenance         |  |
| BAJOLI HOLI             | 1   | HYDRO | NR | HIMACHAL PRADESH | GBHHPL                               | 60   | 5-Oct-25  | 30-Oct-25 | Annual Maintenance         |  |
| BAJOLI HOLI             | 2   | HYDRO | NR | HIMACHAL PRADESH | GBHHPL                               | 60   | 10-Nov-25 | 10-Dec-25 | Annual Maintenance         |  |
| BAJOLI HOLI             | 3   | HYDRO | NR | HIMACHAL PRADESH | GBHHPL                               | 60   | 20-Dec-25 | 19-Jan-26 | Annual Maintenance         |  |
| BUDHIL HPS              | 1   | HYDRO | NR | HIMACHAL PRADESH | Greenko Budhil Hydro Power Pvt. Ltd. | 35   | 1/Dec/26  | 30/Dec/26 | Annual maintenance         |  |
| BUDHIL HPS              | 2   | HYDRO | NR | HIMACHAL PRADESH | Greenko Budhil Hydro Power Pvt. Ltd. | 35   | 1/Jan/27  | 30/Jan/27 | Annual maintenance         |  |
| KASHANG INTEGRATED HEP  | 1   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 65   | 1/Nov/26  | 30/Nov/26 | Annual maintenance         |  |
| KASHANG INTEGRATED HEP  | 2   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 65   | 1/Dec/26  | 31/Dec/26 | Annual maintenance         |  |
| KASHANG INTEGRATED HEP  | 3   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 65   | 1/Jan/27  | 31/Jan/27 | Annual maintenance         |  |
| SAWRA KUDDU HEP         | 1   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 37   | 15-Dec-26 | 30-Dec-26 | Annual Maintenance         |  |
| SAWRA KUDDU HEP         | 2   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 37   | 30-Dec-26 | 15-Jan-27 | Annual Maintenance         |  |
| SAWRA KUDDU HEP         | 3   | HYDRO | NR | HIMACHAL PRADESH | HPPCL                                | 37   | 15-Jan-27 | 30-Jan-27 | Annual Maintenance         |  |
| LARJI HPS               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 42   | 15/Oct/26 | 28/Nov/26 | Annual Maintenance         |  |
| LARJI HPS               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 42   | 29/Nov/26 | 12/Jan/27 | Annual Maintenance         |  |
| LARJI HPS               | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 42   | 13/Jan/27 | 26/Feb/27 | Annual Maintenance         |  |
| SANJAY HPS (BHABA)      | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 40   | 25/Feb/26 | 30/Apr/26 | Annual Maintenance         |  |
| SANJAY HPS (BHABA)      | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 40   | 25/Dec/25 | 23/Feb/26 | Annual Maintenance         |  |
| SANJAY HPS (BHABA)      | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 40   | 25/Oct/25 | 24/Dec/26 | Annual Maintenance         |  |
| BASSI HPS               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 16.5 | 15/Oct/26 | 30/Nov/26 | Annual Maintenance         |  |
| BASSI HPS               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 16.5 | 15/Nov/26 | 27/Dec/26 | Annual Maintenance         |  |
| BASSI HPS               | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 16.5 | 6/Jan/27  | 13/Feb/27 | Annual Maintenance         |  |
| BASSI HPS               | 4   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 16.5 | 23/Jan/27 | 5/Mar/27  | Annual Maintenance         |  |
| UHL-III HPS             | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 33.3 | 15/Oct/26 | 30/Nov/26 | Annual planned maintenance |  |
| UHL-III HPS             | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 33.3 | 1/Dec/26  | 14/Jan/27 | Annual planned maintenance |  |
| UHL-III HPS             | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 33.3 | 15/Jan/27 | 28/Feb/27 | Annual planned maintenance |  |
| GIRI BATA HPS           | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 30   | 1/Jan/27  | 15/Feb/27 | Annual Maintenance         |  |
| GIRI BATA HPS           | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 30   | 15/Apr/26 | 30/May/26 | Annual Maintenance         |  |
| BANER HEP               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 2/Nov/26  | 24/Nov/26 | Annual Maintenance         |  |
| BANER HEP               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 30/Nov/26 | 22/Dec/26 | Annual Maintenance         |  |
| BANER HEP               | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 28/Dec/26 | 18/Jan/27 | Annual Maintenance         |  |
| BANER HEP               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 28/Jan/27 | 2/Feb/27  | Annual Planned Shutdown    |  |
| BANER HEP               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 28/Jan/27 | 2/Feb/27  | Annual Planned Shutdown    |  |
| BANER HEP               | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 4    | 28/Jan/27 | 2/Feb/27  | Annual Planned Shutdown    |  |
| KHAULI HEP              | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 6    | 16/Nov/26 | 30/Dec/26 | Annual Maintenance         |  |
| KHAULI HEP              | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 6    | 31/Dec/26 | 23/Feb/27 | Annual Maintenance         |  |
| GAJ HEP                 | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 13/Oct/26 | 10/Nov/26 | Annual Maintenance         |  |
| GAJ HEP                 | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 11/Nov/26 | 5/Dec/26  | Annual Maintenance         |  |
| GAJ HEP                 | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 6/Dec/26  | 6/Jan/27  | Annual Maintenance         |  |
| GAJ HEP                 | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 8/Jan/27  | 10/Jan/27 | Annual Maintenance         |  |
| GAJ HEP                 | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 8/Jan/27  | 10/Jan/27 | Annual Maintenance         |  |
| GAJ HEP                 | 3   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3.5  | 8/Jan/27  | 10/Jan/27 | Annual Maintenance         |  |
| BINWA HEP               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3    | 1/Nov/26  | 15/Dec/26 | Annual Maintenance         |  |
| BINWA HEP               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3    | 16/Dec/26 | 30/Jan/27 | Annual Maintenance         |  |
| BINWA HEP               | 1   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3    | 1/Feb/27  | 4/Feb/27  | Annual Planned shutdown    |  |
| BINWA HEP               | 2   | HYDRO | NR | HIMACHAL PRADESH | HPSEBL                               | 3    | 1/Feb/27  | 4/Feb/27  | Annual Planned shutdown    |  |
| CHANJU HPS              | 1   | HYDRO | NR | HIMACHAL PRADESH | IA Energy                            | 12   | 1/Oct/26  | 31/Oct/26 | Annual Maintenance         |  |

|                     |      |       |    |                  |                              |        |           |           |                                                                 |  |
|---------------------|------|-------|----|------------------|------------------------------|--------|-----------|-----------|-----------------------------------------------------------------|--|
| CHANJU HPS          | 2    | HYDRO | NR | HIMACHAL PRADESH | IA Energy                    | 12     | 1/Nov/26  | 1/Dec/26  | Annual Maintenance                                              |  |
| CHANJU HPS          | 3    | HYDRO | NR | HIMACHAL PRADESH | IA Energy                    | 12     | 2/Dec/26  | 1/Jan/27  | Annual Maintenance                                              |  |
| BAGLIHAR HPS        | 1    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 20/Nov/26 | 14/Dec/26 | Annual Maintenance                                              |  |
| BAGLIHAR HPS        | 2    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 16/Dec/26 | 9/Jan/27  | Annual Maintenance                                              |  |
| BAGLIHAR HPS        | 3    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 11/Jan/27 | 4/Feb/27  | Annual Maintenance                                              |  |
| BAGLIHAR II HPS     | 1    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 3/Nov/26  | 27/Nov/26 | Annual Maintenance                                              |  |
| BAGLIHAR II HPS     | 2    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 28/Nov/26 | 22/Dec/26 | Annual Maintenance                                              |  |
| BAGLIHAR II HPS     | 3    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 150    | 23/Dec/26 | 16/Jan/27 | Annual Maintenance                                              |  |
| LOWER JHELUM HPS    | 1    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 35     | 1/Dec/26  | 25/Dec/26 | Annual Maintenance                                              |  |
| LOWER JHELUM HPS    | 2    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 36     | 1/Jan/27  | 25/Jan/27 | Annual Maintenance                                              |  |
| LOWER JHELUM HPS    | 3    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 37     | 1/Feb/27  | 25/Feb/27 | Annual Maintenance                                              |  |
| UPPER SINDH-II HPS  | 3    | HYDRO | NR | JAMMU & KASHMIR  | JKSPDCL                      | 35     | 15/Feb/26 | 15/May/26 | Capital Overhauling                                             |  |
| KARCHAM WANGTOO HPS | 1    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 261.25 | 16-Dec-26 | 30-Dec-26 | Annual Maintenance                                              |  |
| KARCHAM WANGTOO HPS | 2    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 261.25 | 2-Jan-27  | 16-Jan-27 | Annual Maintenance                                              |  |
| KARCHAM WANGTOO HPS | 3    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 261.25 | 1-Feb-27  | 15-Feb-27 | Annual Maintenance                                              |  |
| KARCHAM WANGTOO HPS | 4    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 261.25 | 3-Mar-27  | 17-Mar-27 | Annual Maintenance                                              |  |
| BASPA-II HPS        | 1    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 100    | 15/Jan/27 | 26/Jan/27 | Annual Maintenance                                              |  |
| BASPA-II HPS        | 2    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 100    | 1/Feb/27  | 12/Feb/27 | Annual Maintenance                                              |  |
| BASPA-II HPS        | 3    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 100    | 21/Feb/27 | 4/Mar/27  | Annual Maintenance                                              |  |
| KUTEHR HPS          | 1    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 80     | 18/Jan/27 | 2/Feb/27  | Annual Maintenance                                              |  |
| KUTEHR HPS          | 2    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 80     | 2/Feb/27  | 13/Feb/27 | Annual Maintenance                                              |  |
| KUTEHR HPS          | 3    | HYDRO | NR | HIMACHAL PRADESH | JSW HYDRO ENERGY             | 80     | 14/Feb/27 | 28/Feb/27 | Annual Maintenance                                              |  |
| MALANA HPS          | 1    | HYDRO | NR | HIMACHAL PRADESH | MALANA Power Company Limited | 43     | 1-Jan-27  | 20-Jan-27 | Annual Maintenance                                              |  |
| MALANA HPS          | 2    | HYDRO | NR | HIMACHAL PRADESH | MALANA Power Company Limited | 43     | 1-Feb-27  | 20-Feb-27 | Annual Maintenance                                              |  |
| UPPER NANTI HEPL    | 1    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 1-Oct-26  | 10-Dec-26 | Annual Maintenance of Turbine under water parts                 |  |
| UPPER NANTI HEPL    | 1    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 6-Feb-27  | 8-Feb-27  | Annual maintenance of transmission line                         |  |
| UPPER NANTI HEPL    | 1    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 5-Mar-27  | 5-Mar-27  | Calibration and testing of electrical and mechanical equipment. |  |
| UPPER NANTI HEPL    | 2    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 11-Dec-26 | 20-Feb-27 | Annual Maintenance of Turbine under water parts                 |  |
| UPPER NANTI HEPL    | 2    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 6-Feb-27  | 8-Feb-27  | Annual maintenance of transmission line                         |  |
| UPPER NANTI HEPL    | 2    | HYDRO | NR | HIMACHAL PRADESH | Nanti Hydro Power Pvt Ltd.   | 6.75   | 6-Mar-27  | 6-Mar-27  | Calibration and testing of electrical and mechanical equipment. |  |
| TANAKPUR HPS        | 1    | HYDRO | NR | UTTAR PRADESH    | NHPC                         | 31.4   | 1/Dec/26  | 4/Jan/27  | Annual Maintenance                                              |  |
| TANAKPUR HPS        | 2    | HYDRO | NR | UTTAR PRADESH    | NHPC                         | 31.4   | 8/Jan/27  | 11/Feb/27 | Annual Maintenance                                              |  |
| TANAKPUR HPS        | 3    | HYDRO | NR | UTTAR PRADESH    | NHPC                         | 31.4   | 14/Feb/27 | 20/Mar/27 | Annual Maintenance                                              |  |
| DHAULI GANGA HPS    | 1    | HYDRO | NR | UTTARAKHAND      | NHPC                         | 70     | 1/Dec/26  | 22/Dec/26 | Annual Maintenance                                              |  |
| DHAULI GANGA HPS    | 2    | HYDRO | NR | UTTARAKHAND      | NHPC                         | 70     | 25/Dec/26 | 15/Jan/27 | Annual Maintenance                                              |  |
| DHAULI GANGA HPS    | 3    | HYDRO | NR | UTTARAKHAND      | NHPC                         | 70     | 18/Jan/27 | 8/Feb/27  | Annual Maintenance                                              |  |
| DHAULI GANGA HPS    | 4    | HYDRO | NR | UTTARAKHAND      | NHPC                         | 70     | 11/Feb/27 | 4/Mar/27  | Annual Maintenance                                              |  |
| BAIRA SIUL HPS      | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 60     | 18/Jan/27 | 16/Feb/27 | Annual Maintenance                                              |  |
| BAIRA SIUL HPS      | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 60     | 17/Dec/26 | 15/Jan/27 | Annual Maintenance                                              |  |
| BAIRA SIUL HPS      | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 60     | 15/Nov/26 | 14/Dec/26 | Annual Maintenance                                              |  |
| CHAMERA- I HPS      | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 9/Jan/27  | 29/Jan/27 | Annual Maintenance                                              |  |
| CHAMERA- I HPS      | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 24/Nov/26 | 7/Jan/27  | Annual Maintenance & Stator Replacement                         |  |
| CHAMERA- I HPS      | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 31/Jan/27 | 16/Mar/27 | Annual Maintenance & Stator Replacement                         |  |
| CHAMERA- I HPS      | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 29/Mar/27 | 2/Apr/27  | Complete Shutdown for 25 yearly GIS Annual Maintenance work     |  |
| CHAMERA- I HPS      | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 29/Mar/27 | 2/Apr/27  | Complete Shutdown for 25 yearly GIS Annual Maintenance work     |  |
| CHAMERA- I HPS      | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 180    | 29/Mar/27 | 2/Apr/27  | Complete Shutdown for 25 yearly GIS Annual Maintenance work     |  |
| CHAMERA- II HPS     | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 100    | 4/Dec/26  | 18/Dec/26 | Annual Maintenance                                              |  |
| CHAMERA- II HPS     | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 100    | 16/Nov/26 | 30/Nov/26 | Annual Maintenance                                              |  |
| CHAMERA- II HPS     | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 100    | 22/Dec/26 | 20/Jan/27 | Capital Maintenance                                             |  |
| PARBATI-II HPS      | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 200    | 1/Dec/26  | 21/Dec/26 | Annual Maintenance                                              |  |
| PARBATI-II HPS      | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 200    | 28/Dec/26 | 17/Jan/27 | Annual Maintenance                                              |  |
| PARBATI-II HPS      | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 200    | 20/Jan/27 | 9/Feb/27  | Annual Maintenance                                              |  |
| PARBATI-II HPS      | 4    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 200    | 11/Feb/27 | 3/Mar/27  | Annual Maintenance                                              |  |
| CHAMERA-III HPS     | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 77     | 5/Jan/27  | 19/Jan/27 | Annual Maintenance                                              |  |
| CHAMERA-III HPS     | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 77     | 21/Jan/27 | 4/Feb/27  | Annual Maintenance                                              |  |
| CHAMERA-III HPS     | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 77     | 6/Feb/27  | 2/Mar/27  | Capital Maintenance                                             |  |
| PARBATI-III HPS     | 1    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 130    | 1/Nov/26  | 30/Nov/26 | Annual Maintenance                                              |  |
| PARBATI-III HPS     | 2    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 130    | 1/Dec/26  | 30/Dec/26 | Annual Maintenance                                              |  |
| PARBATI-III HPS     | 3    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 130    | 1/Jan/27  | 30/Jan/27 | Annual Maintenance                                              |  |
| PARBATI-III HPS     | 4    | HYDRO | NR | HIMACHAL PRADESH | NHPC                         | 130    | 3/Feb/27  | 4/Mar/27  | Annual Maintenance                                              |  |
| SALAL ST-1&2 HPS    | I-1  | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 12/Nov/26 | 10/Jan/27 | Capital Maintenance                                             |  |
| SALAL ST-1&2 HPS    | I-2  | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 25/Jan/27 | 13/Feb/27 | Annual Maintenance                                              |  |
| SALAL ST-1&2 HPS    | I-3  | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 15/Feb/27 | 6/Mar/27  | Annual Maintenance                                              |  |
| SALAL ST-1&2 HPS    | II-1 | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 7/Mar/27  | 26/Mar/27 | Annual Maintenance                                              |  |
| SALAL ST-1&2 HPS    | II-2 | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 4/Jan/27  | 23/Jan/27 | Annual Maintenance                                              |  |
| SALAL ST-1&2 HPS    | II-3 | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 115    | 15/Oct/26 | 3/Nov/26  | Annual Maintenance                                              |  |
| URI-I HPS           | 1    | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 120    | 1/Nov/26  | 20/Nov/26 | Annual Maintenance                                              |  |
| URI-I HPS           | 2    | HYDRO | NR | JAMMU KASHMIR    | NHPC                         | 120    | 21/Nov/26 | 10/Dec/26 | Annual Maintenance                                              |  |

|                   |   |       |    |                  |               |       |           |           |                                                                                |  |
|-------------------|---|-------|----|------------------|---------------|-------|-----------|-----------|--------------------------------------------------------------------------------|--|
| URI-I HPS         | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 11/Dec/26 | 10/Jan/27 | Capital Maintenance                                                            |  |
| URI-I HPS         | 4 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 11/Jan/27 | 10/Feb/27 | Capital Maintenance                                                            |  |
| URI-I HPS         | 1 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 1/Nov/26  | 20/Nov/26 | Complete Shutdown including Transmission lines for Upgradation of Station DCS. |  |
| URI-I HPS         | 2 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 1/Nov/26  | 20/Nov/26 | Complete Shutdown including Transmission lines for Upgradation of Station DCS. |  |
| URI-I HPS         | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 1/Nov/26  | 20/Nov/26 | Complete Shutdown including Transmission lines for Upgradation of Station DCS. |  |
| URI-I HPS         | 4 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 120   | 1/Nov/26  | 20/Nov/26 | Complete Shutdown including Transmission lines for Upgradation of Station DCS. |  |
| DULHASTI HPS      | 1 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 130   | 15/Dec/26 | 30/Dec/26 | Annual Maintenance                                                             |  |
| DULHASTI HPS      | 2 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 130   | 2/Jan/27  | 16/Jan/27 | Annual Maintenance                                                             |  |
| DULHASTI HPS      | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 130   | 19/Jan/27 | 1/Feb/27  | Annual Maintenance                                                             |  |
| SEWA-II HPS       | 1 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 40    | 1/Nov/26  | 19/Nov/26 | Annual Maintenance                                                             |  |
| SEWA-II HPS       | 2 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 40    | 21/Nov/26 | 9/Dec/26  | Annual Maintenance                                                             |  |
| SEWA-II HPS       | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 40    | 11/Dec/26 | 29/Dec/26 | Annual Maintenance                                                             |  |
| URI-II HPS        | 1 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 60    | 15/Nov/26 | 14/Dec/26 | Capital Maintenance                                                            |  |
| URI-II HPS        | 2 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 60    | 16/Dec/26 | 4/Jan/27  | Annual Maintenance                                                             |  |
| URI-II HPS        | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 60    | 6/Jan/27  | 25/Jan/27 | Annual Maintenance                                                             |  |
| URI-II HPS        | 4 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 60    | 27/Jan/27 | 15/Feb/27 | Annual Maintenance                                                             |  |
| KISHANGANGA HPS   | 1 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 110   | 30/Jan/27 | 19/Feb/27 | Annual Maintenance                                                             |  |
| KISHANGANGA HPS   | 2 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 110   | 7/Jan/27  | 27/Jan/27 | Annual Maintenance                                                             |  |
| KISHANGANGA HPS   | 3 | HYDRO | NR | JAMMU KASHMIR    | NHPC          | 110   | 15/Dec/26 | 4/Jan/27  | Annual Maintenance                                                             |  |
| NIMMO BAZGO HPS   | 1 | HYDRO | NR | LADAKH           | NHPC          | 15    | 1/Jan/27  | 31/Jan/27 | Annual Maintenance                                                             |  |
| NIMMO BAZGO HPS   | 2 | HYDRO | NR | LADAKH           | NHPC          | 15    | 1/Nov/26  | 30/Nov/26 | Annual Maintenance                                                             |  |
| NIMMO BAZGO HPS   | 3 | HYDRO | NR | LADAKH           | NHPC          | 15    | 1/Dec/26  | 31/Dec/26 | Annual Maintenance                                                             |  |
| CHUTAK HPS        | 1 | HYDRO | NR | LADAKH           | NHPC          | 11    | 1/Nov/26  | 30/Nov/26 | Annual Maintenance                                                             |  |
| CHUTAK HPS        | 2 | HYDRO | NR | LADAKH           | NHPC          | 11    | 1/Dec/26  | 30/Dec/26 | Annual Maintenance                                                             |  |
| CHUTAK HPS        | 3 | HYDRO | NR | LADAKH           | NHPC          | 11    | 31/Dec/26 | 29/Jan/27 | Annual Maintenance                                                             |  |
| CHUTAK HPS        | 4 | HYDRO | NR | LADAKH           | NHPC          | 11    | 30/Jan/27 | 28/Feb/27 | Annual Maintenance                                                             |  |
| Naitwar Mori HEP  | 1 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 12-Jul-26 | 12-Jul-26 | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 1 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 9-Aug-26  | 9-Aug-26  | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 1 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 6-Sep-26  | 6-Sep-26  | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 1 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 11-Oct-26 | 11-Oct-26 | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 1 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 3-Feb-27  | 18-Feb-27 | Project Annual Planned Maintenance                                             |  |
| Naitwar Mori HEP  | 2 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 12-Jul-26 | 12-Jul-26 | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 2 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 9-Aug-26  | 9-Aug-26  | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 2 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 6-Sep-26  | 6-Sep-26  | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 2 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 11-Oct-26 | 11-Oct-26 | Barrage Upstream Flushing for removal of excess Silt/Debris                    |  |
| Naitwar Mori HEP  | 2 | HYDRO | NR | UTTARAKHAND      | SJVN          | 30    | 20-Feb-27 | 6-Mar-27  | Project Annual Planned Maintenance                                             |  |
| NATHPA JHAKRI HPS | 1 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 5-Jan-27  | 14-Jan-27 | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 1 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 22-Jan-27 | 24-Jan-27 | Annual Planned Mtc of ButterFly valve                                          |  |
| NATHPA JHAKRI HPS | 2 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 16-Jan-27 | 25-Jan-27 | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 2 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 11-Jan-27 | 13-Jan-27 | Annual Planned Mtc of ButterFly valve                                          |  |
| NATHPA JHAKRI HPS | 3 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 28-Jan-27 | 6-Feb-27  | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 3 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 14-Feb-27 | 16-Feb-27 | Annual Planned Mtc of ButterFly valve                                          |  |
| NATHPA JHAKRI HPS | 4 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 8-Feb-27  | 17-Feb-27 | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 4 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 3-Feb-27  | 5-Feb-27  | Annual Planned Mtc of ButterFly valve                                          |  |
| NATHPA JHAKRI HPS | 5 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 19-Feb-27 | 28-Feb-27 | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 5 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 8-Mar-27  | 10-Mar-27 | Annual Planned Mtc of ButterFly valve                                          |  |
| NATHPA JHAKRI HPS | 6 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 2-Mar-27  | 11-Mar-27 | Annual Planned Mtc of Generating unit                                          |  |
| NATHPA JHAKRI HPS | 6 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 250   | 25-Feb-27 | 27-Feb-27 | Annual Planned Mtc of ButterFly valve                                          |  |
| RAMPUR HPS        | 1 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 5-Jan-27  | 14-Jan-27 | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 1 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 11-Jan-27 | 13-Jan-27 | Annual Planned Mtc. of MIV# 1 & 2 and PGV#1                                    |  |
| RAMPUR HPS        | 2 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 16-Jan-27 | 25-Jan-27 | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 2 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 11-Jan-27 | 13-Jan-27 | Annual Planned Mtc. of MIV# 1 & 2 and PGV#1                                    |  |
| RAMPUR HPS        | 3 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 28-Jan-27 | 6-Feb-27  | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 3 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 3-Feb-27  | 5-Feb-27  | Annual Planned Mtc. of MIV# 3 & 4 and PGV#2                                    |  |
| RAMPUR HPS        | 4 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 8-Feb-27  | 17-Feb-27 | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 4 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 3-Feb-27  | 5-Feb-27  | Annual Planned Mtc. of MIV# 3 & 4 and PGV#2                                    |  |
| RAMPUR HPS        | 5 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 19-Feb-27 | 28-Feb-27 | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 5 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 25-Feb-27 | 27-Feb-27 | Annual Planned Mtc. of MIV# 5 & 6 and PGV#3                                    |  |
| RAMPUR HPS        | 6 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 2-Mar-27  | 11-Mar-27 | Annual Planned Mtc of Generating Unit                                          |  |
| RAMPUR HPS        | 6 | HYDRO | NR | HIMACHAL PRADESH | SJVN          | 68.67 | 25-Feb-27 | 27-Feb-27 | Annual Planned Mtc. of MIV# 5 & 6 and PGV#3                                    |  |
| TARANDA HEP       | 1 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 1-Oct-26  | 20-Dec-26 | Annual Maintenance of Turbine under water parts                                |  |
| TARANDA HEP       | 1 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 21-Dec-26 | 24-Dec-26 | Annual maintenance of transmission line                                        |  |

|                             |   |       |    |                  |               |       |           |           |                                                   |  |
|-----------------------------|---|-------|----|------------------|---------------|-------|-----------|-----------|---------------------------------------------------|--|
| TARANDA HEP                 | 1 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 15-Jan-27 | 15-Jan-27 | Testing of ODY, TRMP & LRMP electrical equipment. |  |
| TARANDA HEP                 | 2 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 25-Dec-26 | 10-Mar-27 | Annual Maintenance of Turbine under water parts   |  |
| TARANDA HEP                 | 2 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 21-Dec-26 | 24-Dec-26 | Annual maintenance of transmission line           |  |
| TARANDA HEP                 | 2 | HYDRO | NR | HIMACHAL PRADESH | Taranda Hydro | 6.5   | 15-Jan-27 | 15-Jan-27 | Testing of ODY, TRMP & LRMP electrical equipment. |  |
| CHIBRO (YAMUNA) HPS         | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 1/Apr/26  | 11/May/26 | Capital Maintance                                 |  |
| CHIBRO (YAMUNA) HPS         | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 25/Dec/26 | 23/Jan/27 | Annual Maintenance                                |  |
| CHIBRO (YAMUNA) HPS         | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 1/Feb/27  | 2/Mar/27  | Annual Maintenance                                |  |
| CHIBRO (YAMUNA) HPS         | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 15/Oct/26 | 14/Nov/26 | Annual Maintenance                                |  |
| CHIBRO (YAMUNA) HPS         | 4 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 20/Nov/26 | 19/Dec/26 | Annual Maintenance                                |  |
| KHODRI HPS                  | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 1/Apr/26  | 10/Apr/26 | Capital Maintance                                 |  |
| KHODRI HPS                  | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 15/Oct/26 | 13/Nov/26 | Annual Maintenance                                |  |
| KHODRI HPS                  | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 20/Nov/26 | 19/Dec/26 | Annual Maintenance                                |  |
| KHODRI HPS                  | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 25/Dec/26 | 23/Jan/27 | Annual Maintenance                                |  |
| KHODRI HPS                  | 4 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 23/Dec/26 | 31/Mar/27 | Capital Maintance                                 |  |
| DHAKRANI POWER HOUSE        | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 11.25 | 1/Feb/27  | 2/Mar/27  | Annual Maintance                                  |  |
| DHAKRANI POWER HOUSE        | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 11.25 | 2/Jan/27  | 31/Jan/27 | Annual Maintance                                  |  |
| DHAKRANI POWER HOUSE        | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 11.25 | 1/Apr/26  | 5/May/26  | RMU                                               |  |
| DHALIPUR POWER HOUSE        | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 17    | 1/Dec/26  | 31/Dec/26 | Annual Maintenance                                |  |
| DHALIPUR POWER HOUSE        | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 17    | 3/Jan/27  | 2/Feb/27  | Annual Maintenance                                |  |
| DHALIPUR POWER HOUSE        | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 17    | 1/Mar/27  | 31/Mar/27 | Annual Maintenance                                |  |
| KULHAL POWER HOUSE          | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 10    | 7/Nov/26  | 6/Dec/26  | Annual Maintance                                  |  |
| KULHAL POWER HOUSE          | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 10    | 1/Apr/26  | 13/Apr/26 | Capital Maintance                                 |  |
| KULHAL POWER HOUSE          | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 10    | 9/Dec/26  | 7/Jan/27  | Annual Maintance                                  |  |
| MANERI BHALI-I HPS TILOTH   | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 3/Feb/26  | 9/Mar/26  | Annual Maintance                                  |  |
| MANERI BHALI-I HPS TILOTH   | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 30/Dec/26 | 2/Feb/27  | Annual Maintance                                  |  |
| MANERI BHALI-I HPS TILOTH   | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 30    | 3/Feb/27  | 9/Mar/27  | Annual Maintance                                  |  |
| MANERI BHALI-II HPS DHARASU | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 76    | 15/Oct/26 | 13/Dec/26 | Annual Maintance                                  |  |
| MANERI BHALI-II HPS DHARASU | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 76    | 15/Nov/26 | 13/Jan/27 | Annual Maintance                                  |  |
| MANERI BHALI-II HPS DHARASU | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 76    | 1/Jan/27  | 1/Mar/27  | Annual Maintance                                  |  |
| MANERI BHALI-II HPS DHARASU | 4 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 76    | 20/Jan/27 | 20/Mar/27 | Annual Maintance                                  |  |
| CHILLA POWER HOUSE          | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 36    | 10/Nov/26 | 31/Mar/27 | RMU                                               |  |
| CHILLA POWER HOUSE          | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 36    | 10/Nov/26 | 31/Mar/27 | RMU                                               |  |
| CHILLA POWER HOUSE          | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 36    | 1/Apr/26  | 9/Nov/26  | RMU                                               |  |
| CHILLA POWER HOUSE          | 4 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 36    | 27/Dec/26 | 4/Feb/27  | Annual Maintance                                  |  |
| RAMGANGA POWER HOUSE        | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 66    | 1/Jul/26  | 31/Jul/26 | Annual Maintance                                  |  |
| RAMGANGA POWER HOUSE        | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 66    | 1/Aug/26  | 31/Aug/26 | Annual Maintance                                  |  |
| RAMGANGA POWER HOUSE        | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 66    | 1/Sep/26  | 1/Oct/26  | Annual Maintance                                  |  |
| VYASI POWER HOUSE           | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 10/Jan/27 | 8/Feb/27  | Annual Maintance                                  |  |
| VYASI POWER HOUSE           | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 60    | 18/Feb/27 | 19/Mar/27 | Annual Maintance                                  |  |
| KHATIMA POWER HOUSE         | 1 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 13.8  | 20/Jan/27 | 19/Feb/27 | Annual Maintance                                  |  |
| KHATIMA POWER HOUSE         | 2 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 13.8  | 15/Dec/26 | 13/Jan/27 | Annual Maintance                                  |  |
| KHATIMA POWER HOUSE         | 3 | HYDRO | NR | UTTARAKHAND      | UJVNL         | 13.8  | 10/Nov/26 | 9/Dec/26  | Annual Maintance                                  |  |